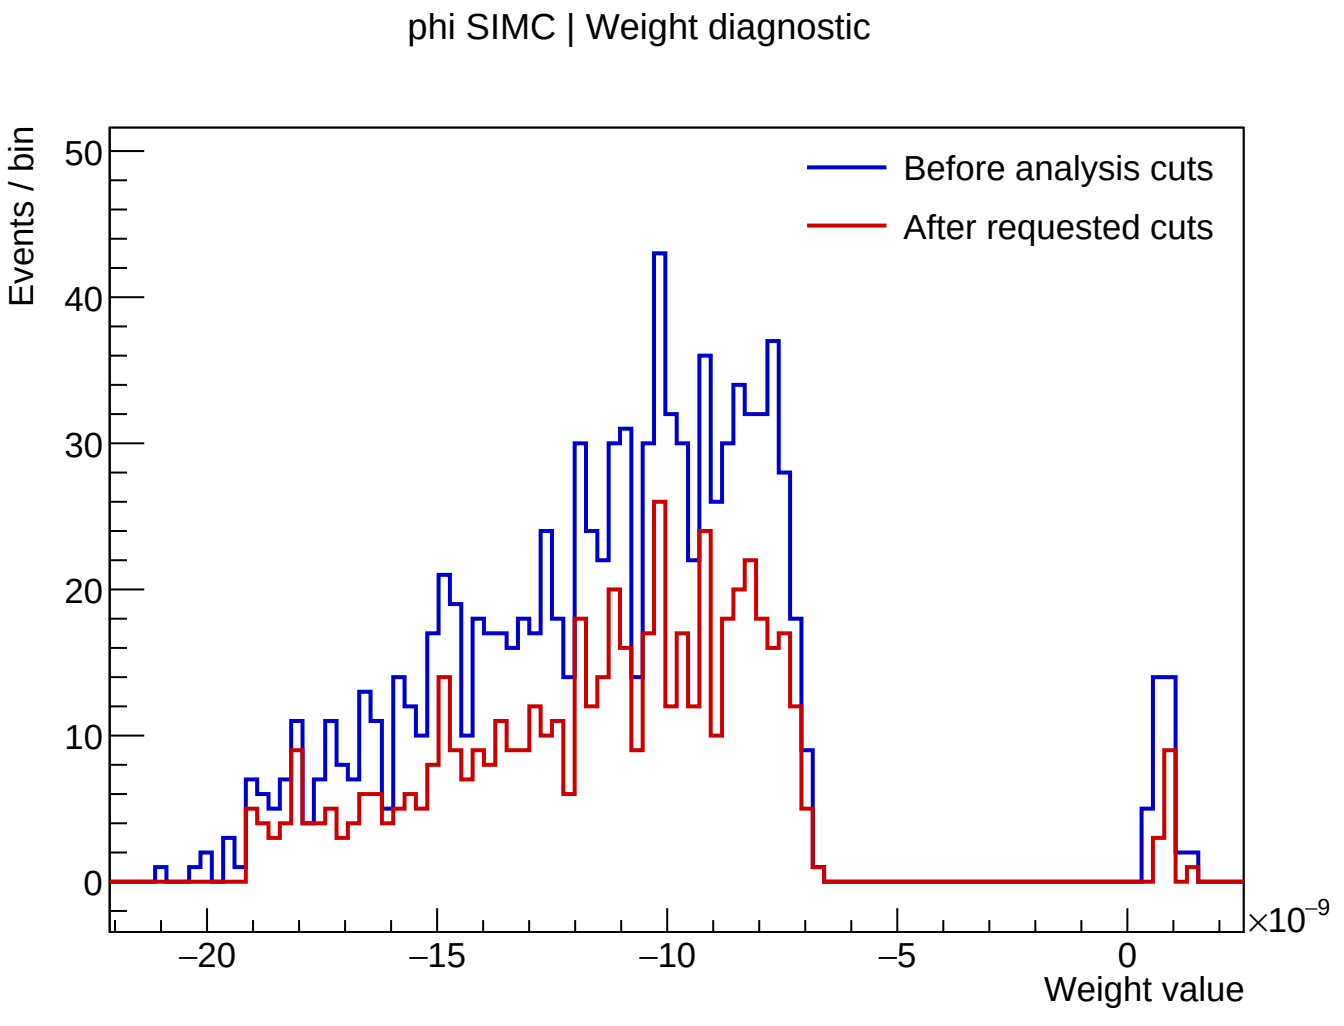
phi SIMC | Weight diagnostic
Events / bin
50
40
30
20
10
0
Before analysis cuts
After requested cuts
−20
−15
−10
−5
0
×10⁻⁹
Weight value