DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J.NAGANUMA/ APPD. T.MUROHOSHI// RE-REGD. 2016-04-28

DWG. No. 310SD14-370

REVISIONS					
REV.	DESCRIPTION	REVD.	CHKD.	APPD.	DATE
B	Revised by comments	A.M	J.N	T.M	2013-09-11
C	Revised by comments	A.M	J.N	T.M	2013-11-20
D	Revised by comments	A.M	H.N	J.N	2014-03-13
E	Revised by design progress	M.K	J.N	T.M	2014-08-05
0	For Construction	M.K	J.N	T.M	2014-09-26
1	For Construction	M.K	J.N	T.M	2015-05-15
2	For Construction	M.K	J.N	T.M	2015-07-29
3	Revised by design progress	A.O	J.N	T.M	2016-02-03
4	Revised by design progress	A.O	J.N	T.M	2016-04-27

TURBINE WIRING DIAGRAMS

三菱日立パワーシステムズ株式会社
MH
2016-04-27
MITSUBISHI HITACHI POWER SYSTEMS, LTD.

For Construction

WORK No. /CUSTOMER	
SIMILAR TO	DWG. No. 310SD14-370

THIS DOCUMENT IS THE PROPERTY OF MITSUBISHI HITACHI POWER SYSTEMS, LTD. (MHPS) AND CONFIDENTIAL. IT MUST NEITHER BE COPIED NOR USED FOR ANY PURPOSE OR MANNER OTHER THAN EXPRESSLY PERMITTED BY MHPS OR WITH A PRIOR WRITTEN CONSENT OF MHPS NEITHER IS IT TO BE HANDED OVER NOR COMMUNICATED TO A THIRD PARTY IN ANY WAY. BREACH OR INFRINGEMENT OF ANY KIND WILL LEAD TO LEGAL ACTION.

Drawn : Name/Date	A.Mori	/2013-07-09
Checked : Name/Date	H.Nakazawa	/2013-07-09
Approved: Name/Date	J.Naganuma	/2013-07-09

Title,supplementary title

TURBINE WIRING DIAGRAMS

FORMOSA HEAVY INDUSTRIES CORP.
100, SWEIKUAN RD., JENWU, KAOHSIUNG, TAIWAN, R.O.C.

PROJECT TITLE / LOCATION	OWNER / ADDRESS
SMC DAVAO POWER PLANT PROJECT MALITA, PROVINCE OF DAVAO DEL SUR, PHILIPPINES	San Miguel Consolidated Power Corporation 40 SAN MIGUEL AVENUE, MANDALUYONG CITY 1550 METRO MANILA, PHILIPPINES

Responsible dep.
Hitachi steam turbine control & auxiliary equipment design group section/ Hitachi steam turbine engineering department

Scale	DWG. No.	Rev.	Sheet	Date of issue
NTS	310SD14-370	4	1/42	

MITSUBISHI HITACHI POWER SYSTEMS, LTD.

CAD SOFTWARE	Auto CAD	SIZE DESIGNATION	A3

DWG. No. 310SD14-370

SH.NO.	Turbine Equipment		Revisions						
			D	E	0	1	2	3	4
1	COVER	—	3/13	8/5	9/24	5/11	7/1	2/3	4/27
2	CONTENTS	—	3/13	8/5	9/24	5/11	7/1	2/3	4/27
3	NOTES	—					7/1		4/27
4	TURBINE FRONT STANDARD	—		8/5					
5	TURBINE FRONT STANDARD	—				5/11			
6	HIP CASING	—	3/13	8/5	9/24	10/21			
7	LP CASING & NO.2 BEARING	—		8/5		5/11			
8	LP CASING & TURNING GEAR DEVICE	—				5/11			
9	MSV (A) & MSV (B)	—		8/5		5/11			
10	CV (A) & CV (B)	—				5/11			
11	CRV (A)	—				5/11			
12	CRV (B)	—				5/11			
13	MAIN OIL TANK	—	3/13	8/5	9/24	5/11	7/1		
14	MAIN OIL TANK & LOCAL	—	3/13	8/5		5/11			
15	LOCAL	—	3/13	8/5		5/11	7/1		
16	LOCAL	—		8/5		5/11			
17	LOCAL	—		8/5			7/1		
18	LOCAL	—		8/5					
19	TURBINE FRONT STANDARD	—						2/3	
20	TURBINE FRONT STANDARD	—			9/24	5/11	7/1	2/3	
21	HIP CASING	—	3/13		9/24				

MARKED THUS "*" WIRED AT JOB-SITE
BY CUSTOMER

SH.NO.	Turbine Equipment		Revisions						
			D	E	0	1	2	3	4
22	LP CASING	—	3/13		9/24				
23	LP CASING & TURNING GEAR DEVICE	—			9/24	5/11	7/1		
24	HIP CASING & LP CASING	—	3/13		9/24		7/1	2/3	
25	MAIN STOP VALVE (A)	—	3/13		9/24			2/3	
26	MAIN STOP VALVE (B)	—	3/13		9/24			2/3	
27	CONTROL VALVE (A)	—	3/13		9/24			2/3	
28	CONTROL VALVE (B)	—	3/13		9/24			2/3	
29	REHEAT STOP VALVE (A)	—			9/24				
30	INTERCEPT VALVE (A)	—	3/13		9/24			2/3	
31	REHEAT STOP VALVE (B)	—			9/24				
32	INTERCEPT VALVE (B)	—	3/13		9/24			2/3	
33	MAIN OIL TANK	—	3/13						
34	MAIN OIL TANK	—	3/13	8/5	9/24	5/11			
35	MAIN OIL TANK	—	3/13	8/5	9/24	5/11	7/1		4/27
36	LOCAL(LUBE OIL DEVICE & CONTROL VALVE)	—	3/13	8/5	9/24	5/11	7/1	2/3	
37	LOCAL(CONTROL VALVE)	—	3/13	8/5	9/24		7/1	2/3	
38	LOCAL(NON RETURN VALVE)	—		8/5	9/24		7/1		
39	LOCAL(NON RETURN VALVE)	—		8/5	9/24		7/1		
40	LOCAL(LOCAL RACK)	—			9/24		7/1		
41	LOCAL	—			9/24		7/1	2/3	
42	PRA-BOX	—			9/24				

NAME	CONTENTS			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 2	REV.	

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

TURBINE WIRING DIAGRAMS REFERENCE NOTES

1. ALL DEVICES LISTED ON THESE TABULATION SHEETS ARE SUPPLIED BY HITACHI, LTD. UNLESS OTHERWISE SPECIFIED.

2. THE WIRING FROM THE ELECTRICAL DEVICE TO THE JUNCTION BOX SHOWN IN THIS DRAWING WILL BE WIRED BY MHPS OR CUSTOMER (CONSTRUCTOR).

3. WIRING FOR THE ELECTRICAL DEVICES WITH * MARKING WILL BE WIRED BY CUSTOMER(CONSTRUCTOR) ON THE JOB-SITE, USING CABLES, CONDUITS, AND CONNECTORS SUPPLIED BY MHPS.


4. WIRING FOR ELECTRICAL DEVICES WITH NO * MARKING WILL BE WIRED BY MHPS IN THE FACTORY.

5. EXTERNAL CABLE FROM MCC AND TCS ARE DIRECTLY CONNECTED TO TERMINAL OF ELECTRICAL DEVICES WITH ◇ MARKING BY CUSTOMER (CONSTRUCTOR).


6. THE MARK "X" IN THE SWITCH ACTUATION TABLE SHOWS CLOSED CONTACT.

EXAMPLE


SYMBOL	CONTACT	ENGAGE	DISENGAGE
TSS	1-2		X
	3-4	X	



7. THE SWITCH OF THIS DRAWING SHOWS NORMAL CONTACT (NOT ACTUATING)

8. THE MARK  IN THE DRAWING SHOW THE SHIELD WIRE.

9. INTERNAL WIRING AND WIRE LABEL
THE INTERNAL WIRING IS FROM THE ELECTRICAL DEVICE TO THE JUNCTION BOX.
WIRE LABEL WILL BE ATTACHED TO BOTH ENDS OF THE WIRING OR TO ONE END(JUNCTION BOX SIDE) FOR THE ELECTRICAL DEVICE ACCESSORY CABLE. ON THE WIRE LABEL, THE TERMINAL NUMBER FOR WIRING CONNECTION WILL BE SHOWN.

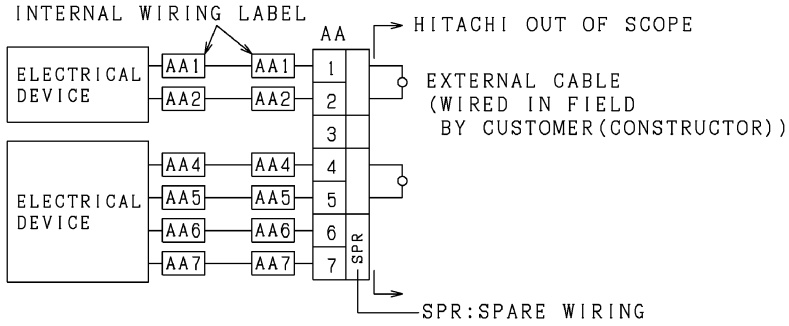

10. FOR THE FOLLOWING ELECTRICAL COMPONENTS, THE EXTERNAL CABLE WILL BE CONNECTED DIRECTLY TO THE TERMINAL OF ELECTRICAL COMPONENTS.
- ELECTRICAL MOTOR AND HEATER.
- LOCAL EQUIPMENT FOR WHICH A JUNCTION BOX CANNOT BE PREPARED.

11. THE DETAILS OF THE TEMPERATURE ELEMENT.
- TEMPERATURE-EMF AND LIMITS OF ERROR SHALL CONFORM TO "JIS C1602-1995 CLASS 1".
- FOR EXTENSION LEAD WIRE INSULATION COLOR CODE IN ACCORDANCE WITH JIS C1610-2012 CLASS 1.
- COLOR OF INSULATION ··· OVERALL:GREEN, POSITIVE:GREEN, NEGATIVE:WHITE

NAME	NOTES		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 3	REV.

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	ED	ZE-STn004	LOW SPEED ECCENTRICITY DETECTOR	BENTLY NEVADA	330101-00-20-10	19	
2	SXD	ZE-STn001	TURBINE SHELL EXPANSION (HP TURBINE SIDE) DETECTOR	BENTLY NEVADA	24765-02-00	19	
3	RPD-A	ZE-STn003-1	TURBINE ROTOR POSITION (A) DETECTOR	BENTLY NEVADA	330701-00-20-10	19	
4	RPD-B	ZE-STn003-2	TURBINE ROTOR POSITION (B) DETECTOR	BENTLY NEVADA	330701-00-20-10	19	
5	RPD-C	ZE-STn003-3	TURBINE ROTOR POSITION (C) DETECTOR	BENTLY NEVADA	330701-00-20-10	19	
6							
7	SPU-A	SE-STn001-1	TURBINE SPEED (A) SENSOR	ONO SOKKI CO.	MP-988	19	
8	SPU-B	SE-STn001-2	TURBINE SPEED (B) SENSOR	ONO SOKKI CO.	MP-988	19	
9	SPU-C	SE-STn001-3	TURBINE SPEED (C) SENSOR	ONO SOKKI CO.	MP-988	19	
10	SPU-D	SE-STn001-4	TURBINE SPEED (D) SENSOR	ONO SOKKI CO.	MP-988	19	
11	SPU-E	SE-STn001-5	TURBINE SPEED (E) SENSOR	ONO SOKKI CO.	MP-988	19	
12	SPU-F	SE-STn001-6	TURBINE SPEED (F) SENSOR	ONO SOKKI CO.	MP-988	19	
13							
14							
15	TE-M1	TE-STn009	NO.1 TURBINE JOURNAL BEARING METAL. TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	19	
16	TE-TFM1	TE-STn011-1	THRUST BEARING FRONT-END EMBEDDED METAL TEMP. (A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	19	
17	TE-TFM2	TE-STn011-2	THRUST BEARING FRONT-END EMBEDDED METAL TEMP. (B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	19	
18	TE-TRM1	TE-STn012-1	THRUST BEARING REAR-END EMBEDDED METAL TEMP. (A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	19	
19	TE-TRM2	TE-STn012-2	THRUST BEARING REAR-END EMBEDDED METAL TEMP. (B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	19	
20							
21							
22							
23							
24							

NAME	TURBINE FRONT STANDARD			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 4	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	VD-1X	VE-STn001-1	NO.1 TURBINE SHAFT VIBRATION (X) DETECTOR	BENTLY NEVADA	21000-33-10-00	19	
2	VD-1Y	VE-STn001-2	NO.1 TURBINE SHAFT VIBRATION (Y) DETECTOR	BENTLY NEVADA	21000-33-10-00	19	
3							
4	PR-V1X	VT-STn001-1	PROXIMITOR FOR NO.1 TURBINE SHAFT VIBRATION (X) DETECTOR	BENTLY NEVADA	330180-X1-00	20	
5	PR-V1Y	VT-STn001-2	PROXIMITOR FOR NO.1 TURBINE SHAFT VIBRATION (Y) DETECTOR	BENTLY NEVADA	330180-X1-00	20	
6	PR-ED	ZT-STn004	PROXIMITOR FOR LOW SPEED ECCENTRICITY DETECTOR	BENTLY NEVADA	330180-X1-00	20	
7	PR-RPA	ZT-STn003-1	PROXIMITOR FOR TURBINE ROTOR POSITION (A) DETECTOR	BENTLY NEVADA	330780-X1-00	20	
8	PR-RPB	ZT-STn003-2	PROXIMITOR FOR TURBINE ROTOR POSITION (B) DETECTOR	BENTLY NEVADA	330780-X1-00	20	
9	PR-RPC	ZT-STn003-3	PROXIMITOR FOR TURBINE ROTOR POSITION (C) DETECTOR	BENTLY NEVADA	330780-X1-00	20	
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							

NAME	TURBINE FRONT STANDARD		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 5	REV.

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	TE-S1A	TE-STn001-1	HP TURBINE FIRST STAGE INNER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
2	TE-S1B	TE-STn001-2	HP TURBINE FIRST STAGE OUTER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
3	TE-S3	TE-STn002-2	HP TURBINE EXHAUST INNER WALL METAL TEMP.(LOWER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
4	TE-S4	TE-STn002-1	HP TURBINE EXHAUST INNER WALL METAL TEMP.(UPPER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
5	TE-S5A	TE-STn003-1	HP TURBINE EXHAUST STEAM TEMP. (A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
6	TE-S5B	TE-STn003-2	HP TURBINE EXHAUST STEAM TEMP. (B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
7	TE-S5C	TE-STn003-3	HP TURBINE EXHAUST STEAM TEMP. (C) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
8	TE-CVA	TE-STn904-B1	CV (B) INNER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
9	TE-CVB	TE-STn904-B2	CV (B) OUTER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
10							
11	TE-S11	TE-STn004-1	REHEAT BOWL INNER WALL METAL TEMP.(A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
12	TE-S12A	TE-STn004-2	REHEAT BOWL INNER WALL METAL TEMP.(B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
13	TE-S12B	TE-STn005	REHEAT BOWL OUTER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
14	TE-S13A	TE-STn006-1	IP TURBINE AFTER 15 STAGE INNER WALL METAL TEMP.(UPPER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
15	TE-S13B	TE-STn006-2	IP TURBINE AFTER 15 STAGE INNER WALL METAL TEMP.(LOWER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
16	TE-S14A	TE-STn007-1	IP TURBINE AFTER 18 STAGE INNER WALL METAL TEMP.(UPPER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
17	TE-S14B	TE-STn007-2	IP TURBINE AFTER 18 STAGE INNER WALL METAL TEMP.(LOWER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
18	TE-S15A	TE-STn013-1	IP TURBINE AFTER 21 STAGE INNER WALL METAL TEMP.(UPPER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
19	TE-S15B	TE-STn013-2	IP TURBINE AFTER 21 STAGE INNER WALL METAL TEMP.(LOWER) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	21	
20							
21							
22							
23							
24							

NAME	HIP CASING			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 6	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	TE-EHA	TE-STn110-1	LP TURBINE EXHAUST HOOD STEAM TEMP. (A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	22	
2	TE-EHB	TE-STn110-2	LP TURBINE EXHAUST HOOD STEAM TEMP. (B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	22	
3	TE-EHC	TE-STn110-3	LP TURBINE EXHAUST HOOD STEAM TEMP. (C) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	22	
4	TE-EX1	TE-STn008	LP TURBINE EXTRACTION STEAM TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	22	
5							
6	PIT-307A	PT-STn110-1	LP TURBINE EXHAUST HOOD STEAM PRESS. (CONDENSER VACUUM) (A) TRANSMITTER	EMERSON	3051TA1A2B21	22	
7	PIT-307B	PT-STn110-2	LP TURBINE EXHAUST HOOD STEAM PRESS. (CONDENSER VACUUM) (B) TRANSMITTER	EMERSON	3051TA1A2B21	22	
8	PIT-307C	PT-STn110-3	LP TURBINE EXHAUST HOOD STEAM PRESS. (CONDENSER VACUUM) (C) TRANSMITTER	EMERSON	3051TA1A2B21	22	
9	TE-M2	TE-STn010	NO.2 TURBINE JOURNAL BEARING METAL. TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	22	
10							
11							
12	KYPH	ZE-STn005	KEY PHASER	BENTLY NEVADA	21000-33-05-00	22	
13	VD-2X	VE-STn002-1	NO.2 TURBINE SHAFT VIBRATION (X) DETECTOR	BENTLY NEVADA	21000-33-10-00	22	
14	VD-2Y	VE-STn002-2	NO.2 TURBINE SHAFT VIBRATION (Y) DETECTOR	BENTLY NEVADA	21000-33-10-00	22	
15	DXD-A	ZE-STn002-1	LP TURBINE DIFF. EXPANSION(A) DETECTOR	BENTLY NEVADA	330851-04-000-020	22	
16	DXD-B	ZE-STn002-2	LP TURBINE DIFF. EXPANSION(B) DETECTOR	BENTLY NEVADA	330851-04-000-020	22	
17							
18	PR-V2X	VT-STn002-1	PROXIMITOR FOR NO.2 TURBINE SHAFT VIBRATION (X) DETECTOR	BENTLY NEVADA	330180-X1-00	22	
19	PR-V2Y	VT-STn002-2	PROXIMITOR FOR NO.2 TURBINE SHAFT VIBRATION (Y) DETECTOR	BENTLY NEVADA	330180-X1-00	22	
20	PR-DXA	ZT-STn002-1	PROXIMITOR FOR LP TURBINE DIFF. EXPANSION (A) DETECTOR	BENTLY NEVADA	330850-X1-05	22	
21	PR-DXB	ZT-STn002-2	PROXIMITOR FOR LP TURBINE DIFF. EXPANSION (B) DETECTOR	BENTLY NEVADA	330850-X1-05	22	
22	PR-KYPH	ZT-STn005	PROXIMITOR FOR KEY PHASER	BENTLY NEVADA	330180-X1-00	22	
23							
24							

NAME	LP CASING & No.2 BEARING			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 7	REV.	

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	TGM	M-n906	TURNING GEAR MOTOR	TATUNG CO.	AC460V 11kW	23	
2							
3	TGS	SV-LOn906	TURNING GEAR ENGAGE SOLENOID VALVE	JAPAN ASCO	HC8316D15V	23	DC125V
4	TTS	ZS-LOn906-2	TURNING GEAR DISENGAGE POSITION	HONEYWELL CO.	LSA4L	23	
5	TSS	ZS-LOn906-1	TURNING GEAR ENGAGE POSITION	HONEYWELL CO.	LSA4L	23	
6	HTIS	ZS-LOn003	HAND TURNING INTERLOCK POSITION	HONEYWELL CO.	LSD4L	23	
7							
8	PB-JOG	-	TURNING MOTOR JOG PB	IDEC	ABN111	23	
9	PB-TGE	-	TURNING GEAR ENGAGE PB	IDEC	ABN111	23	
10	L-STT	-	TURNING MOTOR START LAMP	IDEC	APDE116DDN-R	23	
11	L-ENG	-	TURNING GEAR ENGAGE LAMP	IDEC	APDE116DDN-R	23	
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							

NAME	LP CASING & TURNING GEAR DEVICE			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 8	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	MVDT-AA	ZT-STn903-A1	MAIN STOP VALVE (A) POSITION (A)	REXROTH	WLU-200	25	
2	MVDT-AB	ZT-STn903-A2	MAIN STOP VALVE (A) POSITION (B)	REXROTH	WLU-200	25	
3	MVDT-AC	ZT-STn903-A3	MAIN STOP VALVE (A) POSITION (C)	REXROTH	WLU-200	25	
4	MVASV-A	SV-STn903-A1	MAIN STOP VALVE (A) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	25	AC110V
5	MVSV-A	SV-STn903-A2	MSV (A) SERVO VALVE	REXROTH	4WS2EM10-5X	25	
6							
7							
8							
9							
10							
11							
12							
13	MVDT-BA	ZT-STn903-B1	MAIN STOP VALVE (B) POSITION (A)	REXROTH	WLU-200	26	
14	MVDT-BB	ZT-STn903-B2	MAIN STOP VALVE (B) POSITION (B)	REXROTH	WLU-200	26	
15	MVDT-BC	ZT-STn903-B3	MAIN STOP VALVE (B) POSITION (C)	REXROTH	WLU-200	26	
16	MVASV-B	SV-STn903-B1	MAIN STOP VALVE (B) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	26	AC110V
17	MVSV-B	SV-STn903-B2	MSV (B) SERVO VALVE	REXROTH	4WS2EM10-5X	26	
18							
19	TE-MVBA	TE-STn903-B1	MSV (B) INNER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	26	
20	TE-MVBB	TE-STn903-B2	MSV (B) OUTER WALL METAL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	26	
21							
22							
23							
24							

NAME	MSV(A) & MSV(B)			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 9	REV.	

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	CVDT-AA	ZT-STn904-A1	CONTROL VALVE (A) POSITION (A)	REXROTH	WLU-100	27	
2	CVDT-AB	ZT-STn904-A2	CONTROL VALVE (A) POSITION (B)	REXROTH	WLU-100	27	
3	CVDT-AC	ZT-STn904-A3	CONTROL VALVE (A) POSITION (C)	REXROTH	WLU-100	27	
4	CVASV-A	SV-STn904-A1	CONTROL VALVE (A) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	27	AC110V
5	CVSV-A	SV-STn904-A2	CV (A) SERVO VALVE	REXROTH	4WS2EM10-5X	27	
6							
7							
8							
9							
10							
11							
12							
13	CVDT-BA	ZT-STn904-B1	CONTROL VALVE (B) POSITION (A)	REXROTH	WLU-100	28	
14	CVDT-BB	ZT-STn904-B2	CONTROL VALVE (B) POSITION (B)	REXROTH	WLU-100	28	
15	CVDT-BC	ZT-STn904-B3	CONTROL VALVE (B) POSITION (C)	REXROTH	WLU-100	28	
16	CVASV-B	SV-STn904-B1	CONTROL VALVE (B) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	28	AC110V
17	CVSV-B	SV-STn904-B2	CV (B) SERVO VALVE	REXROTH	4WS2EM10-5X	28	
18							
19							
20							
21							
22							
23							
24							

NAME	CV(A) & CV(B)			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 10	REV.	

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	RVDT-AA	ZT-STn905-A1	REHEAT STOP VALVE (A) POSITION (A)	REXROTH	WLU-300	29	
2	RVDT-AB	ZT-STn905-A2	REHEAT STOP VALVE (A) POSITION (B)	REXROTH	WLU-300	29	
3	RVDT-AC	ZT-STn905-A3	REHEAT STOP VALVE (A) POSITION (C)	REXROTH	WLU-300	29	
4	RVASV-A	SV-STn906-A1	REHEAT STOP VALVE (A) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	29	AC110V
5	RVTSV-A	SV-STn906-A2	REHEAT STOP VALVE (A) TEST SOLENOID VALVE	REXROTH	4WE6D6X	29	AC110V
6							
7							
8							
9							
10							
11							
12							
13	IVDT-AA	ZT-STn905-A4	INTERCEPT VALVE (A) POSITION (A)	REXROTH	WLU-300	30	
14	IVDT-AB	ZT-STn905-A5	INTERCEPT VALVE (A) POSITION (B)	REXROTH	WLU-300	30	
15	IVDT-AC	ZT-STn905-A6	INTERCEPT VALVE (A) POSITION (C)	REXROTH	WLU-300	30	
16	IVASV-A	SV-STn905-A1	INTERCEPT VALVE (A) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	30	AC110V
17	IVSV-A	SV-STn905-A2	ICV (A) SERVO VALVE	REXROTH	4WS2EM10-5X	30	
18							
19							
20							
21							
22							
23							
24							

NAME	CRV(A)			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 11	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	RVDT-BA	ZT-STn905-B1	REHEAT STOP VALVE (B) POSITION (A)	REXROTH	WLU-300	31	
2	RVDT-BB	ZT-STn905-B2	REHEAT STOP VALVE (B) POSITION (B)	REXROTH	WLU-300	31	
3	RVDT-BC	ZT-STn905-B3	REHEAT STOP VALVE (B) POSITION (C)	REXROTH	WLU-300	31	
4	RVASV-B	SV-STn906-B1	REHEAT STOP VALVE (B) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	31	AC110V
5	RVTSV-B	SV-STn906-B2	REHEAT STOP VALVE (B) TEST SOLENOID VALVE	REXROTH	4WE6D6X	31	AC110V
6							
7							
8							
9							
10							
11							
12							
13	IVDT-BA	ZT-STn905-B4	INTERCEPT VALVE (B) POSITION (A)	REXROTH	WLU-300	32	
14	IVDT-BB	ZT-STn905-B5	INTERCEPT VALVE (B) POSITION (B)	REXROTH	WLU-300	32	
15	IVDT-BC	ZT-STn905-B6	INTERCEPT VALVE (B) POSITION (C)	REXROTH	WLU-300	32	
16	IVASV-B	SV-STn905-B1	INTERCEPT VALVE (B) FAST ACTING SOLENOID VALVE	REXROTH	4WE6D6X	32	AC110V
17	IVSV-B	SV-STn905-B2	ICV (B) SERVO VALVE	REXROTH	4WS2EM10-5X	32	
18							
19							
20							
21							
22							
23							
24							

NAME	CRV(B)			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 12	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	PIT-201A	PT-LOn003-1	BEARING OIL PRESS. (A) TRANSMITTER	EMERSON	3051TG2A2B21	33	
2	PIT-201B	PT-LOn003-2	BEARING OIL PRESS. (B) TRANSMITTER	EMERSON	3051TG2A2B21	33	
3	PIT-201C	PT-LOn003-3	BEARING OIL PRESS. (C) TRANSMITTER	EMERSON	3051TG2A2B21	33	
4	PIT-202	PT-LOn923	EOP DISCHARGE OIL PRESS. TRANSMITTER	EMERSON	3051TG2A2B21	33	
5	PS-203	PS-LOn004	BEARING OIL PRESS. (FOR EOP AUTO START) SWICTH	NAGAKO KEIKI	CB33-2X3	33	
6	PIT-204A	PT-LOn922-A	MOP (A) DISCHARGE OIL PRESS. (FOR MOP(B) AUTO START) TRANSMITTER	EMERSON	3051TG2A2B21	33	
7	PIT-204B	PT-LOn922-B	MOP (B) DISCHARGE OIL PRESS. (FOR MOP(A) AUTO START) TRANSMITTER	EMERSON	3051TG2A2B21	33	
8							
9	PIT-231A	PT-LOn006-1	CONTROL OIL PRESS. (A) TRANSMITTER	EMERSON	3051TG4A2B21	33	
10	PIT-231B	PT-LOn006-2	CONTROL OIL PRESS. (B) TRANSMITTER	EMERSON	3051TG4A2B21	33	
11	PIT-231C	PT-LOn006-3	CONTROL OIL PRESS. (C) TRANSMITTER	EMERSON	3051TG4A2B21	33	
12	PIT-232A	PT-LOn931-A	COP(A) DISCHARGE OIL PRESS. (FOR COP(B) AUTO START) TRANSMITTER	EMERSON	3051TG4A2B21	33	
13	PIT-232B	PT-LOn931-B	COP(B) DISCHARGE OIL PRESS. (FOR COP(A) AUTO START) TRANSMITTER	EMERSON	3051TG4A2B21	33	
14	PIT-233A	PT-LOn007-1	TURBINE TRIP OIL PRESS. (A) TRANSMITTER	EMERSON	3051TG4A2B21	33	
15	PIT-233B	PT-LOn007-2	TURBINE TRIP OIL PRESS. (B) TRANSMITTER	EMERSON	3051TG4A2B21	33	
16	PIT-233C	PT-LOn007-3	TURBINE TRIP OIL PRESS. (C) TRANSMITTER	EMERSON	3051TG4A2B21	33	
17							
18							
19	DPS-235A	DPIS-LOn933-A	CONTROL OIL LINE FILTER (A) DIFF. PRESS. HIGH SWITCH	PALL	RC771BZ097	35	
20	DPS-235B	DPIS-LOn933-B	CONTROL OIL LINE FILTER (B) DIFF. PRESS. HIGH SWITCH	PALL	RC771BZ097	35	
21							
22	LS-201	LSH-LOn920-2	MAIN OIL TANK LEVEL HIGH	KANEKO SANGYO	KLE-100-2LT	35	
23		LSL-LOn920-1	MAIN OIL TANK LEVEL LOW			35	
24							

NAME	MAIN OIL TANK			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 13	REV.	

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	MTSV-A1	SV-STn001-1	MASTER TRIP SOLENOID VALVE(AA)	TOKYO KEIKI INC.	F3SDG5S4-062A-125DC-50-JA-AM-S682P-10X-M	34	
2	MTSV-A2	SV-STn001-2	MASTER TRIP SOLENOID VALVE(AB)	TOKYO KEIKI INC.	F3SDG5S4-062A-125DC-50-JA-AM-S682P-10X-M	34	
3	MTSV-B1	SV-STn001-3	MASTER TRIP SOLENOID VALVE(BA)	TOKYO KEIKI INC.	F3SDG5S4-062A-125DC-50-JA-AM-S682P-10X-M	34	
4	MTSV-B2	SV-STn001-4	MASTER TRIP SOLENOID VALVE(BB)	TOKYO KEIKI INC.	F3SDG5S4-062A-125DC-50-JA-AM-S682P-10X-M	34	
5	MTSVS-A1	ZS-STn001-1	MASTER TRIP SOLENOID(AA) TRIP POSITION	OMRON Co.	Z-15-GQ-B	34	
6	MTSVS-A2	ZS-STn001-2	MASTER TRIP SOLENOID(AB) TRIP POSITION	OMRON Co.	Z-15-GQ-B	34	
7	MTSVS-B1	ZS-STn001-3	MASTER TRIP SOLENOID(BA) TRIP POSITION	OMRON Co.	Z-15-GQ-B	34	
8	MTSVS-B2	ZS-STn001-4	MASTER TRIP SOLENOID(BB) TRIP POSITION	OMRON Co.	Z-15-GQ-B	34	
9							
10							
11	MOPM-A	M-n922A	MAIN OIL PUMP MOTOR(A)	BALDOR	AC460V 75kW	35	
12	MOPM-B	M-n922B	MAIN OIL PUMP MOTOR(B)	BALDOR	AC460V 75kW	35	
13	EOPM	M-n923	EMERGENCY OIL PUMP MOTOR	BALDOR	DC125V 22kW	35	
14	VXM	M-n937	VAPOUR EXTRACTOR MOTOR	TECO	AC460V 2.2kW	35	
15	COPM-A	M-n931A	CONTROL OIL PUMP MOTOR(A)	TOSHIBA	AC460V 37kW	35	
16	COPM-B	M-n931B	CONTROL OIL PUMP MOTOR(B)	TOSHIBA	AC460V 37kW	35	
17			—— LOCAL ——				
18	TE-OTC	TE-LOn001	LUBE OIL COOLER INLET OIL TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	Pt 100Ω (DOUBLE ELEMENT)	35	
19	TE-OFCA	TE-LOn002-1	LUBE OIL COOLER OUTLET OIL TEMP. (A)	SUKEGAWA ELECTRIC CO.	Pt 100Ω (DOUBLE ELEMENT)	35	
20	TE-OFCB	TE-LOn002-2	LUBE OIL COOLER OUTLET OIL TEMP. (B)	SUKEGAWA ELECTRIC CO.	Pt 100Ω (DOUBLE ELEMENT)	35	
21							
22	OPPM	M-n941	OIL PURIFIER PUMP MOTOR	HITACHI	AC460V 1.5kW	35	
23	DPS-251	DPIS-LOn932	DUPLEX OIL FILTER DIFF. PRESS. SWITCH	MIDWEST	106QE-10-K0 (HNM)	36	
24	DPS-252	DPIS-LOn942	LUBE OIL CONDITIONER COALESCER FILTER DIFF. PRESS. HIGH SWITCH	ASHCROFT	100-F5502-S-04L-XQ33	36	

NAME	MAIN OIL TANK & LOCAL		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 14	REV.

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	WSVOS	ZSO-CDn904	LP EXHAUST HOOD WATER SPRAY VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	37	
2	WSVCS	ZSC-CDn904	LP EXHAUST HOOD WATER SPRAY VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	37	
3	WSVS	SV-CDn904	LP EXHAUST HOOD WATER SPRAY VALVE SOLENOID VALVE	ASCO	JKC8327G042MO	37	DC125V
4							
5	POT-SSFV	ZT-GSn031	STEAM SEAL FEED VALVE POSITION	SIEMENS	6DR5112	37	
6	SSFVCS	ZSC-GSn031	STEAM SEAL FEED VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	37	
7	SSFVBCS	ZSC-GSn032	SSFV BYPASS VALVE FULL CLOSE POSITION	AZBIL	LSP7L	37	
8	POT-SPUV	ZT-GSn034	STEAM PACKING UNLOADING VALVE POSITION	SIEMENS	6DR5122	37	
9							
10	BDVOS	ZSO-GSn039	BLOW DOWN VALVE FULL OPEN POSITION	AZBIL	VCL-5102-H	36	
11	BDVCS	ZSC-GSn039	BLOW DOWN VALVE FULL CLOSE POSITION	AZBIL	VCL-5102-H	36	
12	BDVS	SV-GSn039	BLOW DOWN VALVE SOLENOID VALVE	ASCO	JKC8316G084VMBMO	36	DC125V
13							
14	SDVS-HT	ZSO-GSn018	STEAM SEAL DIVERTING VALVE HEATER SIDE	AZBIL	VCL-5102-H	36	
15	SDVS-CD	ZSO-GSn017	STEAM SEAL DIVERTING VALVE CONDENSER SIDE	AZBIL	VCL-5102-H	36	
16	SDVSV	SV-GSn036	STEAM SEAL DIVERTING VALVE SOLENOID VALVE	ASCO	JKC8316G084VMBMO	36	DC125V
17							
18	VVOS	ZSO-CRn902	VENTILATOR VALVE FULL OPEN POSITION SWITCH	AZBIL	VCL-5102-H	37	
19	VVCS	ZSC-CRn902	VENTILATOR VALVE FULL CLOSE POSITION SWITCH	AZBIL	VCL-5102-H	37	
20	VVSV	SV-CRn902	VENTILATOR VALVE SOLENOID VALVE	ASCO	JKC8316G084VMBMO	37	DC125V
21							
22							
23							
24							

DWG. No. 310SD14-370

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	2ESNRVS	SV-TSn700	NO.2 EXTRACTION STEAM NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	38	DC125V
2	2ESNRVOS	ZSO-TSn700	NO.2 EXTRACTION STEAM NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	38	
3	2ESNRVCS	ZSC-TSn700	NO.2 EXTRACTION STEAM NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	38	
4							
5	3ESPNRVS	SV-TSn710	NO.3 EXTRACTION STEAM PRIMARY NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	38	DC125V
6	3ESPNRVOS	ZSO-TSn710	NO.3 EXTRACTION STEAM PRIMARY NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	38	
7	3ESPNRVOC	ZSC-TSn710	NO.3 EXTRACTION STEAM PRIMARY NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	38	
8							
9	3ESSNRVS	SV-TSn740	NO.3 EXTRACTION STEAM SECONDARY NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	38	DC125V
10	3ESSNRVOS	ZSO-TSn740	NO.3 EXTRACTION STEAM SECONDARY NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	38	
11	3ESSNRVCS	ZSC-TSn740	NO.3 EXTRACTION STEAM SECONDARY NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	38	
12							
13	4ESNRVS	SV-TSn720	NO.4 EXTRACTION STEAM NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	38	DC125V
14	4ESNRVOS	ZSO-TSn720	NO.4 EXTRACTION STEAM NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	38	
15	4ESNRVCS	ZSC-TSn720	NO.4 EXTRACTION STEAM NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	38	
16							
17	5ESNRVS	SV-TSn730	NO.5 EXTRACTION STEAM NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	39	
18	5ESNRVOS	ZSO-TSn730	NO.5 EXTRACTION STEAM NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	39	
19	5ESNRVCS	ZSC-TSn730	NO.5 EXTRACTION STEAM NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	39	
20							
21							
22	CRNRVOS	ZSO-CRn901	COLD REHEAT STEAM NON RETURN VALVE FULL OPEN POSITION	AZBIL	VCL-5101-H	39	
23	CRNRVCS	ZSC-CRn901	COLD REHEAT STEAM NON RETURN VALVE FULL CLOSE POSITION	AZBIL	VCL-5101-H	39	
24	CRNRVS	SV-CRn901	COLD REHEAT STEAM NON RETURN VALVE SOLENOID VALVE	ASCO	HT8327G42	39	DC125V

NAME	LOCAL			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 16	REV.	

DWG. No. 310SD14-370


NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	PIT-301A	PT-MSn901-1	MSV INLET STEAM PRESS. (A) TRANSMITTER	EMERSON	3051TG4A2B21	40	
2	PIT-301B	PT-MSn901-2	MSV INLET STEAM PRESS. (B) TRANSMITTER	EMERSON	3051TG4A2B21	40	
3	PIT-302A	PT-STn001-1	HP TURBINE FIRST STAGE STEAM PRESS. (A) TRANSMITTER	EMERSON	3051TG4A2B21	40	
4	PIT-302B	PT-STn001-2	HP TURBINE FIRST STAGE STEAM PRESS. (B) TRANSMITTER	EMERSON	3051TG4A2B21	40	
5	PIT-302C	PT-STn001-3	HP TURBINE FIRST STAGE STEAM PRESS. (C) TRANSMITTER	EMERSON	3051TG4A2B21	40	
6	PIT-303A	PT-CRn901-1	HP TURBINE EXHAUST STEAM PRESS. (A) TRANSMITTER	EMERSON	3051TG3A2B21	40	
7	PIT-303B	PT-CRn901-2	HP TURBINE EXHAUST STEAM PRESS. (B) TRANSMITTER	EMERSON	3051TG3A2B21	40	
8	PIT-303C	PT-CRn901-3	HP TURBINE EXHAUST STEAM PRESS. (C) TRANSMITTER	EMERSON	3051TG3A2B21	40	
9							
10	PIT-305A	PT-STn002-1	REHEAT BOWL STEAM PRESS. (A) TRANSMITTER	EMERSON	3051TG3A2B21	40	
11	PIT-305B	PT-STn002-2	REHEAT BOWL STEAM PRESS. (B) TRANSMITTER	EMERSON	3051TG3A2B21	40	
12	PIT-305C	PT-STn002-3	REHEAT BOWL STEAM PRESS. (C) TRANSMITTER	EMERSON	3051TG3A2B21	40	
13							
14	PIT-308A	PT-GSn001-1	GLAND STEAM SEAL HEADER PRESS. (A) TRANSMITTER	EMERSON	3051TG2A2B21	40	
15	PIT-308B	PT-GSn001-2	GLAND STEAM SEAL HEADER PRESS. (B) TRANSMITTER	EMERSON	3051TG2A2B21	40	
16							
17	PIT-207	PT-HRn901	HOT REHEAT STEAM PRESS. TRANSMITTER	EMERSON	3051TG3A2B21	40	
18							
19							
20							
21							
22							
23							
24							

NAME	LOCAL			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.		DWG.No. 310SD14-370	SH. 17	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

NO.	SYMBOL	TAG.NO.	NAME OF DEVICE	MANUFACTURER	TYPE OF DEVICE	REF.SHEET	REMARKS
1	TE-301A	TE-MSn902-1	MSV INLET STEAM TEMP. (A) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
2	TE-301B	TE-MSn902-2	MSV INLET STEAM TEMP. (B) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
3	TE-301C	TE-MSn902-3	MSV INLET STEAM TEMP. (C) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
4	TE-302	TE-MSn902-4	MSV INLET STEAM TEMP. (D) ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
5							
6							
7							
8	TE-305	TE-GSn002	GLAND STEAM SEAL HEADER STEAM TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
9	TE-306	TE-GSn003	GLAND STEAM SEAL LP INLET STEAM TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
10							
11	TE-304	TE-HRn902	HOT REHEAT STEAM TEMP. ELEMENT	SUKEGAWA ELECTRIC CO.	JIS K (DOUBLE ELEMENT)	41	
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							

DWG. No. 310SD14-370

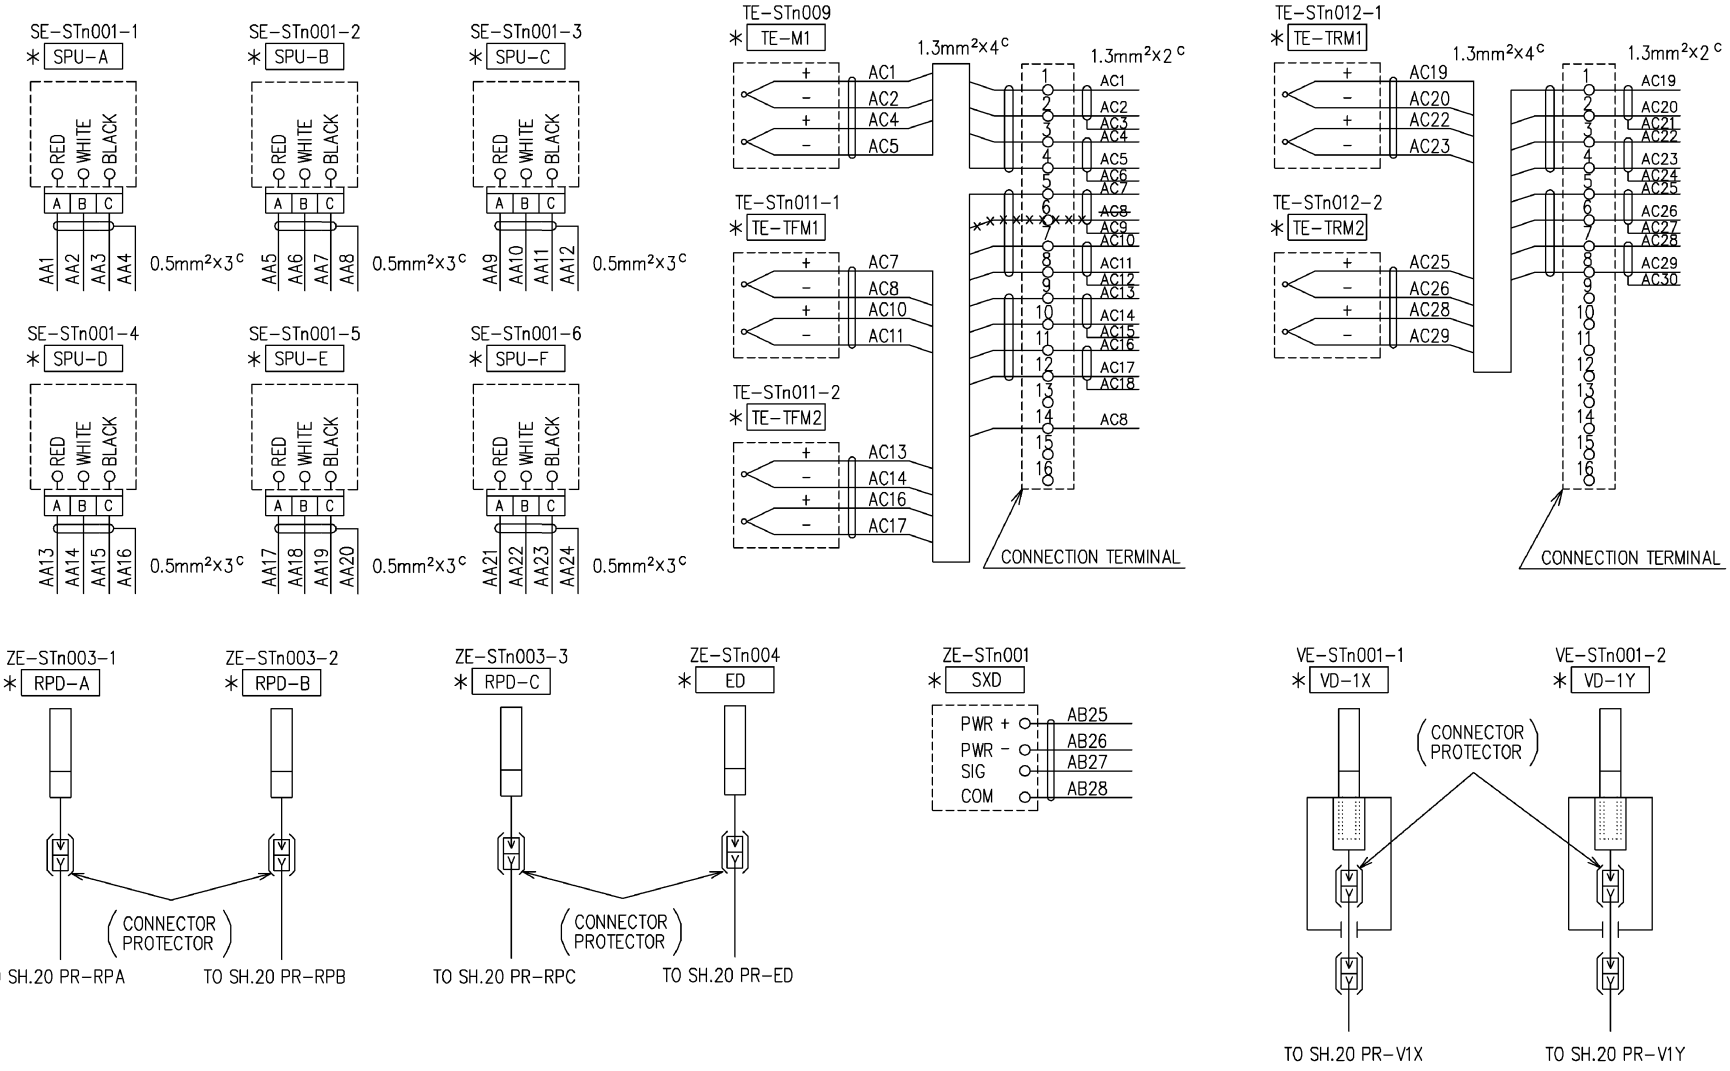


WIRING TO SH.20

NAME	TURBINE FRONT STANDARD		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 19	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

JUNCTION BOX FOR TURBINE FRONT STANDARD No. E-n920

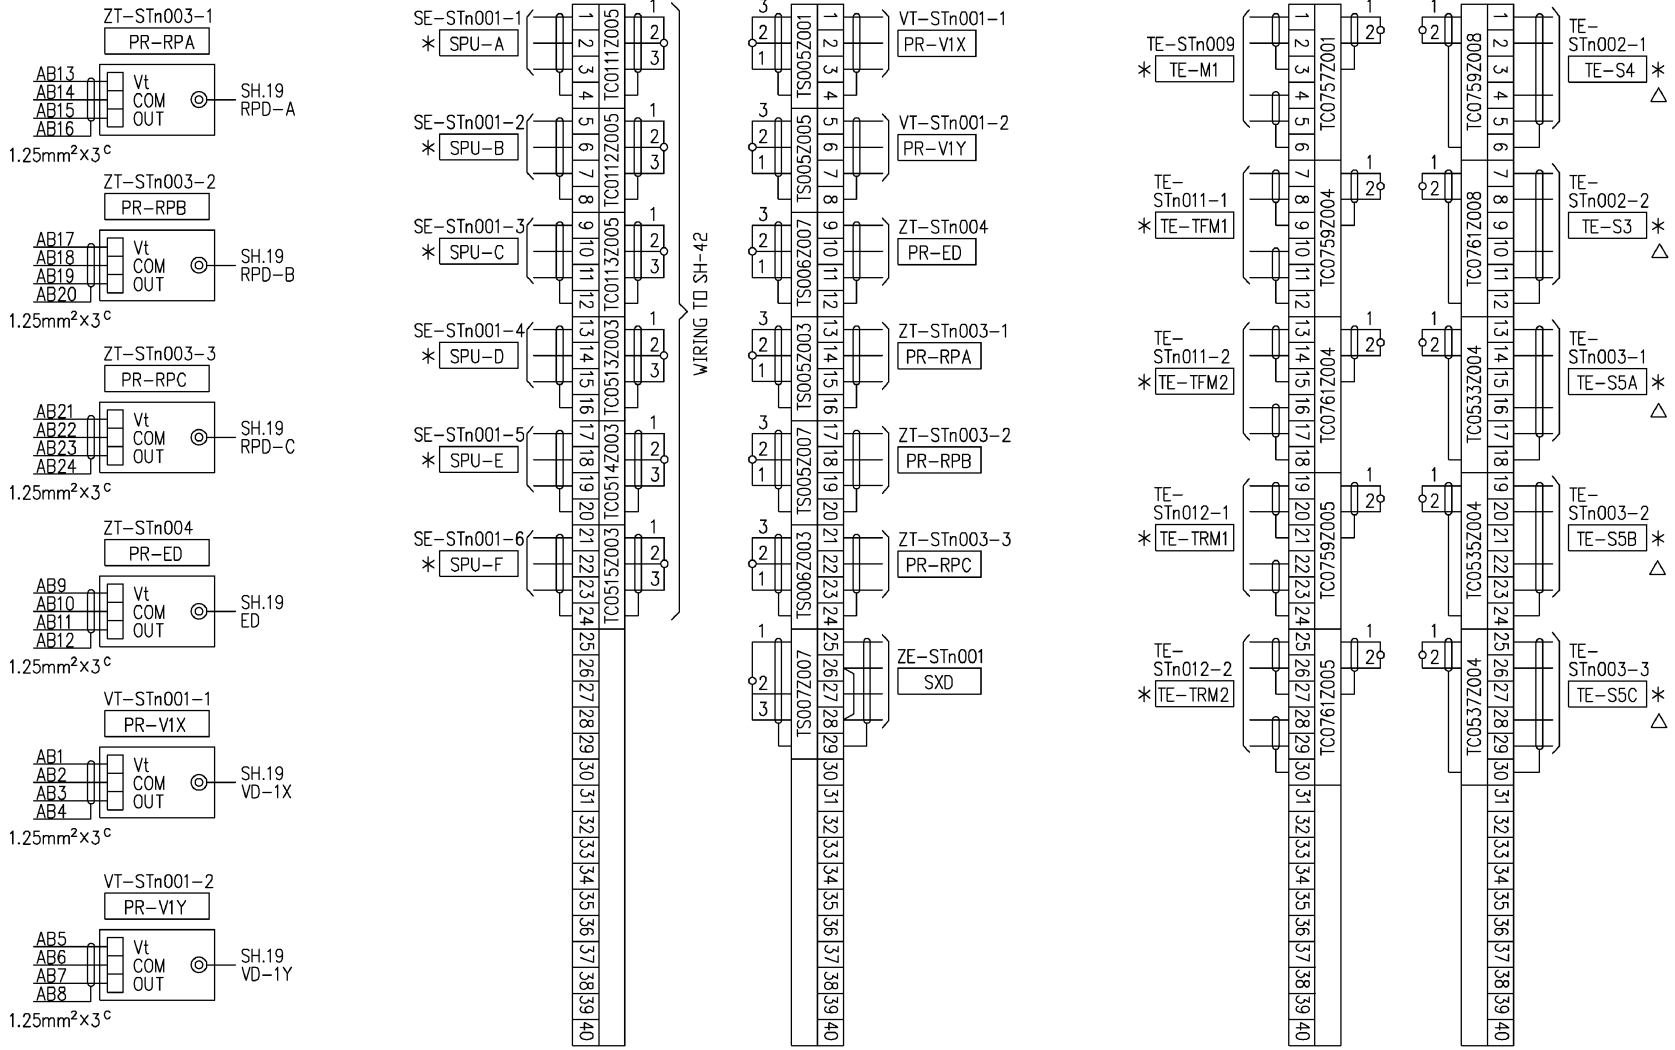


WIRING FROM SH.19

MARKED △ : WIRING FROM SH.21

NAME	TURBINE FRONT STANDARD		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 20	REV.


DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

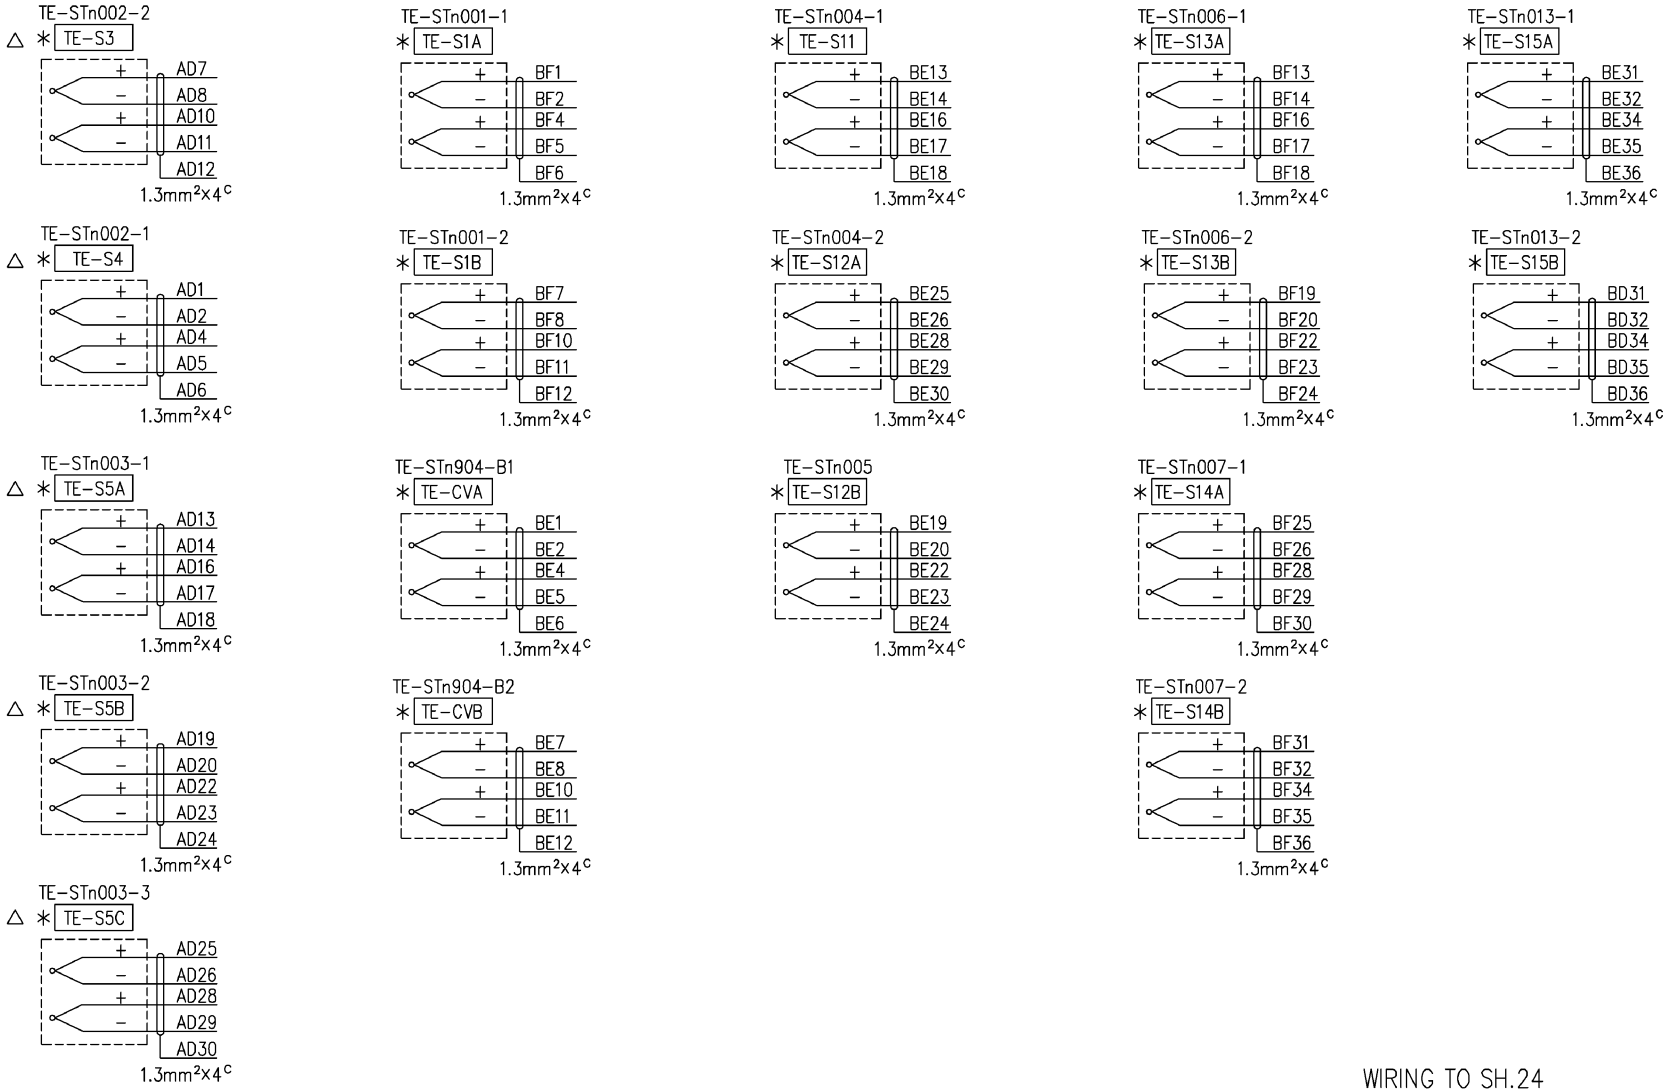

WIRING TO SH.24
MARKED △ : WIRING TO SH.20


NAME	HIP CASING		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 21	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

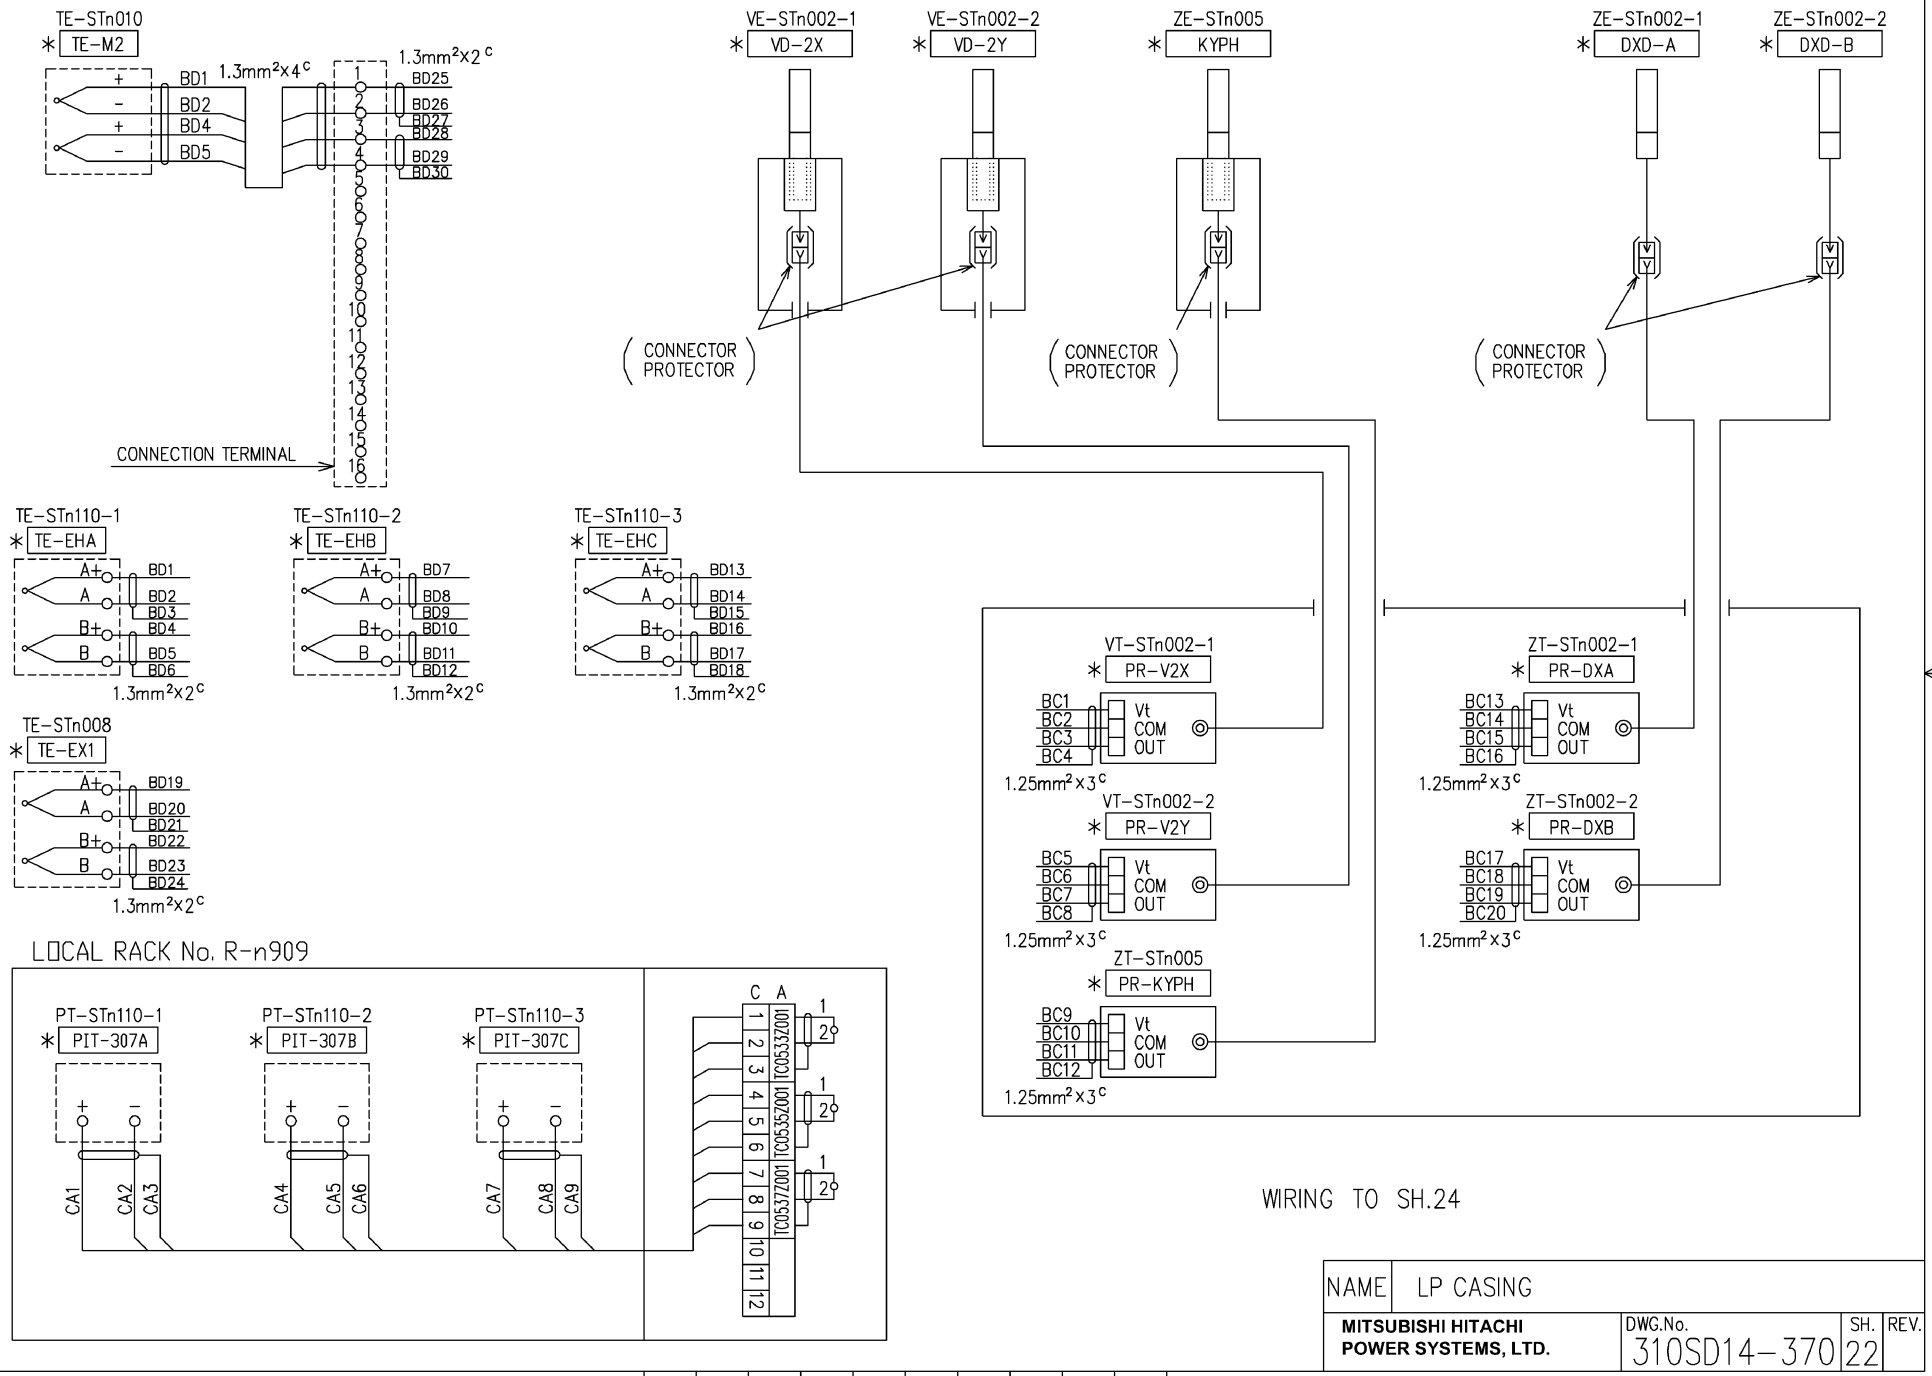

NAME	LP CASING		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 22	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

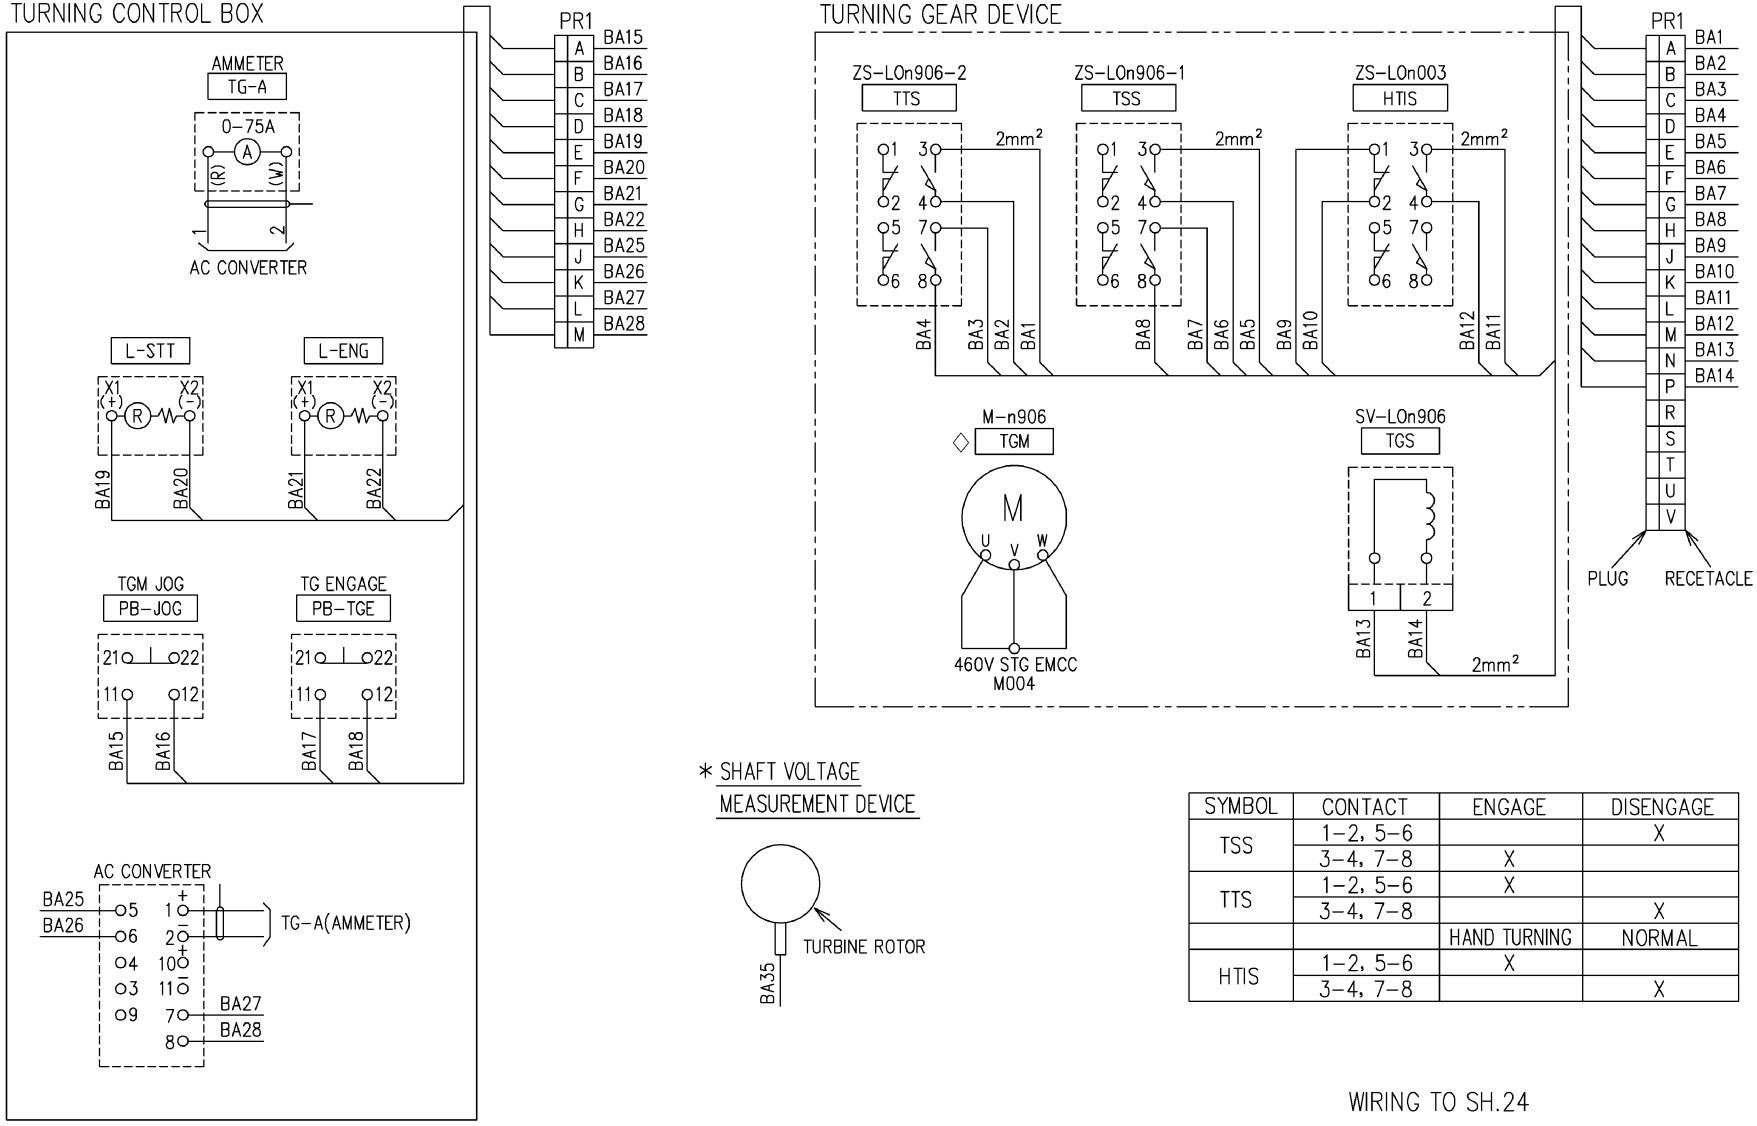


SYMBOL	CONTACT	ENGAGE	DISENGAGE
TSS	1-2, 5-6		X
	3-4, 7-8	X	
TTS	1-2, 5-6	X	
	3-4, 7-8		X
		HAND TURNING	NORMAL
HTIS	1-2, 5-6	X	
	3-4, 7-8		X

WIRING TO SH.24

NAME	LP CASING & TURNING GEAR DEVICE		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 23	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28


JUNCTION BOX FOR LP TURBINE No.E-n911

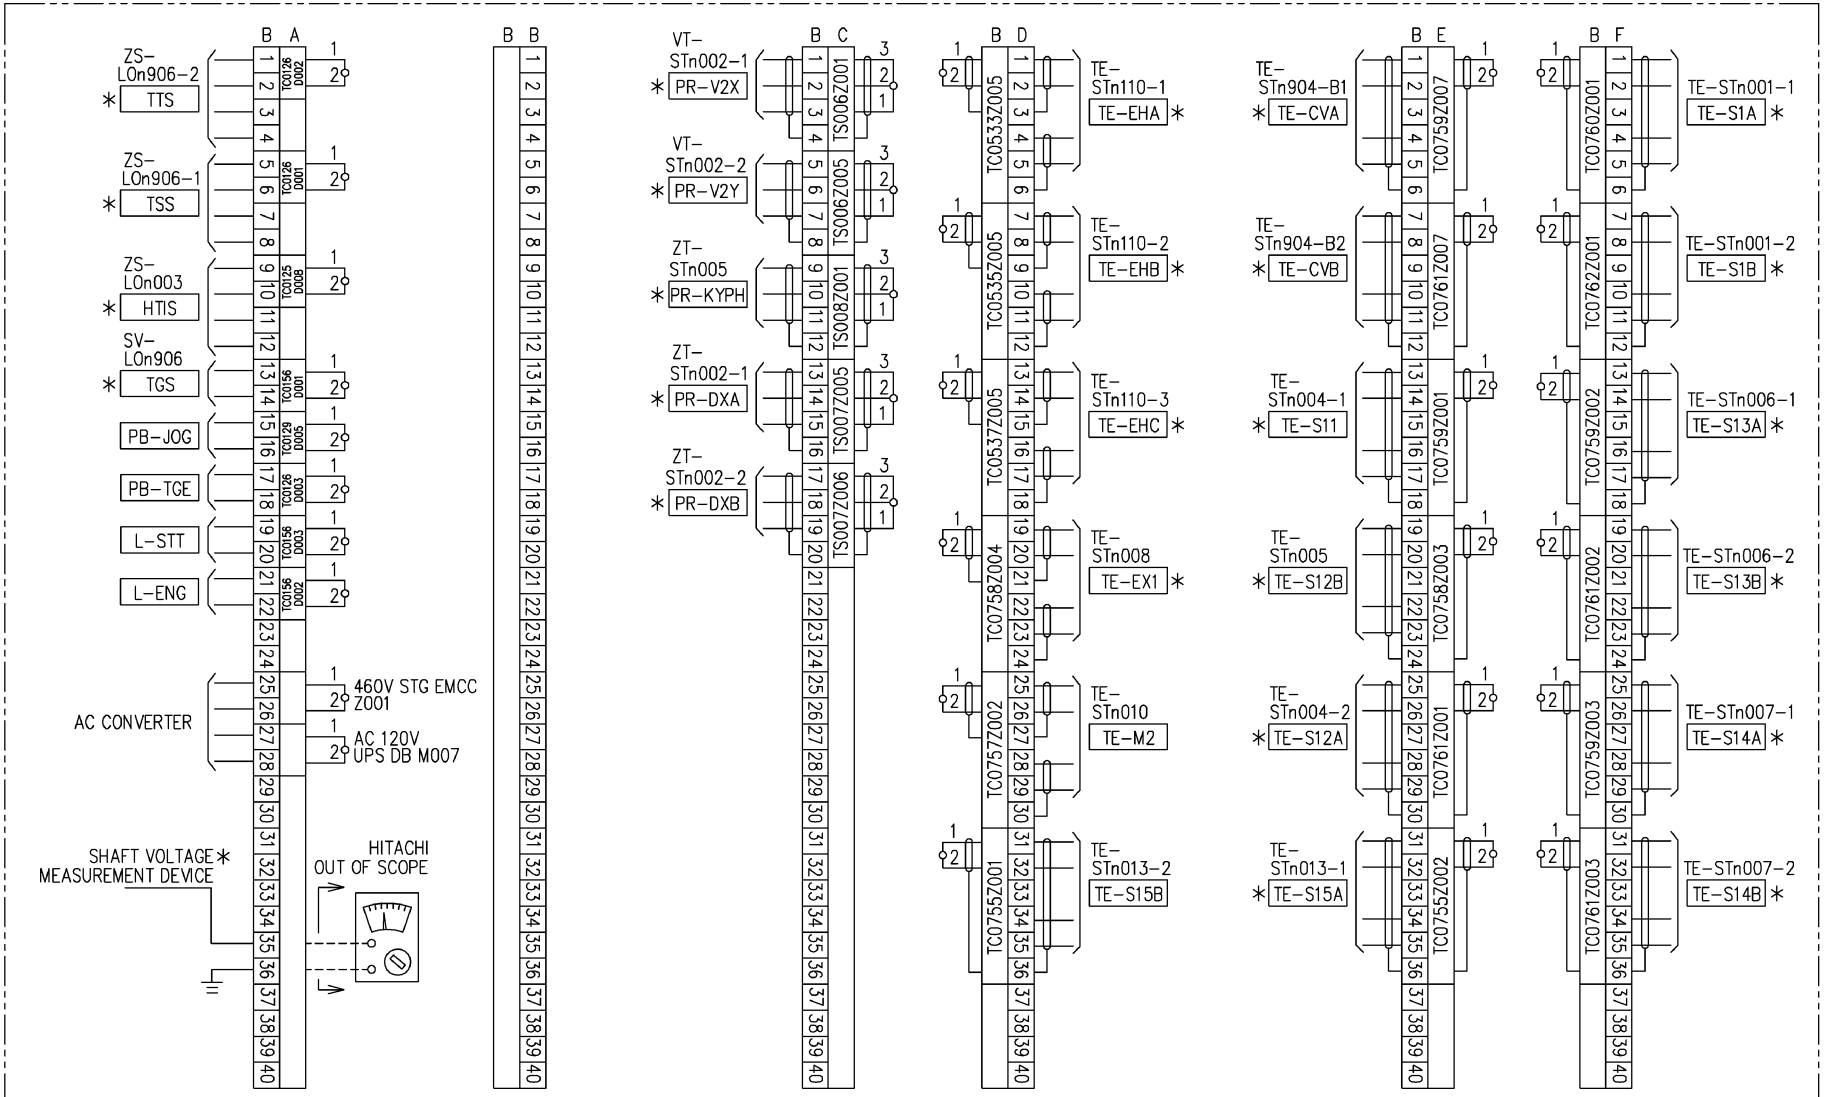


WIRING FROM SH.21 TO SH.23

NAME	HIP CASING & LP CASING		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 24	REV.


DWG. No. 310SD14-370

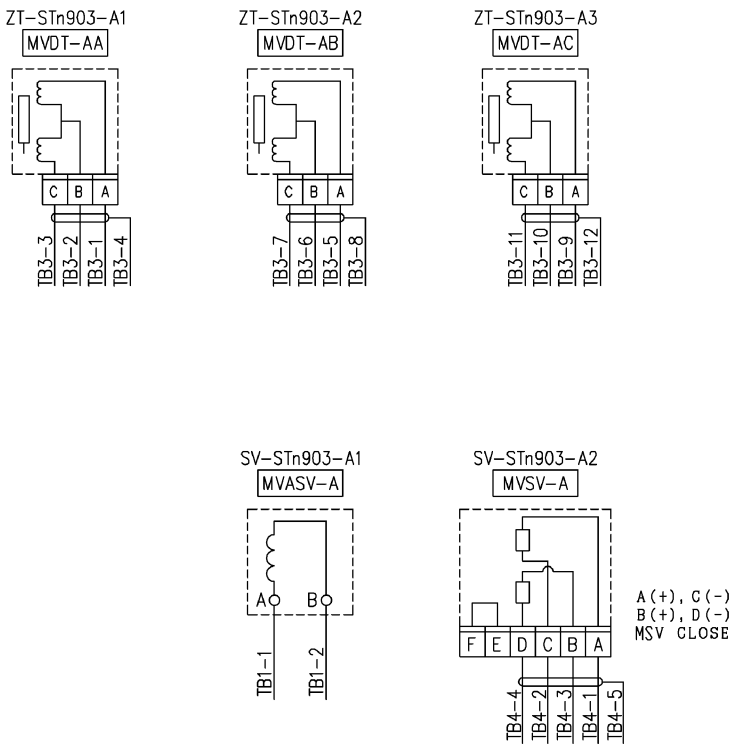


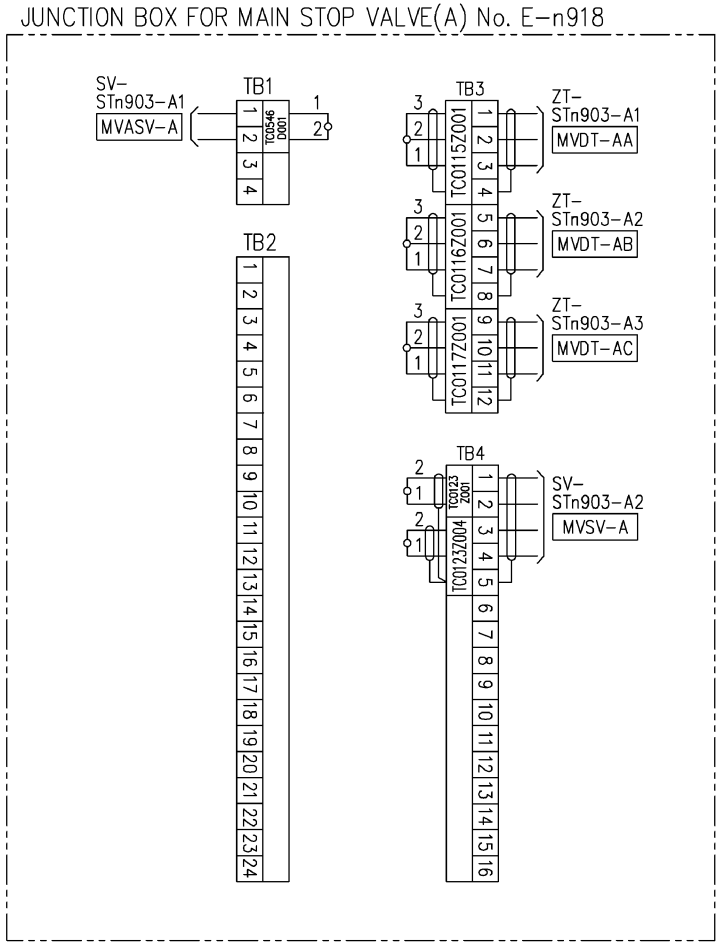



NAME	MAIN STOP VALVE(A)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 25	REV.


DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28












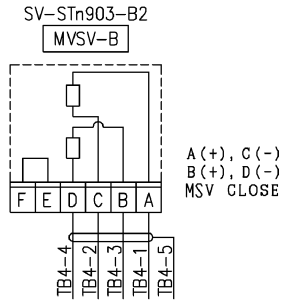







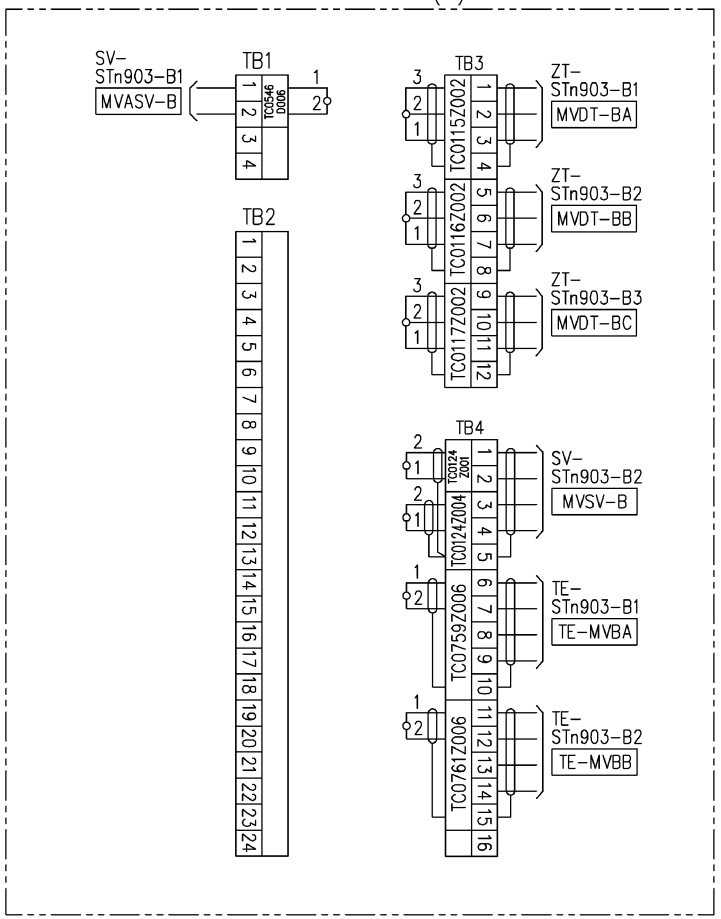

NAME	MAIN STOP VALVE(B)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 26	REV.


DWG. No. 310SD14-370

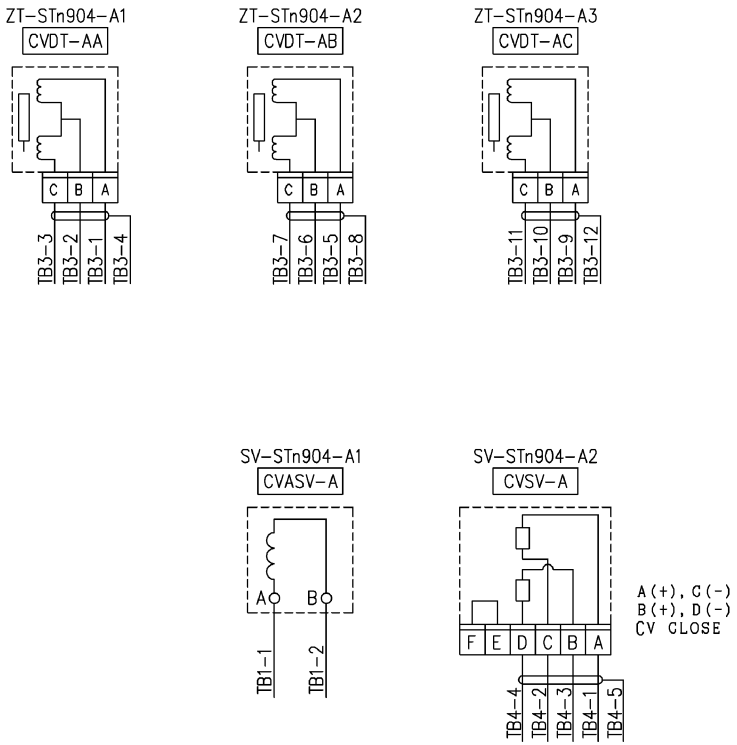


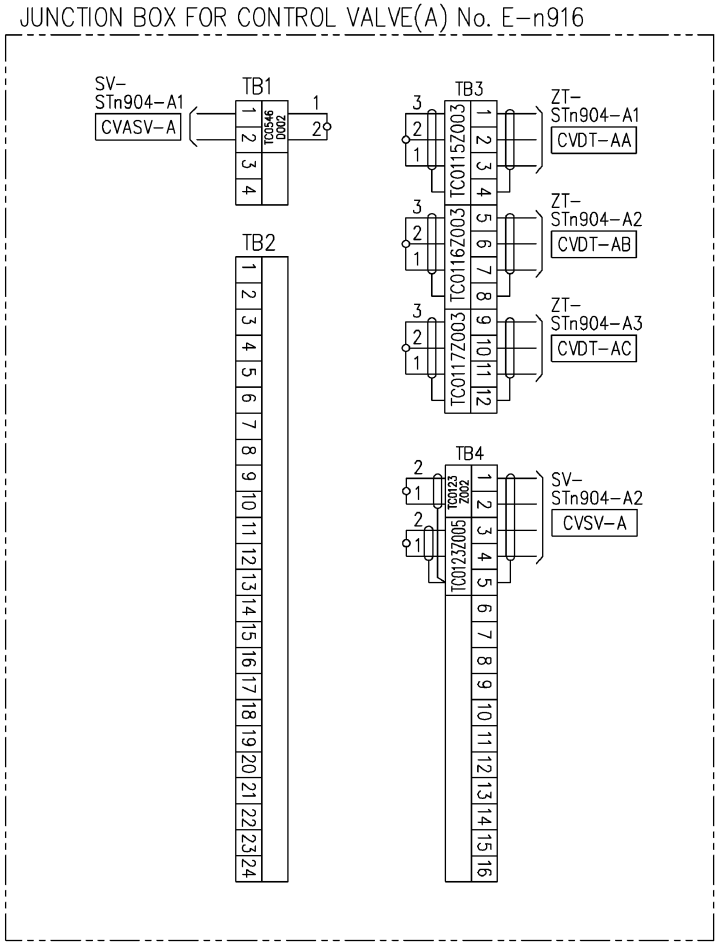



NAME	CONTROL VALVE(A)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 27	REV.


DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28











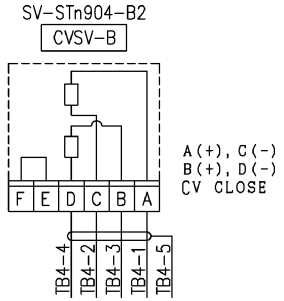


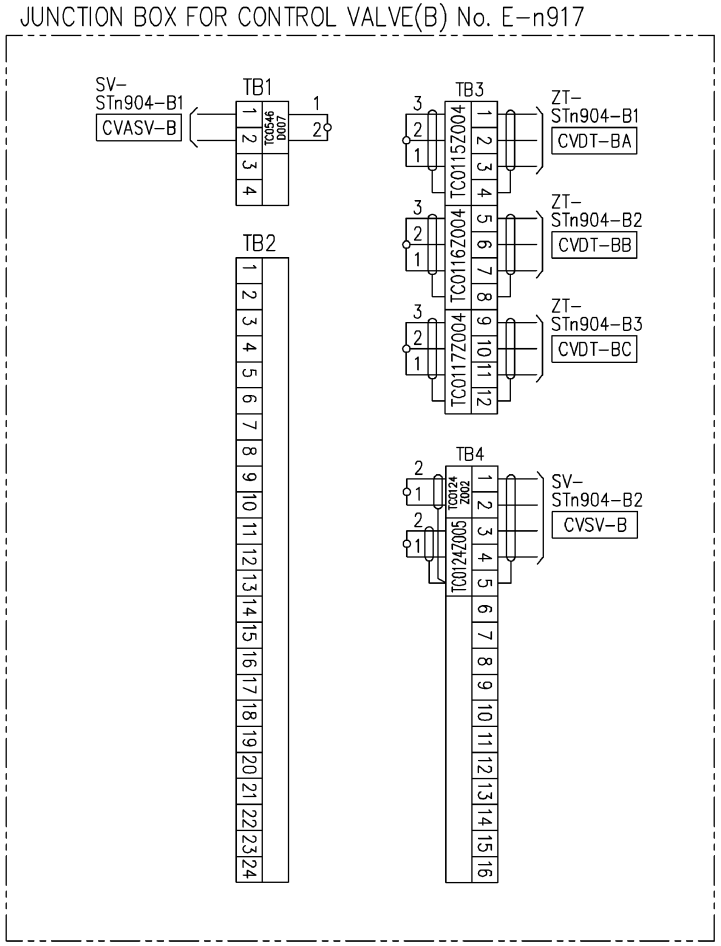


NAME	CONTROL VALVE(B)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 28	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

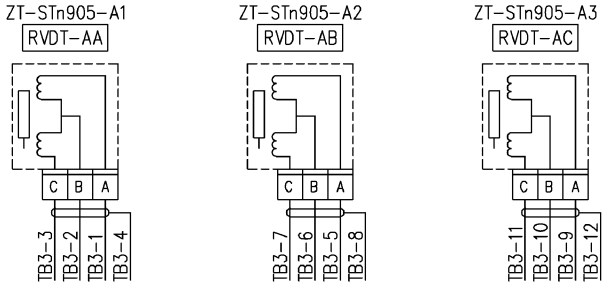


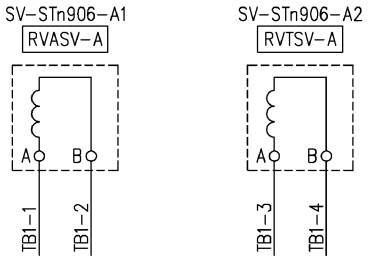


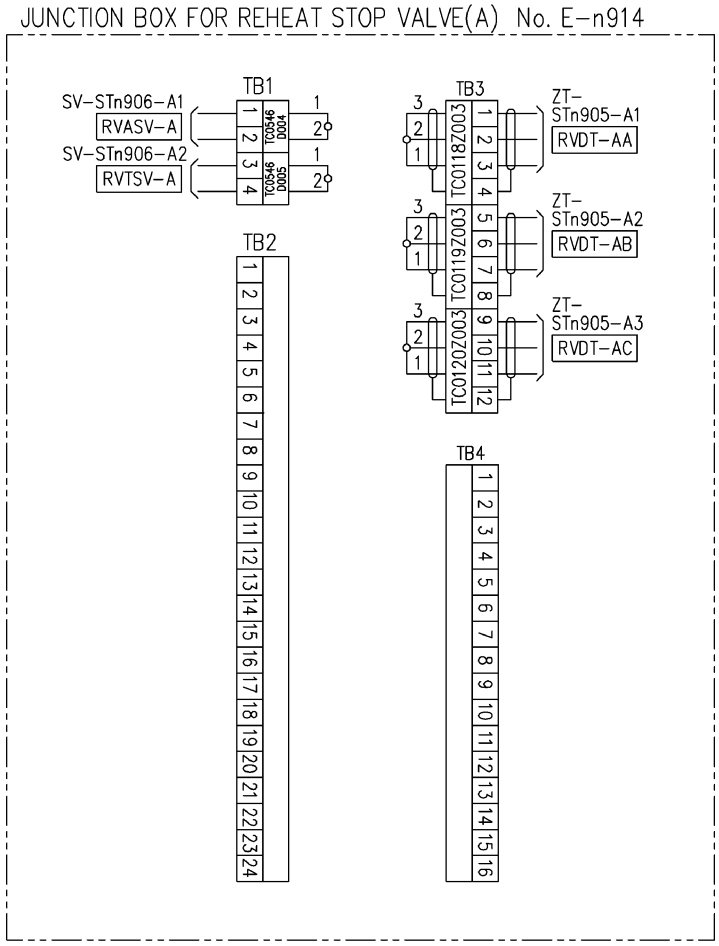

NAME	REHEAT STOP VALVE(A)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 29	REV.


DWG. No. 310SD14-370

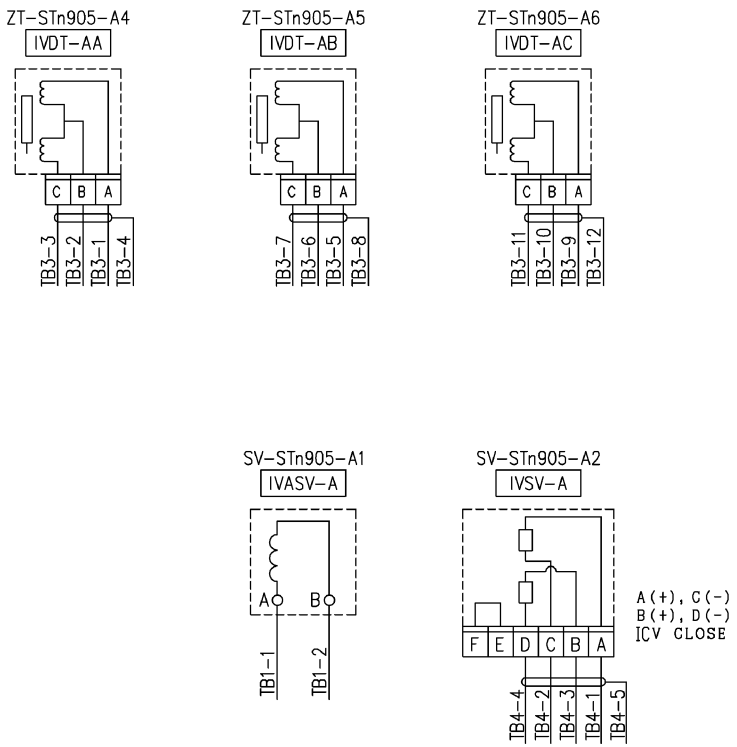


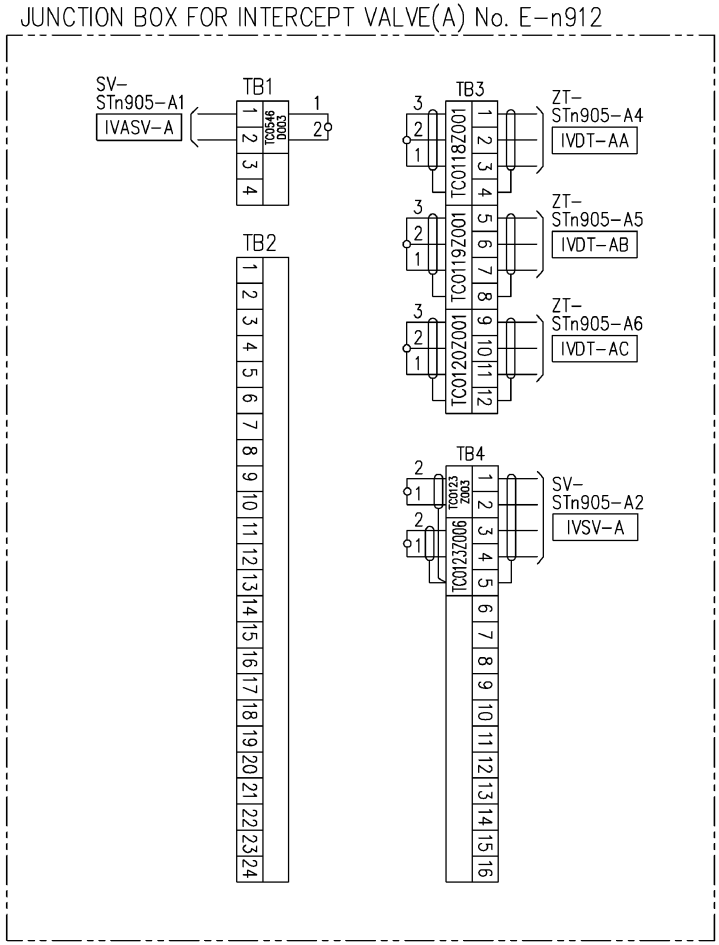

NAME	INTERCEPT VALVE(A)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 30	REV.


DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

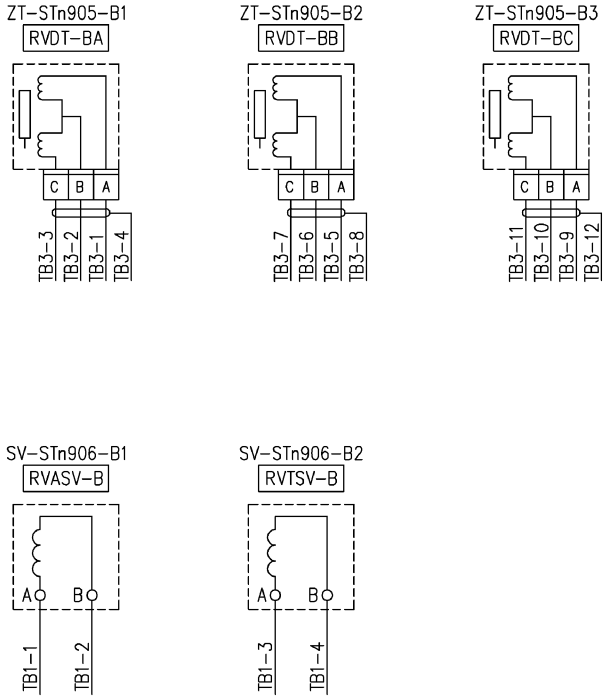


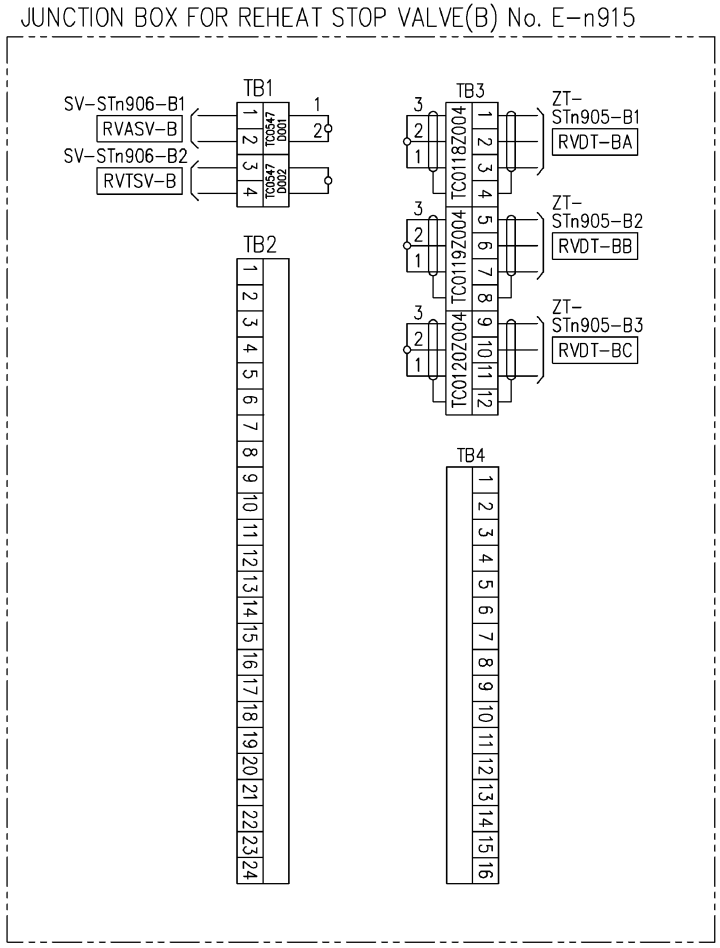

NAME	REHEAT STOP VALVE(B)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 31	REV.

DWG. No. 310SD14-370

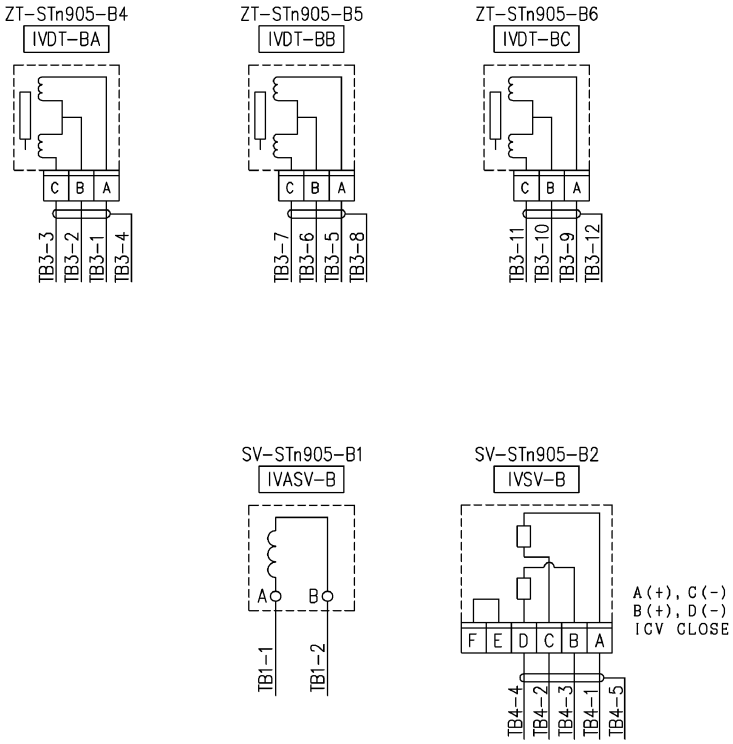


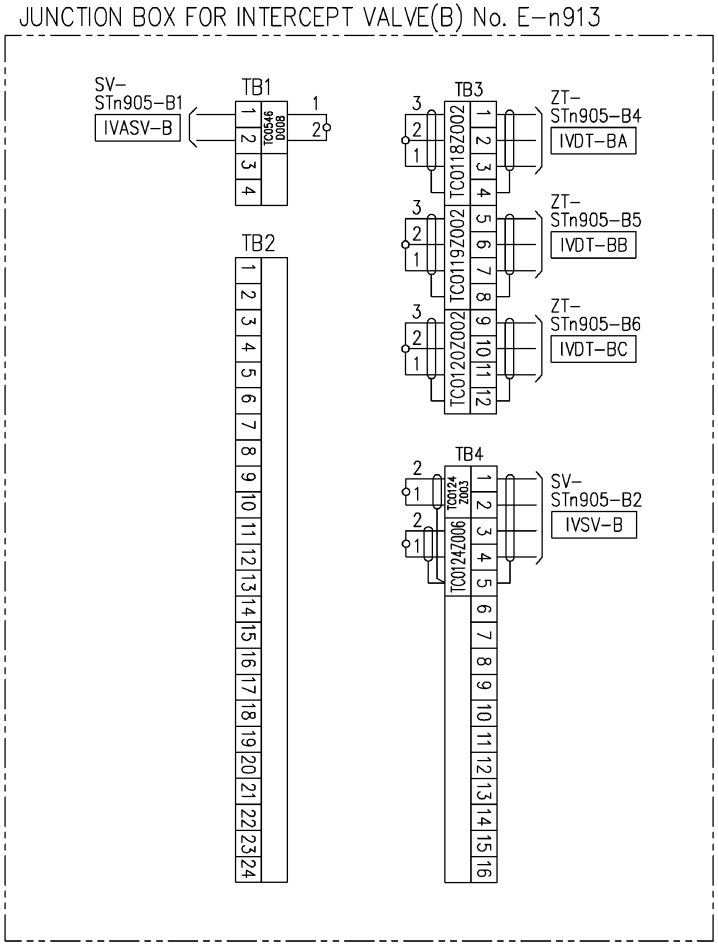

NAME	INTERCEPT VALVE(B)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 32	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28


INSTRUMENT RACK NO.R-n905

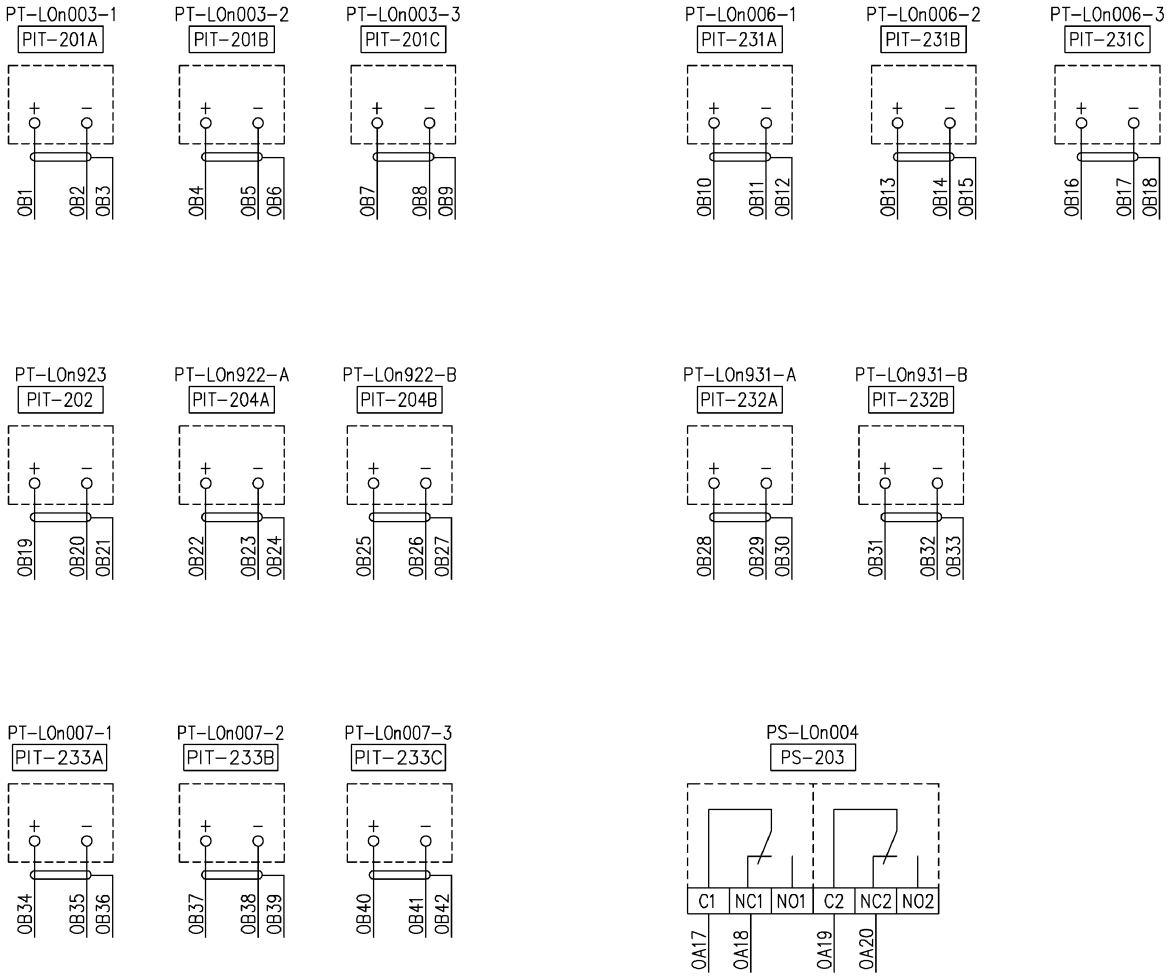


SYMBOL	CONTACT	INCREASE	DECREASE
PS-203	C1-NO1,C2-NO2	X	
	C1-NC1,C2-NC2		X

NAME	MAIN OIL TANK		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 33	REV.

DWG. No. 310SD14-370

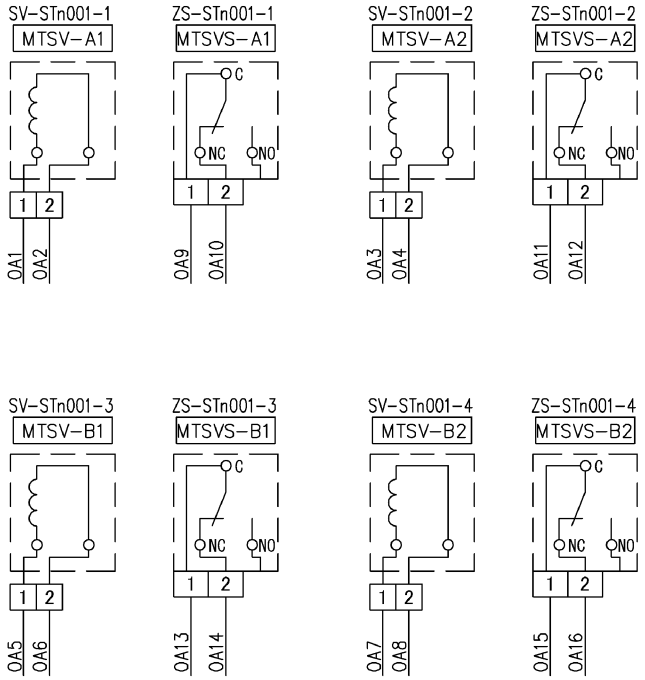


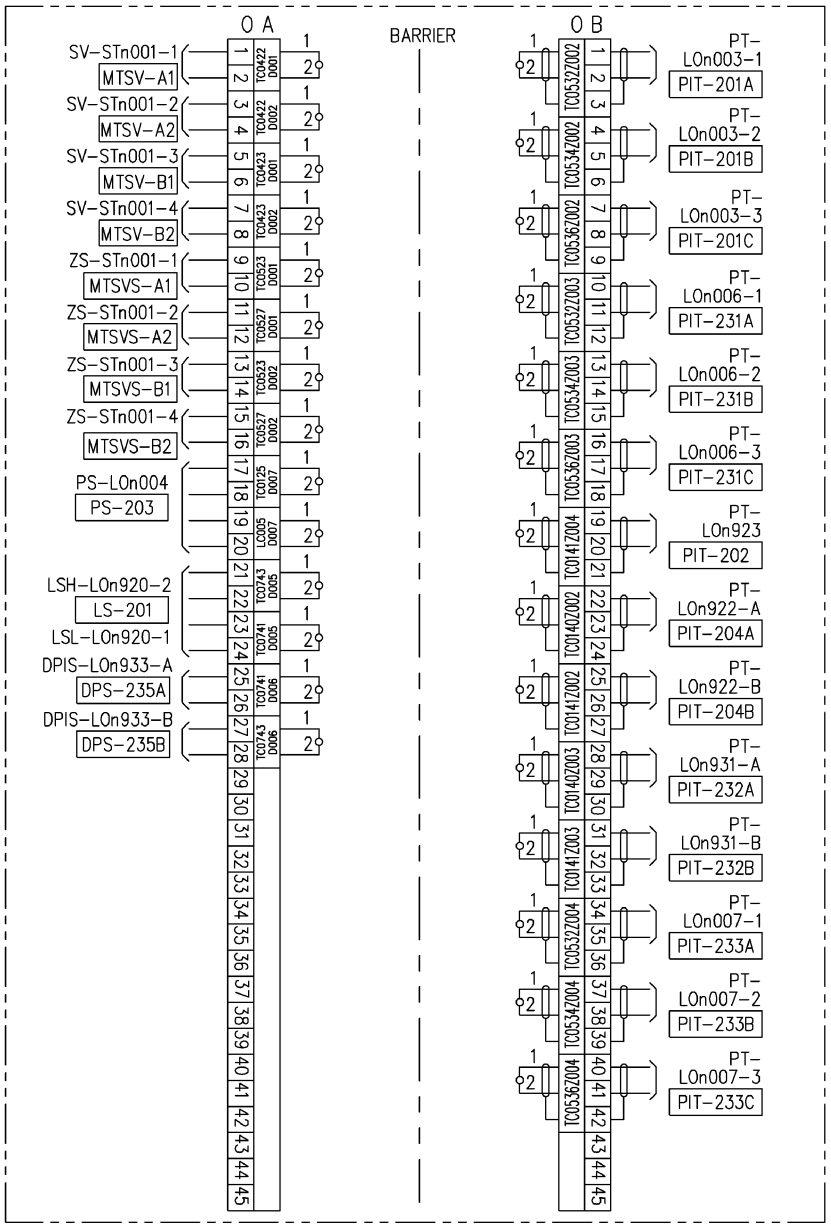

NAME	MAIN OIL TANK		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 34	REV.


DWG. No. 310SD14-370

M-u922A
◇ MOPM-A




460V STG EMCC
M001

M-u931A
◇ COPM-A




460V STG MCC
M002

M-u937
◇ VXM




460V STG EMCC
M003

M-u922B
◇ MOPM-B




460V STG EMCC
M002

M-u931B
◇ COPM-B



460V STG MCC
M003

M-u923
◇ EOPM

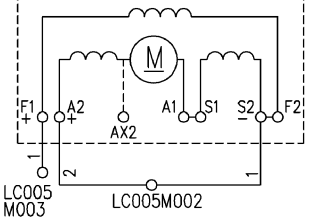

S2-F2
S1-A1
Connection by FHI.


LC005
M003

LC005M002

LS-201

LEVEL HIGH
LSH-LOn920-2

LEVEL LOW
LSL-LOn920-1




WIRING TO SH.34

SYMBOL	CONTACT	LEVEL HIGH	LEVEL LOW
LS-201	H1-C1	X	
	L2-C2		X

DPIS-LOn933-A
DPS-235A


DPIS-LOn933-B
DPS-235B

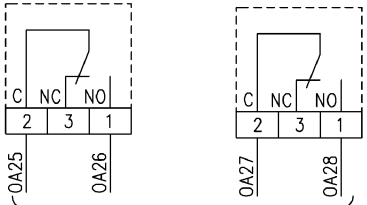

WIRING TO SH.34


SYMBOL	CONTACT	INCREASE	DECREASE
DPS-235A	1-2	X	
	2-3		X
DPS-235B	1-2	X	
	2-3		X

M-u941
◇ OPPM




460V STG MCC
M001

TE-LOn001
◇ TE-OTC




TC0763
Z001

TE-LOn002-1
◇ TE-OFCA



TC0756
Z004

TE-LOn002-2
◇ TE-OFCB




TC0758
Z004

LOCAL


NAME	MAIN OIL TANK & LOCAL		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 35	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28


DUPLEX OIL FILTER (NO.Z-n930)

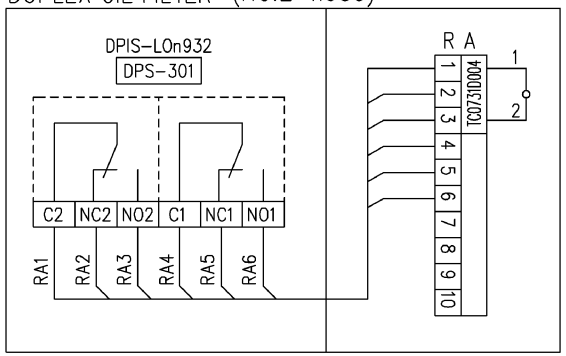


BLOW DOWN VALVE (NO.FV-GSn039)

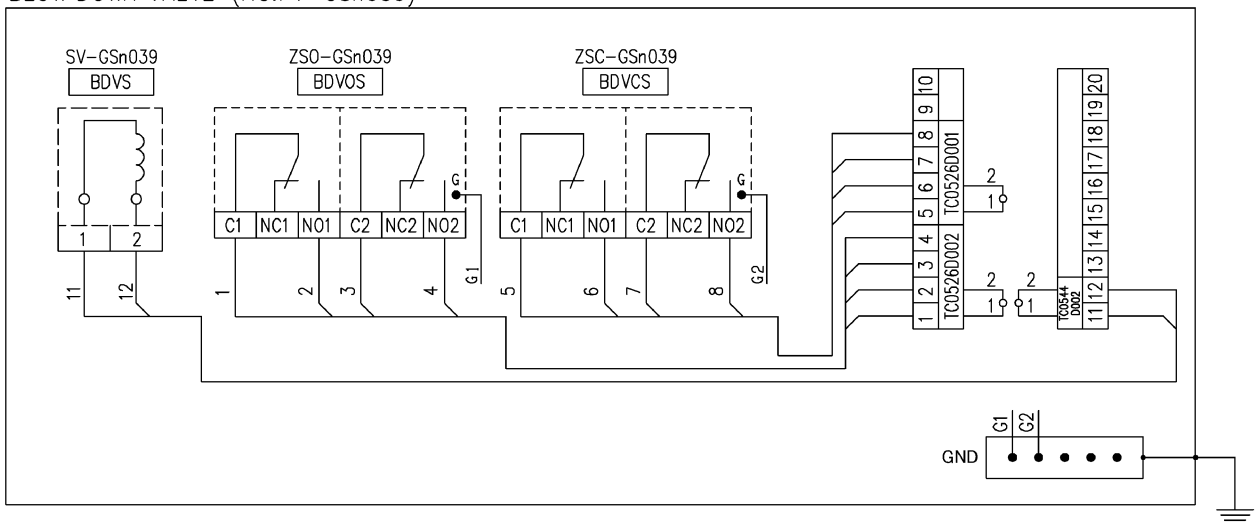

OIL CONDITIONER (NO.Z-n940)

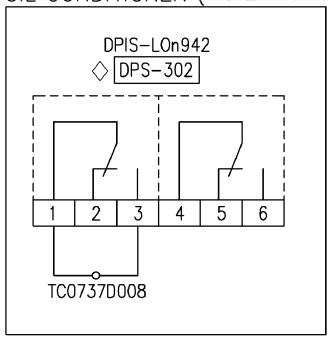

STEAM SEAL DIVERTING VALVE (NO.FV-GSn036)

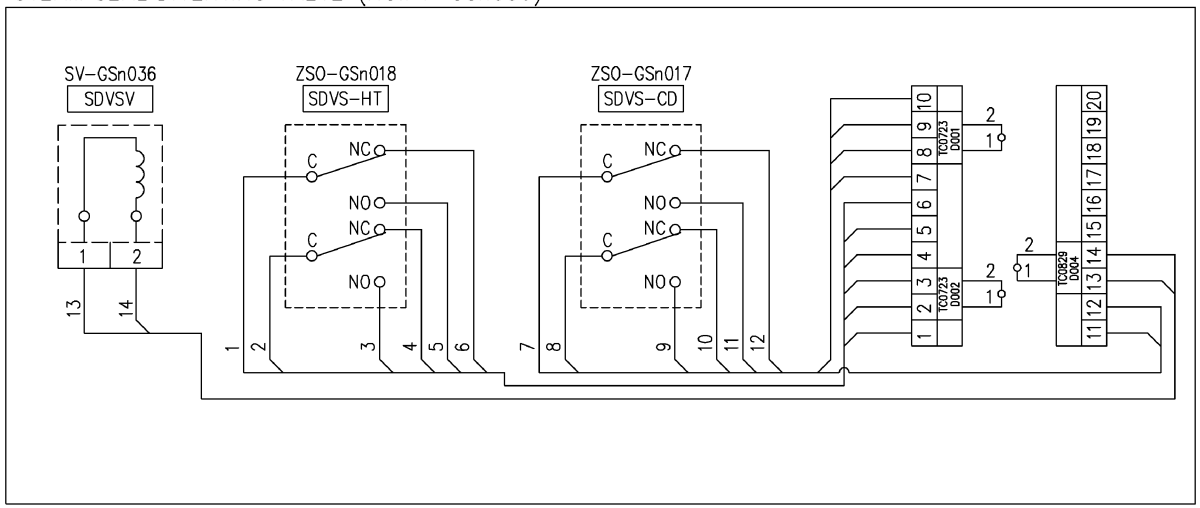


SYMBOL	CONTACT	OPEN	CLOSE
BDVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
BDVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
		HEATER	CONDENSER
SDVS-HT	C-NC, C-NC		X
	C-NO, C-NO	X	
SDVS-CD	C-NC, C-NC	X	
	C-NO, C-NO		X


NAME	LOCAL (LUBE OIL DEVICE & CONTROL VALVE)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 36	REV.

DWG. No. 310SD14-370


STEAM SEAL FEED VALVE (NO.PV-GSn031)

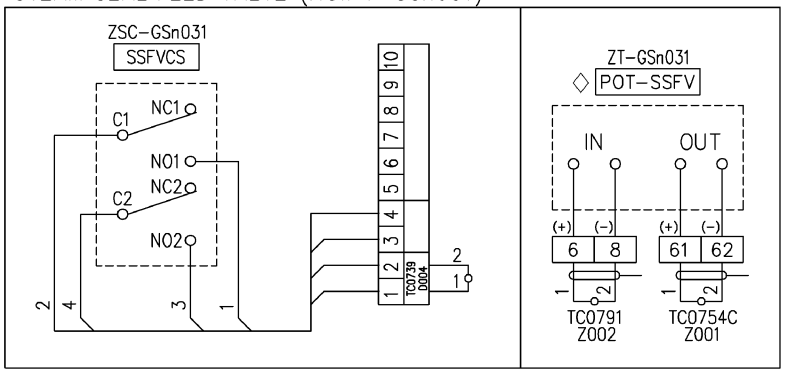


VENTILATOR VALVE (NO.FV-CRn902)

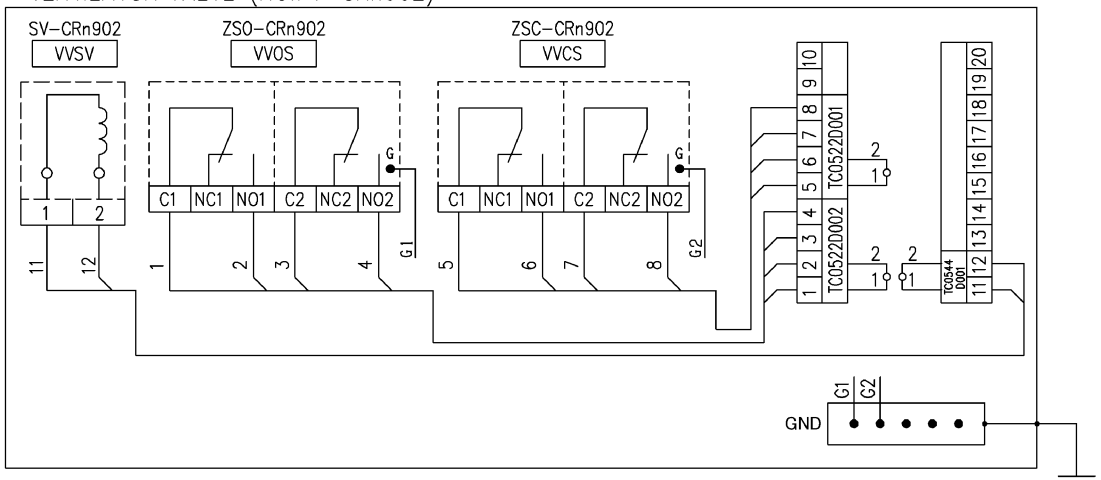


STEAM SEAL FEED VALVE BYPASS VALVE (NO.V-GSn032)

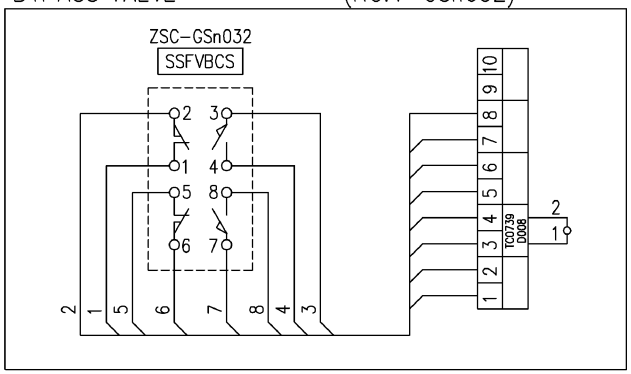

LP EXHAUST HOOD WATER SPRAY CONTROL VALVE (NO.FV-CDn904)

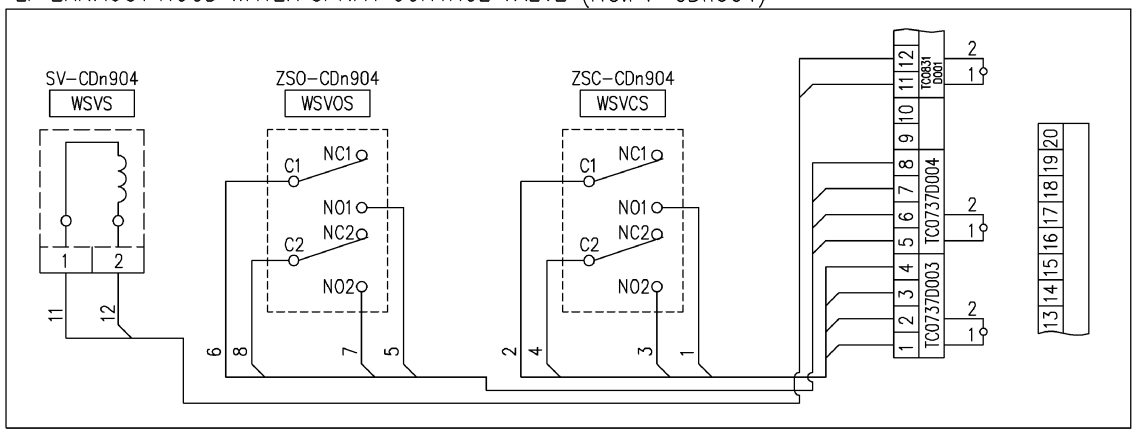

STEAM PACKING UNLOADING VALVE (NO.PV-GSn034

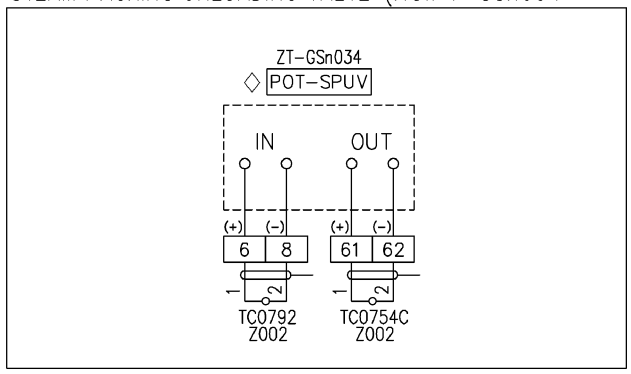


SYMBOL	CONTACT	OPEN	CLOSE
SSFVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
WSVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
WSVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
SSFVBCS	1-2, 5-6		
	3-4, 7-8		X
VVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
VVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X


NAME	LOCAL (CONTROL VALVE)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 37	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28


NO.2 EXTRACTION STEAM NON RETURN VALVE (NO.XV-TSn700)

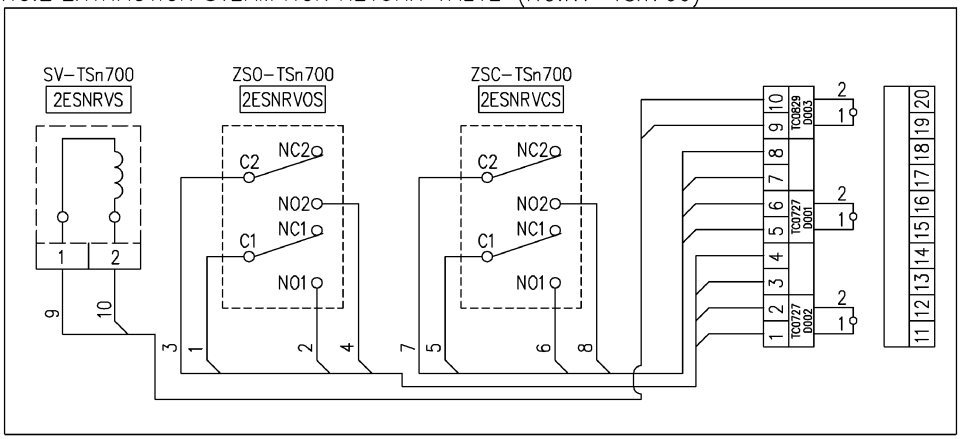


NO.3 EXTRACTION STEAM PRIMARY NON RETURN VALVE (NO.XV-TSn710)

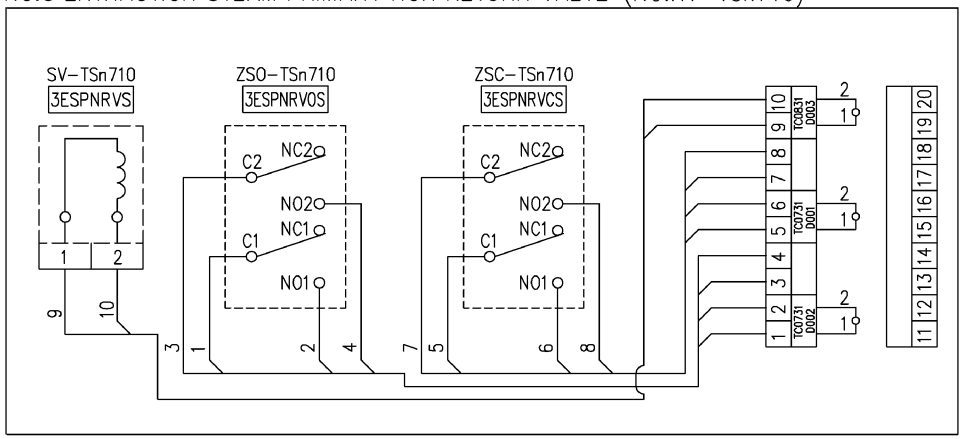

NO.3 EXTRACTION STEAM SECONDARY NON RETURN VALVE (NO.XV-TSn740)

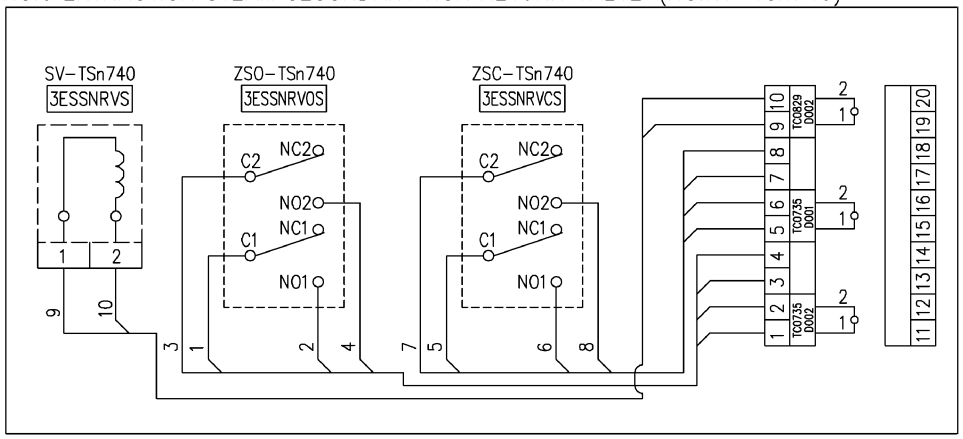

NO.4 EXTRACTION STEAM NON RETURN VALVE (NO.XV-TSn720)

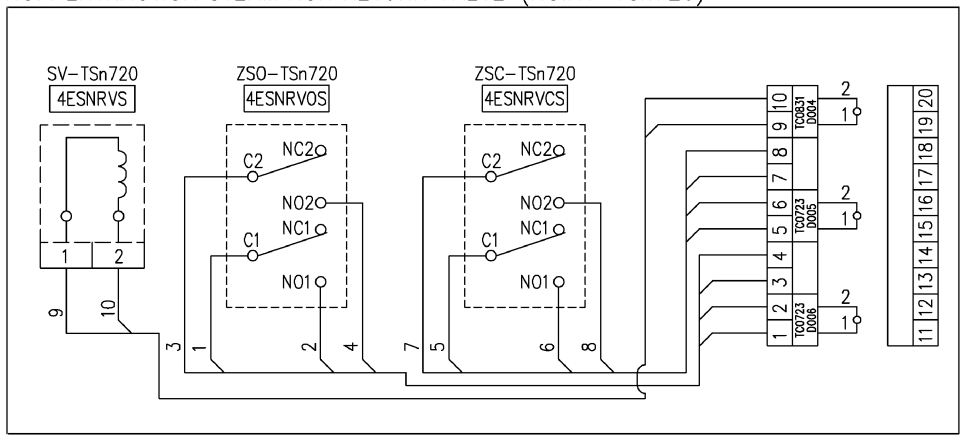


SYMBOL	CONTACT	OPEN	CLOSE
2ESNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
2ESNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
3ESSNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
3ESSNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X

SYMBOL	CONTACT	OPEN	CLOSE
3ESPNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
3ESPNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
4ESNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
4ESNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X


NAME	LOCAL(NON RETURN VALVE)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 38	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28

NO.5 EXTRACTION STEAM NON RETURN VALVE (NO.XV-TSn730)

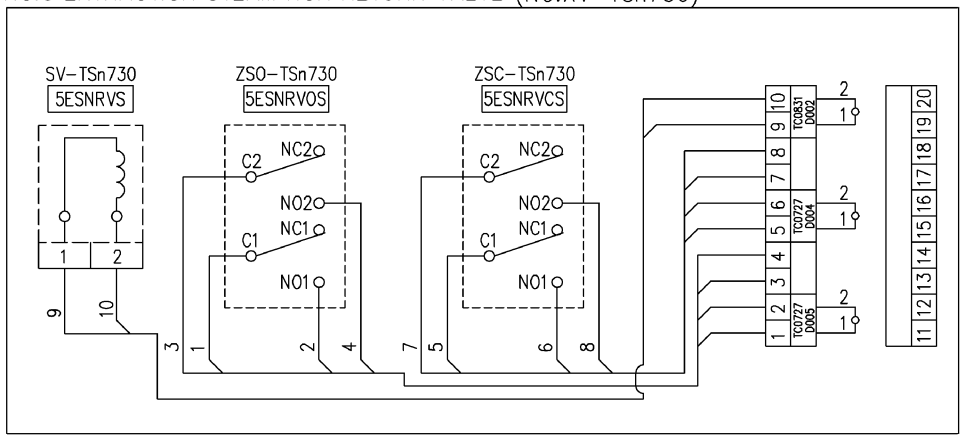

COLD REHEAT NON RETURN VALVE (NO.XV-CRn901)

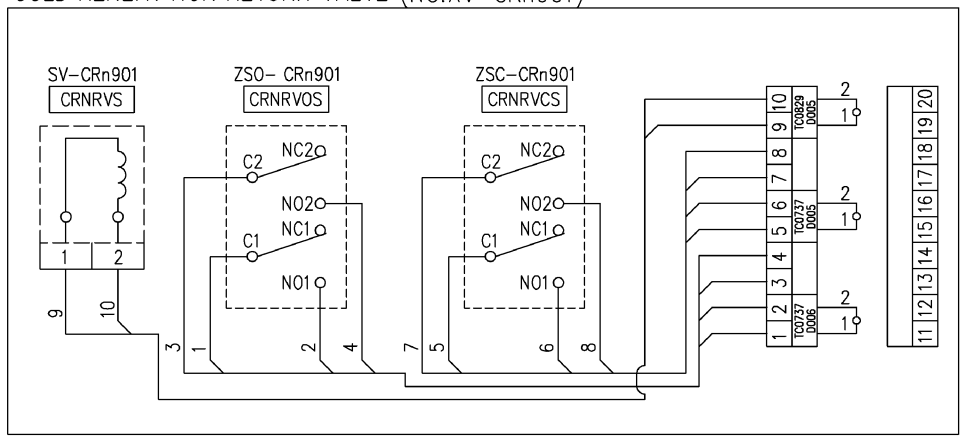


SYMBOL	CONTACT	OPEN	CLOSE
5ESNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
5ESNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X
CRNRVOS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2	X	
CRNRVCS	C1-NC1, C2-NC2		
	C1-NO1, C2-NO2		X


NAME	LOCAL (NON RETURN VALVE)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 39	REV.

DWG. No. 310SD14-370


LOCAL RACK No. R-n901 (FHI Supply)




LOCAL RACK No. R-n902 (MHPS Supply)

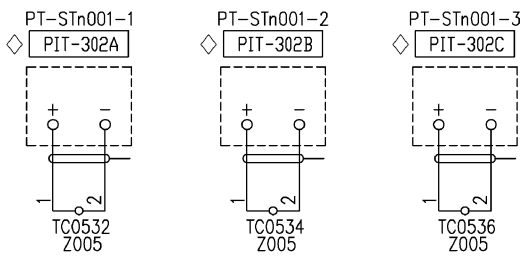


LOCAL RACK No. R-n904 (MHPS Supply)

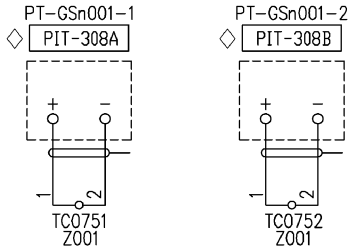


LOCAL RACK No. R-n906 (MHPS Supply)

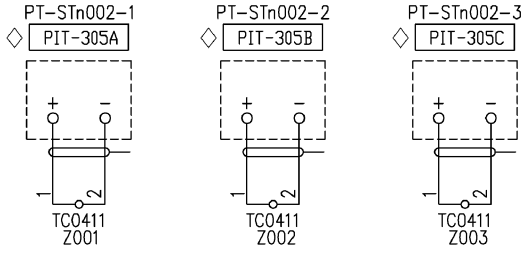


LOCAL RACK
No. R-n910 (FHI Supply)

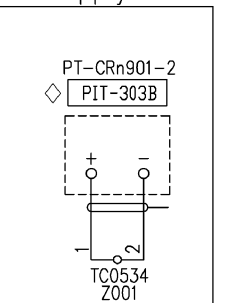

LOCAL RACK
No. R-n911 (FHI Supply)

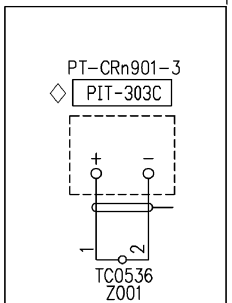


LOCAL RACK
No. R-n903 (FHI Supply)

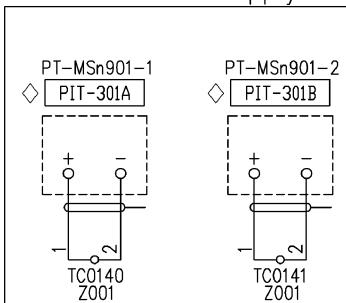

NAME	LOCAL (LOCAL RACK)		
MITSUBISHI HITACHI POWER SYSTEMS, LTD.	DWG.No. 310SD14-370	SH. 40	REV.

DWG. No. 310SD14-370

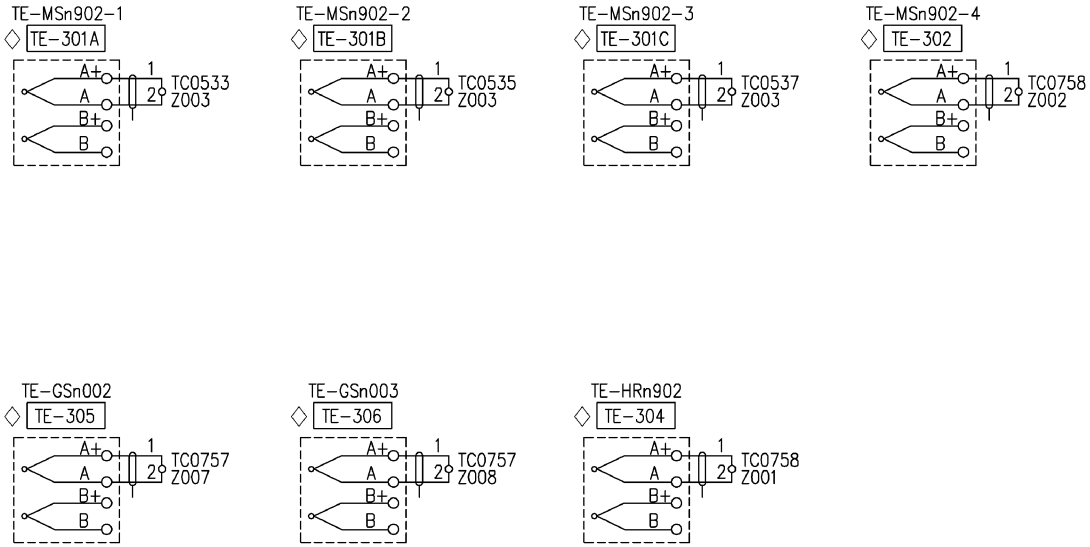


NAME	LOCAL			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.		DWG.No. 310SD14-370	SH. 41	REV.

DWG. No. SD14-370 R4// REGD. 2014-09-29
CHKD. J. NAGANUMA/ APPD. T. MUROHOSHI// RE-REGD. 2016-04-28


LOCAL RACK No. R-n907

PRA-BOX FOR TURBINE SPEED SENSOR

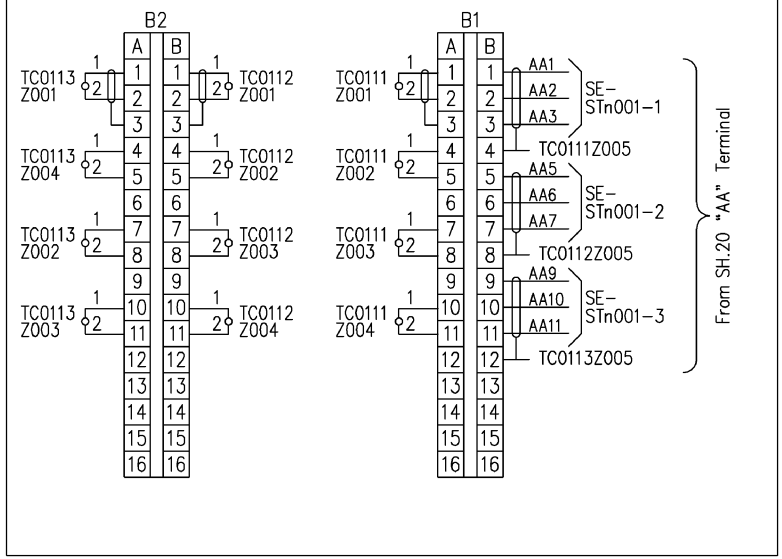

LOCAL LACK No. R-n908

PRA-BOX FOR TURBINE SPEED SENSOR

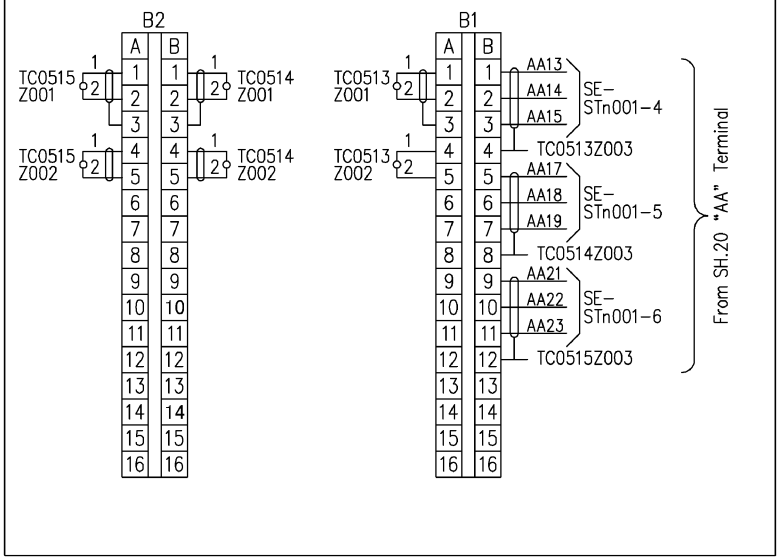

NAME	PRA-BOX			
MITSUBISHI HITACHI POWER SYSTEMS, LTD.		DWG.No. 310SD14-370	SH. 42	REV.