




Exact two-reservoir response

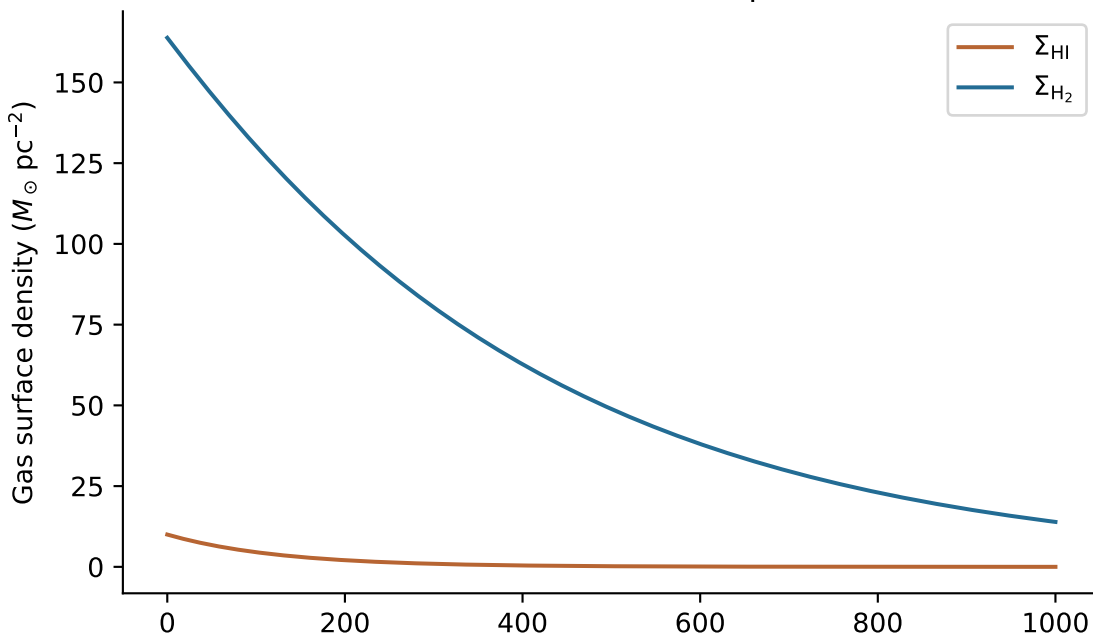

A short local response

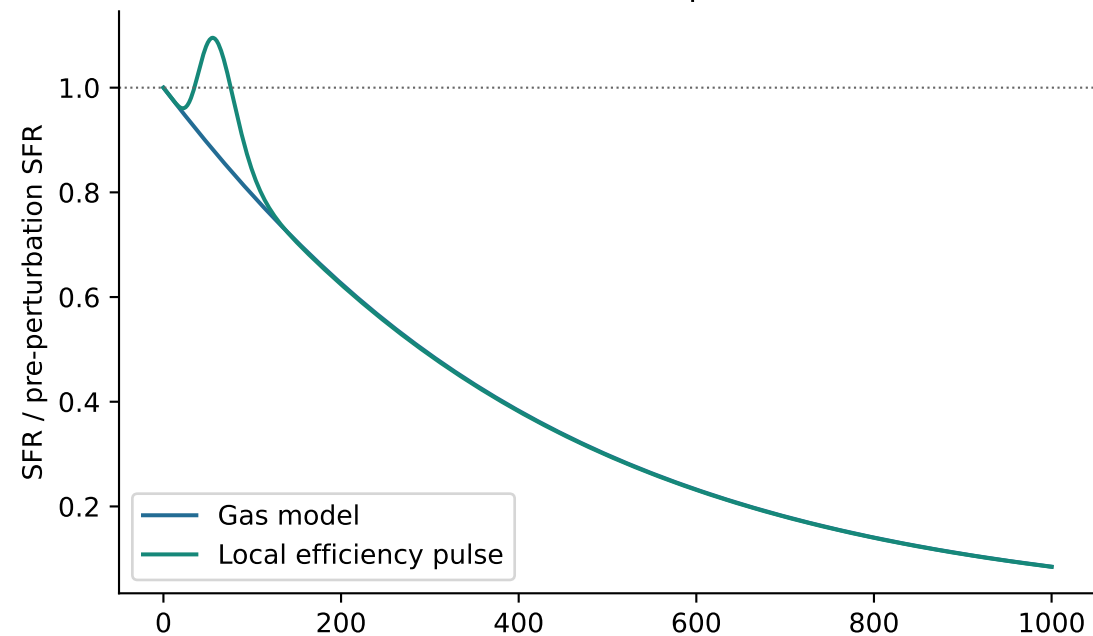

Negative = instantaneously rising SFR

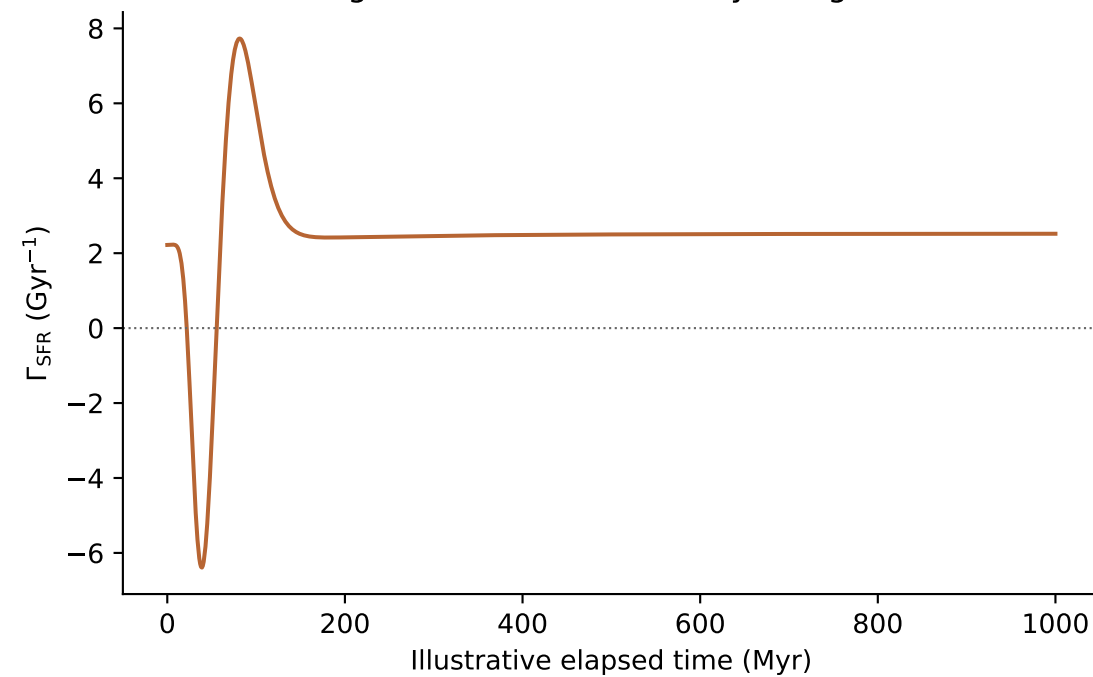

Negative = above initial SFR

