


H I-only removal; depletion time 2 Gyr



Sensitivity; gas columns held fixed

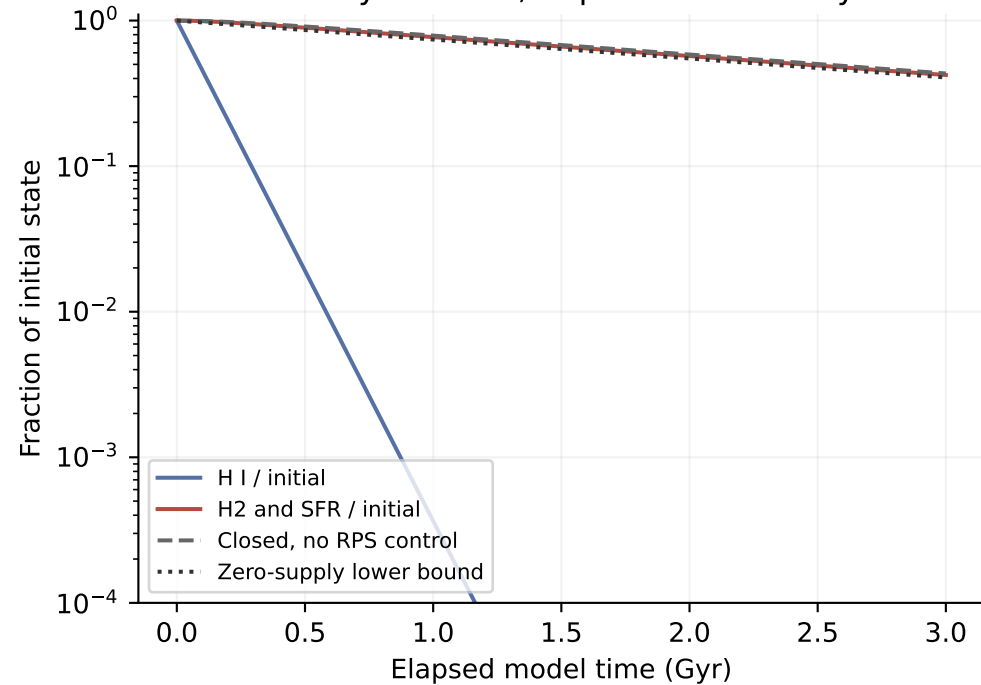