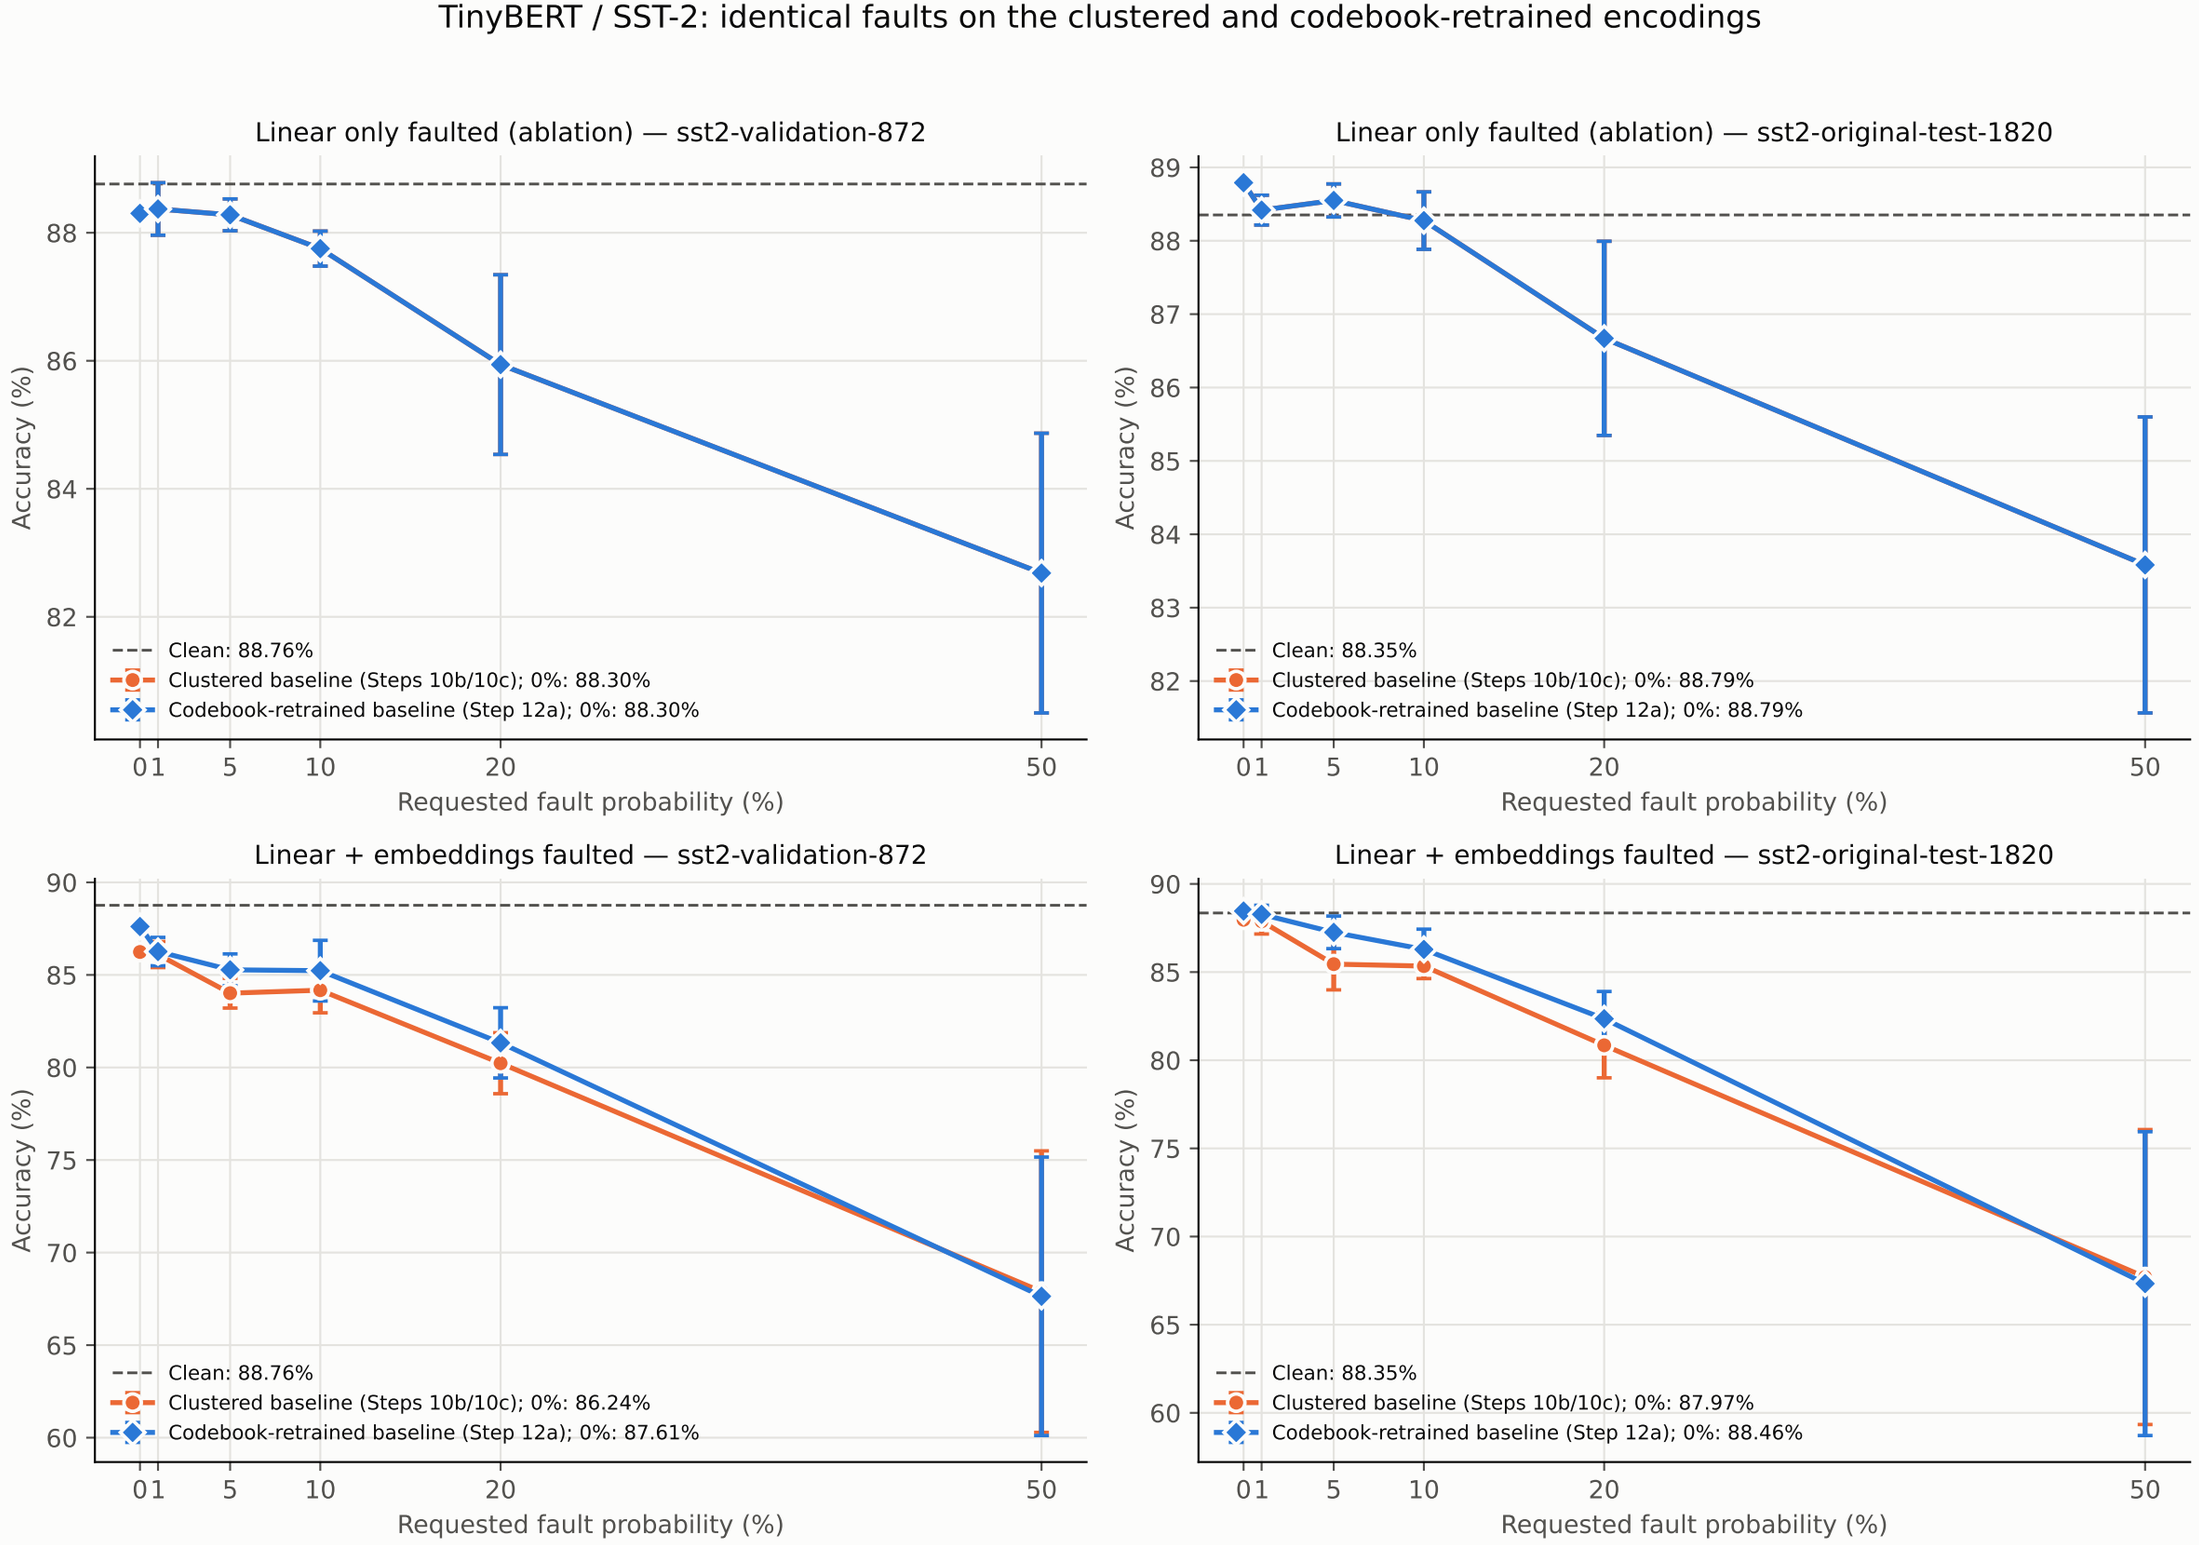
TinyBERT / SST-2: identical faults on the clustered and codebook-retrained encodings
Linear only faulted (ablation) — sst2-validation-872
Linear only faulted (ablation) — sst2-original-test-1820
Linear + embeddings faulted — sst2-validation-872
Linear + embeddings faulted — sst2-original-test-1820
Accuracy (%)
Requested fault probability (%)
Clean: 88.76%
Clean: 88.35%
Clustered baseline (Steps 10b/10c); 0%: 88.30%
Clustered baseline (Steps 10b/10c); 0%: 88.79%
Clustered baseline (Steps 10b/10c); 0%: 86.24%
Clustered baseline (Steps 10b/10c); 0%: 87.97%
Codebook-retrained baseline (Step 12a); 0%: 88.30%
Codebook-retrained baseline (Step 12a); 0%: 88.79%
Codebook-retrained baseline (Step 12a); 0%: 87.61%
Codebook-retrained baseline (Step 12a); 0%: 88.46%
Mean ± 1 sample SD across 5 static patterns per nonzero rate; identical cells faulted in both encodings. Test sets reported separately. No LoRA.