DRAWING No
WO.912551/D01/022

LEGEND

- FIREWATER SUPPLY
- INSTRUMENTATION TRIM
- PNEUMATIC LINES
- ELECTRIC CABLE

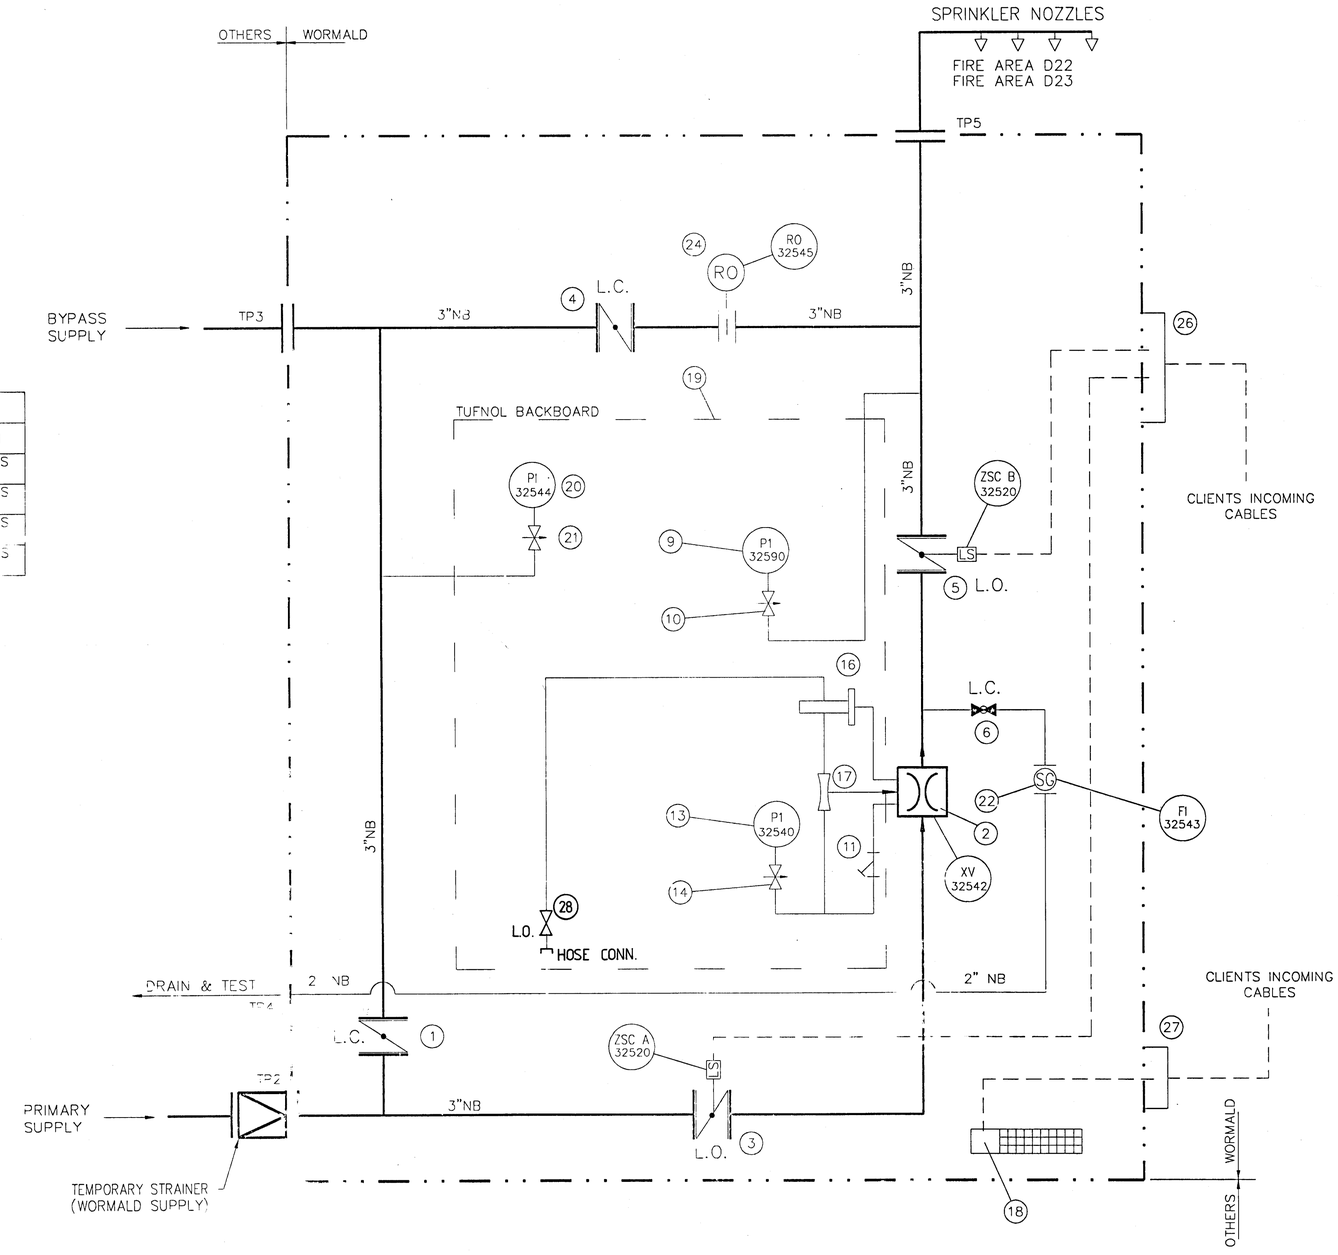

ITEM No.	SIZE	DESCRIPTION	SET POINT
1	3"	ALTERNATIVE BYPASS ISOLATION VALVE	
2	3"	SURGE CONTROL DELUGE VALVE	
3	3"	DELUGE SYSTEM ISOLATION VALVE C\W LIMIT SWITCH	
4	3"	BYPASS ISOLATION VALVE	
5	3"	DELUGE SYSTEM ISOLATION VALVE C\W LIMIT SWITCH	
6	2"	DRAIN AND TEST VALVE	
7	—	NOT USED	
8	—	NOT USED	
9	4"DIA	WATER SYSTEM PRESSURE INDICATOR	
10	1/2"	WATER SYSTEM PRESSURE INDICATOR BLOCK / BLEED VALVE	
11	1/2"	PILOT LINE SEAWATER STRAINER	
12	—	NOT USED	
13	4"DIA	WATER SUPPLY PRESSURE INDICATOR	
14	1/2"	WATER SUPPLY PRESSURE INDICATOR BLOCK / BLEED VALVE	
15	—	NOT USED	
16	1/2"	PILOT VALVE	
17	1/2"	RESTRICTOR/VENTURI	
18	—	ENCLOSURE CONVECTION HEATER	
19	—	INSTRUMENT BACKBOARD	
20	4"DIA	BYPASS PRESSURE INDICATOR	
21	1/2"	BYPASS PRESSURE INDICATOR BLOCK / BLEED VALVE	
22	2"	SIGHT GLASS (DRAIN & TEST)	
23	—	NOT USED	
24	HOLD	BYPASS RESTRICTED ORIFICE (D22 & D23)	
25	—	NOT USED	
26	—	I.S. JUNCTION BOX EEx'e' 24VDC	
27	—	HEATER JUNCTION BOX 254VAC	
28	1/2"	COMMISSIONING VALVE C/W HOSE CONNECTION	

INTERFACE & CONNECTION TAB

REF	SIZE	DESCRIPTION	SPECIFICATION
TP2	3"	FIREWATER INLET	ANSI B16.5 CLASS 150lb FLANGE
TP3	3"	BYPASS INLET	ANSI B16.5 CLASS 150lb FLANGE
TP4	2"	DRAIN / TEST OUTLET	ANSI B16.5 CLASS 150lb FLANGE
TP5	3"	FIREWATER OUTLET (D22,D23)	ANSI B16.5 150lb

AMERADA HESS LIMITED
Scott Field Development

RETURN CODE 8

THIS DOCUMENT HAS BEEN ACCEPTED BY COMPANY AS "AS SUPPLIED" WITHOUT ENGINEERING REVIEW

AS SUPPLIED

Seller shall complete both Sections A & B, sign & date

A All Company comments on previous submission have been fully incorporated
☑ Yes ☐ No ☐ Not Applicable

B There are no design changes, other than incorporation of Company comments, from previous submission
☑ Yes ☐ No

Seller's Verifying Statement:
This document accurately represents the "As Supplied" condition of the Work

Sellers Authorised Signature: Date: 7/5/92

ISSUE	DATE	BY	CHKD	APPD	REVISION
05	DEC 91	G.B.	SP		COMMISSIONING VALVE ADDED
04	JUL 91	G.B.	SP		AS SUPPLIED
03	MAY 91	W.G.	SP		CLIENTS COMMENTS INCORPORATED
					RE-ISSUED FOR APPROVAL
02	MAR 91	GR	SP		CLIENTS COMMENTS INCORPORATED
					RE-ISSUED FOR APPROVAL
01	JAN 91	PRB	SP		ISSUED FOR APPROVAL

REVISIONS

NOTES

1) THIS DRAWING IS TO BE READ IN CONJUNCTION WITH –
GENERAL ARRANGEMENT – WO.912551/C03/022
FABRICATION DETAIL – WO921551/C04/022
ELECTRICAL TERMINATION DETAIL – WO012551/F04/010

2) PROJECT PIPING SPECIFICATION – SCOTT FW 0000 PI SP 0001

COMPANY RETURN CODES
- ☐ 1. Accepted "As Supplied"
- ☐ 2. Accepted - No Comments
- ☐ 3. Qualified Acceptance – Minor Comments. Revise & Resubmit as "As Supplied" Work May Proceed
- ☐ 4. Qualified Acceptance – Minor Comments. Revise & Resubmit To Obtain Code 2 Work May Proceed
- ☐ 5. Qualified Acceptance – Major Comments. Revise & Resubmit To Obtain Code 2 Work May Proceed
- ☐ 6. Rejected – Revise & Resubmit Immediately Work May Not Proceed In The Affected Areas
- ☐ 7. Review Not Required

Company's Signature:..... Date:.....

AMERADA HESS LIMITED
SCOTT FIELD DEVELOPMENT

Package Desc	DELUGE & SPRINKLER CONTROL SKIDS		
Equip Nos	LS-3203		
SDRS Codes	D01		
Module	D11	Sheet 1 of 1	
Purchase Order No	Document No		Rev
PO 160	D	0 0 2 2 0 5	

N.T.S.

ORIGINAL SCALE:

WORMALD
ENGINEERING & CONTRACTING DIVISION

PROJECT SCOTT FIELD DEVELOPMENT

W.E. JOB N° WO912551 | ITEM N° | CLIENT AMERADA HESS LIMITED

DRAWN BY P.BUCKLEY | DATE JAN 91

CLIENTS ORDER N° T000 LC RM 0003 PO 160

TITLE
PIPING AND INSTRUMENT DIAGRAM FOR 3" SPRINKLER VALVE SKID EQUIPMENT No LS-3203

DRAWING NUMBER WO.912551/D01/022

ISSUE 01 02 03 04 05

CAD DRG REF D01-022

THIS DRAWING IS CONFIDENTIAL & THE COPYRIGHT OF WORMALD. THE CONTENTS ARE NOT TO BE USED OR COPIED FOR ANY PURPOSE WHATSOEVER WITHOUT OUR PRIOR WRITTEN CONSENT