


Awaiting TA Approval

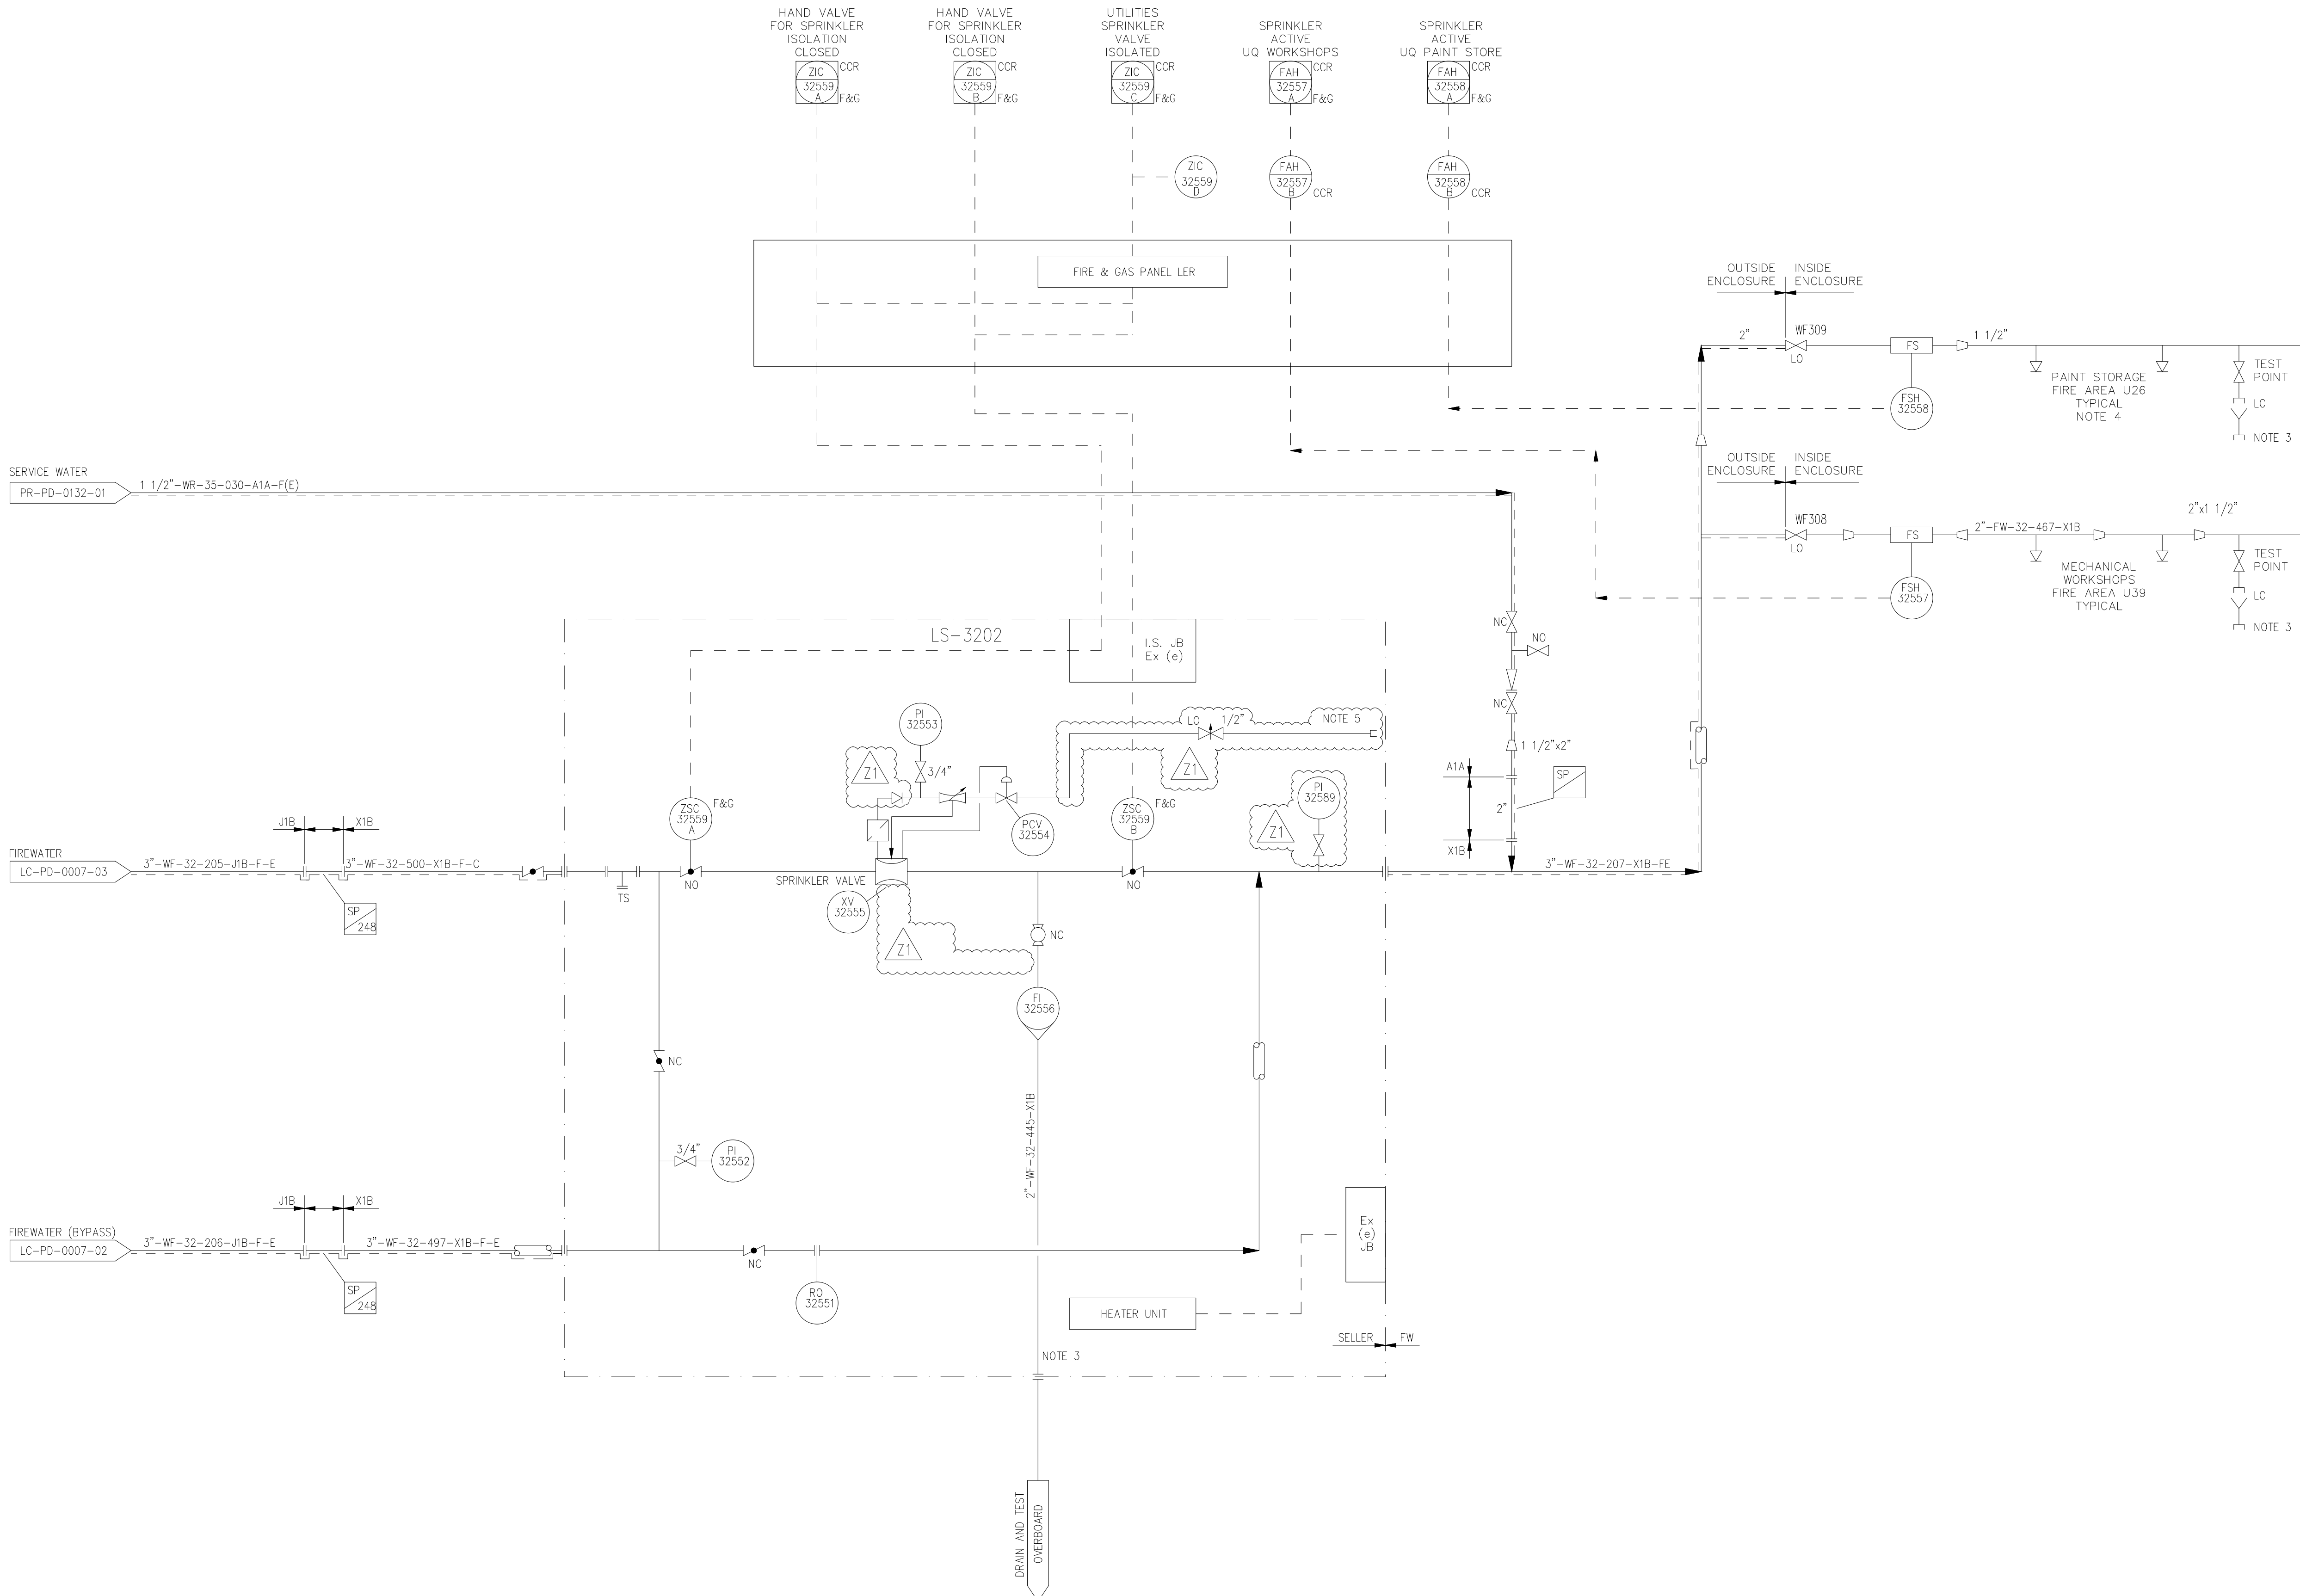

NOTES

1. SPRINKLER SKID TO BE PROVIDED WITH AN ENCLOSURE AND HEATER FOR WINTERISATION, THUS NO TRACE HEATING REQUIRED ON SKID.
2. DELETED.
3. TEST POINT FOR INSPECTOR TO CONNECT SPOOL WITH CROPPED SPRINKLER HEAD AND PRESSURE GAUGE.
4. SEE FIRE PROTECTION LAYOUT FOR LINE SIZE DETAILS. THIS P&ID IS TYPICAL ONLY INSIDE ENCLOSURE.
5. COMMISSIONING LINE WITH HOSE CONNECTION. CONNECTION IS 1/2" OPEN ENDED BULKHEAD FITTING.

ONLY ACTIVATED TRACE
HEATING IS SHOWN ON P & ID,
ALL OTHER INSTALLED TRACE
HEATING IS NOT ACTIVATED
AND NOT SHOWN ON P & ID.

FOR ORIGINAL DESIGN
APPROVAL SIGNATURES SEE
ARCHIVED DRAWING AT REV 0

[illegible]