



DRYING AREA 118
LAUNDRY 119
LINEN STORE 120

HVAC PLANTROOM 113


ELECTRICAL
SWITCHROOM 116

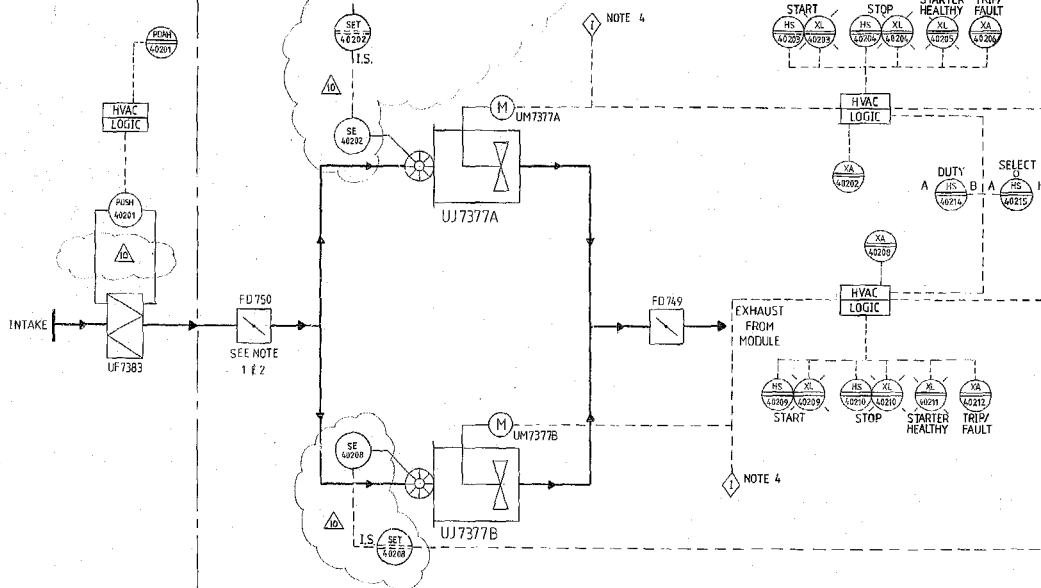

NOTE
1 TYPICAL FIREDAMPER CONTROL SCHEMATIC



- 2 ALL FIREDAMPERS TO BE PREFIXED UE 7371
- 3 SHORTENED FORM OF TAGGING ADOPTED TO IMPROVE READABILITY AND LIMIT CONGESTION IN ACCORDANCE TO AHL PROCEDURE 'E4-06 'ENGINEERING IDENTIFICATION SYSTEM', PAGE 29, SECTION 13-1
- 4 Δ INDICATES LOGIC INTERLOCK LOCATED IN ELECTRICAL SWITCHGEAR R116
- 5 FOR OVERRIDE SIGNAL ZONE CONTROL SEE DRG: SCOTT-SE-1100-JN-DG-0009-00
- 6 FOR EQUIPMENT TAG NUMBERS REFER TO HVAC DUCTING LAYOUT DIAGRAMS
- 7 FOR FIRE & GAS INTERLOCKS SEE F&G CAUSE & EFFECTS SCOTT-SE-1100-FG-CH-0001 TO 27.



DRAWING	REV	TITLE
SCOTT-SE-1100-FG-CH-0001 TO 27		FIRE & GAS CAUSE & EFFECTS DIAGS.
SCOTT-SE-1100-HV-SC-0002-00		HVAL DAMPER SCHEDULE
SCOTT-SE-1100-HV-DR-0003-00		HVAC DUCTING LAYOUTS
SCOTT-SE-1100-JN-DG-0021-SERIES		HVAC INST E&I BLOCK DIAGRAMS
SCOTT-SE-1100-JN-CH-0001-00 TO 0010-00		HVAC INST E&I CAUSE AND EFFECT DIAGRAMS
SCOTT-SE-1100-HV-DR-0001 TO 0021		HVAC AIRFLOW DIAGRAMS
SCOTT-SE-1100-JN-SC-0001-00		HVAC INST E&I LEGEND & SYMBOLS

THIS DRAWING IS THE PROPERTY OF SLP ENGINEERING LTD AND MUST NOT BE COPIED, REPRODUCED, OR SHOWN TO A THIRD PARTY WITHOUT THE WRITTEN CONSENT OF SLP ENGINEERING LTD.

REV	REASON FOR ISSUE	DATE	DRN	CHK	LE	DRN/CHK	LE	TH	REV	SEPM	AHL	EM
10	NO CHANGE AS BUILT	5/1/93	AFL	10/1/93	1/1/93	1/1/93	1/1/93	1/1/93				
0	APPROVED FOR CONSTRUCTION	1/1/93	AFL	1/1/93	1/1/93	1/1/93	1/1/93	1/1/93				
CD	APPROVED FOR DESIGN	1/1/93	AFL	1/1/93	1/1/93	1/1/93	1/1/93	1/1/93				
C	RE-ISSUED FOR CLIENT REVIEW/COMMENT	20/6/91	RI	1/1/91	1/1/91	1/1/91	1/1/91	1/1/91				
B	ISSUED FOR CLIENT REVIEW/COMMENT	1/1/91	RI	1/1/91	1/1/91	1/1/91	1/1/91	1/1/91				
A	ISSUED FOR INTERNAL COMMENT/IDC	13/6/91	RI	1/1/91	1/1/91	1/1/91	1/1/91	1/1/91				

F/DAMPER	CZK	XYK	TSVK	HVK	FCVK	ZSLK
FD 749	40359	40359	40359	40359	40359	40359
FD 750	40360	40360	40360	40360	40360	40360

MTU No	AFD APPROVAL	REV	SEPM	AHL	EM	AFC APPROVAL

AMERADA HESS LIMITED
SCOTT FIELD DEVELOPMENT
SLP ENGINEERING LTD
1/1/93

TITLE HVAC/INSTRUMENTS E&I
DUCTING & INSTRUMENT DIAGRAM
LAUNDRY EXHAUST SYSTEM
NTS
SCOTT-SE-1110-JN-DG-0006-0010

009000-00-NC-0117