

LEGEND
FIREWATER SUPPLY LINE
INSTRUMENTATION TRIM
PNEUMATIC LINES
ELECTRIC CABLE


INTERFACE & CONNECTION TABLE			
REF	SIZE	DESCRIPTION	SPECIFICATION
TP2	10"	FIREWATER INLET	ANSI B16.5 CLASS 150lb FLANGE
TP3	10"	BYPASS INLET	ANSI B16.5 CLASS 150lb FLANGE
TP4	10"	FIREWATER OUTLET (P04)	ANSI B16.5 CLASS 150lb FLANGE
TP5	8"	FIREWATER OUTLET (P21)	ANSI B16.5 CLASS 150lb FLANGE
TP6	2"	DRAIN / TEST	ANSI B16.5 CLASS 150lb FLANGE
TP7	1"	INSTRUMENT AIR INLET	ANSI B16.5 CLASS 150lb FLANGE
TP8	1"	INSTRUMENT AIR OUTLET (P04)	ANSI B16.5 CLASS 150lb FLANGE
TP9	1"	INSTRUMENT AIR OUTLET (P21)	ANSI B16.5 CLASS 150lb FLANGE

AS SUPPLIED
Seller shall complete both Sections A & B, sign & date
A All Company comments on previous submission have been fully incorporated
☒ Yes ☐ No ☐ Not Applicable
B There are no design changes, other than incorporation of Company comments, from previous submission
☒ Yes ☐ No
Seller's Verifying Statement:
This document accurately represents the "As Supplied" condition of the Work
Sellers Authorized Signature: *[Signature]* Date: 5/5/92

AMERADA HESS LIMITED
Scott Field Development
RETURN CODE 8
THIS DOCUMENT HAS BEEN ACCEPTED BY COMPANY AS "AS SUPPLIED" WITHOUT ENGINEERING REVIEW

INSTRUMENT AIR SUPPLY
PRIMARY SUPPLY
TEMPORARY STRAINER (WORMALD SUPPLY)

ISSUE	DATE	BY	CHKD	APPD	REVISION
05	MAY 92	D.O.N	SP	SP	MADE AS SUPPLIED STATUS
04	AUG 91	W.G.	SP	SP	CLIENTS COMMENTS INCORPORATED
03	MAY 91	G.B.	SP	SP	RE-ISSUED FOR APPROVAL CLIENTS COMMENTS INCORPORATED
02	MAR 91	GR	SP	SP	RE-ISSUED FOR APPROVAL CLIENTS COMMENTS INCORPORATED
01	JAN 91	PRB	SP	SP	RE-ISSUED FOR APPROVAL ISSUED FOR APPROVAL

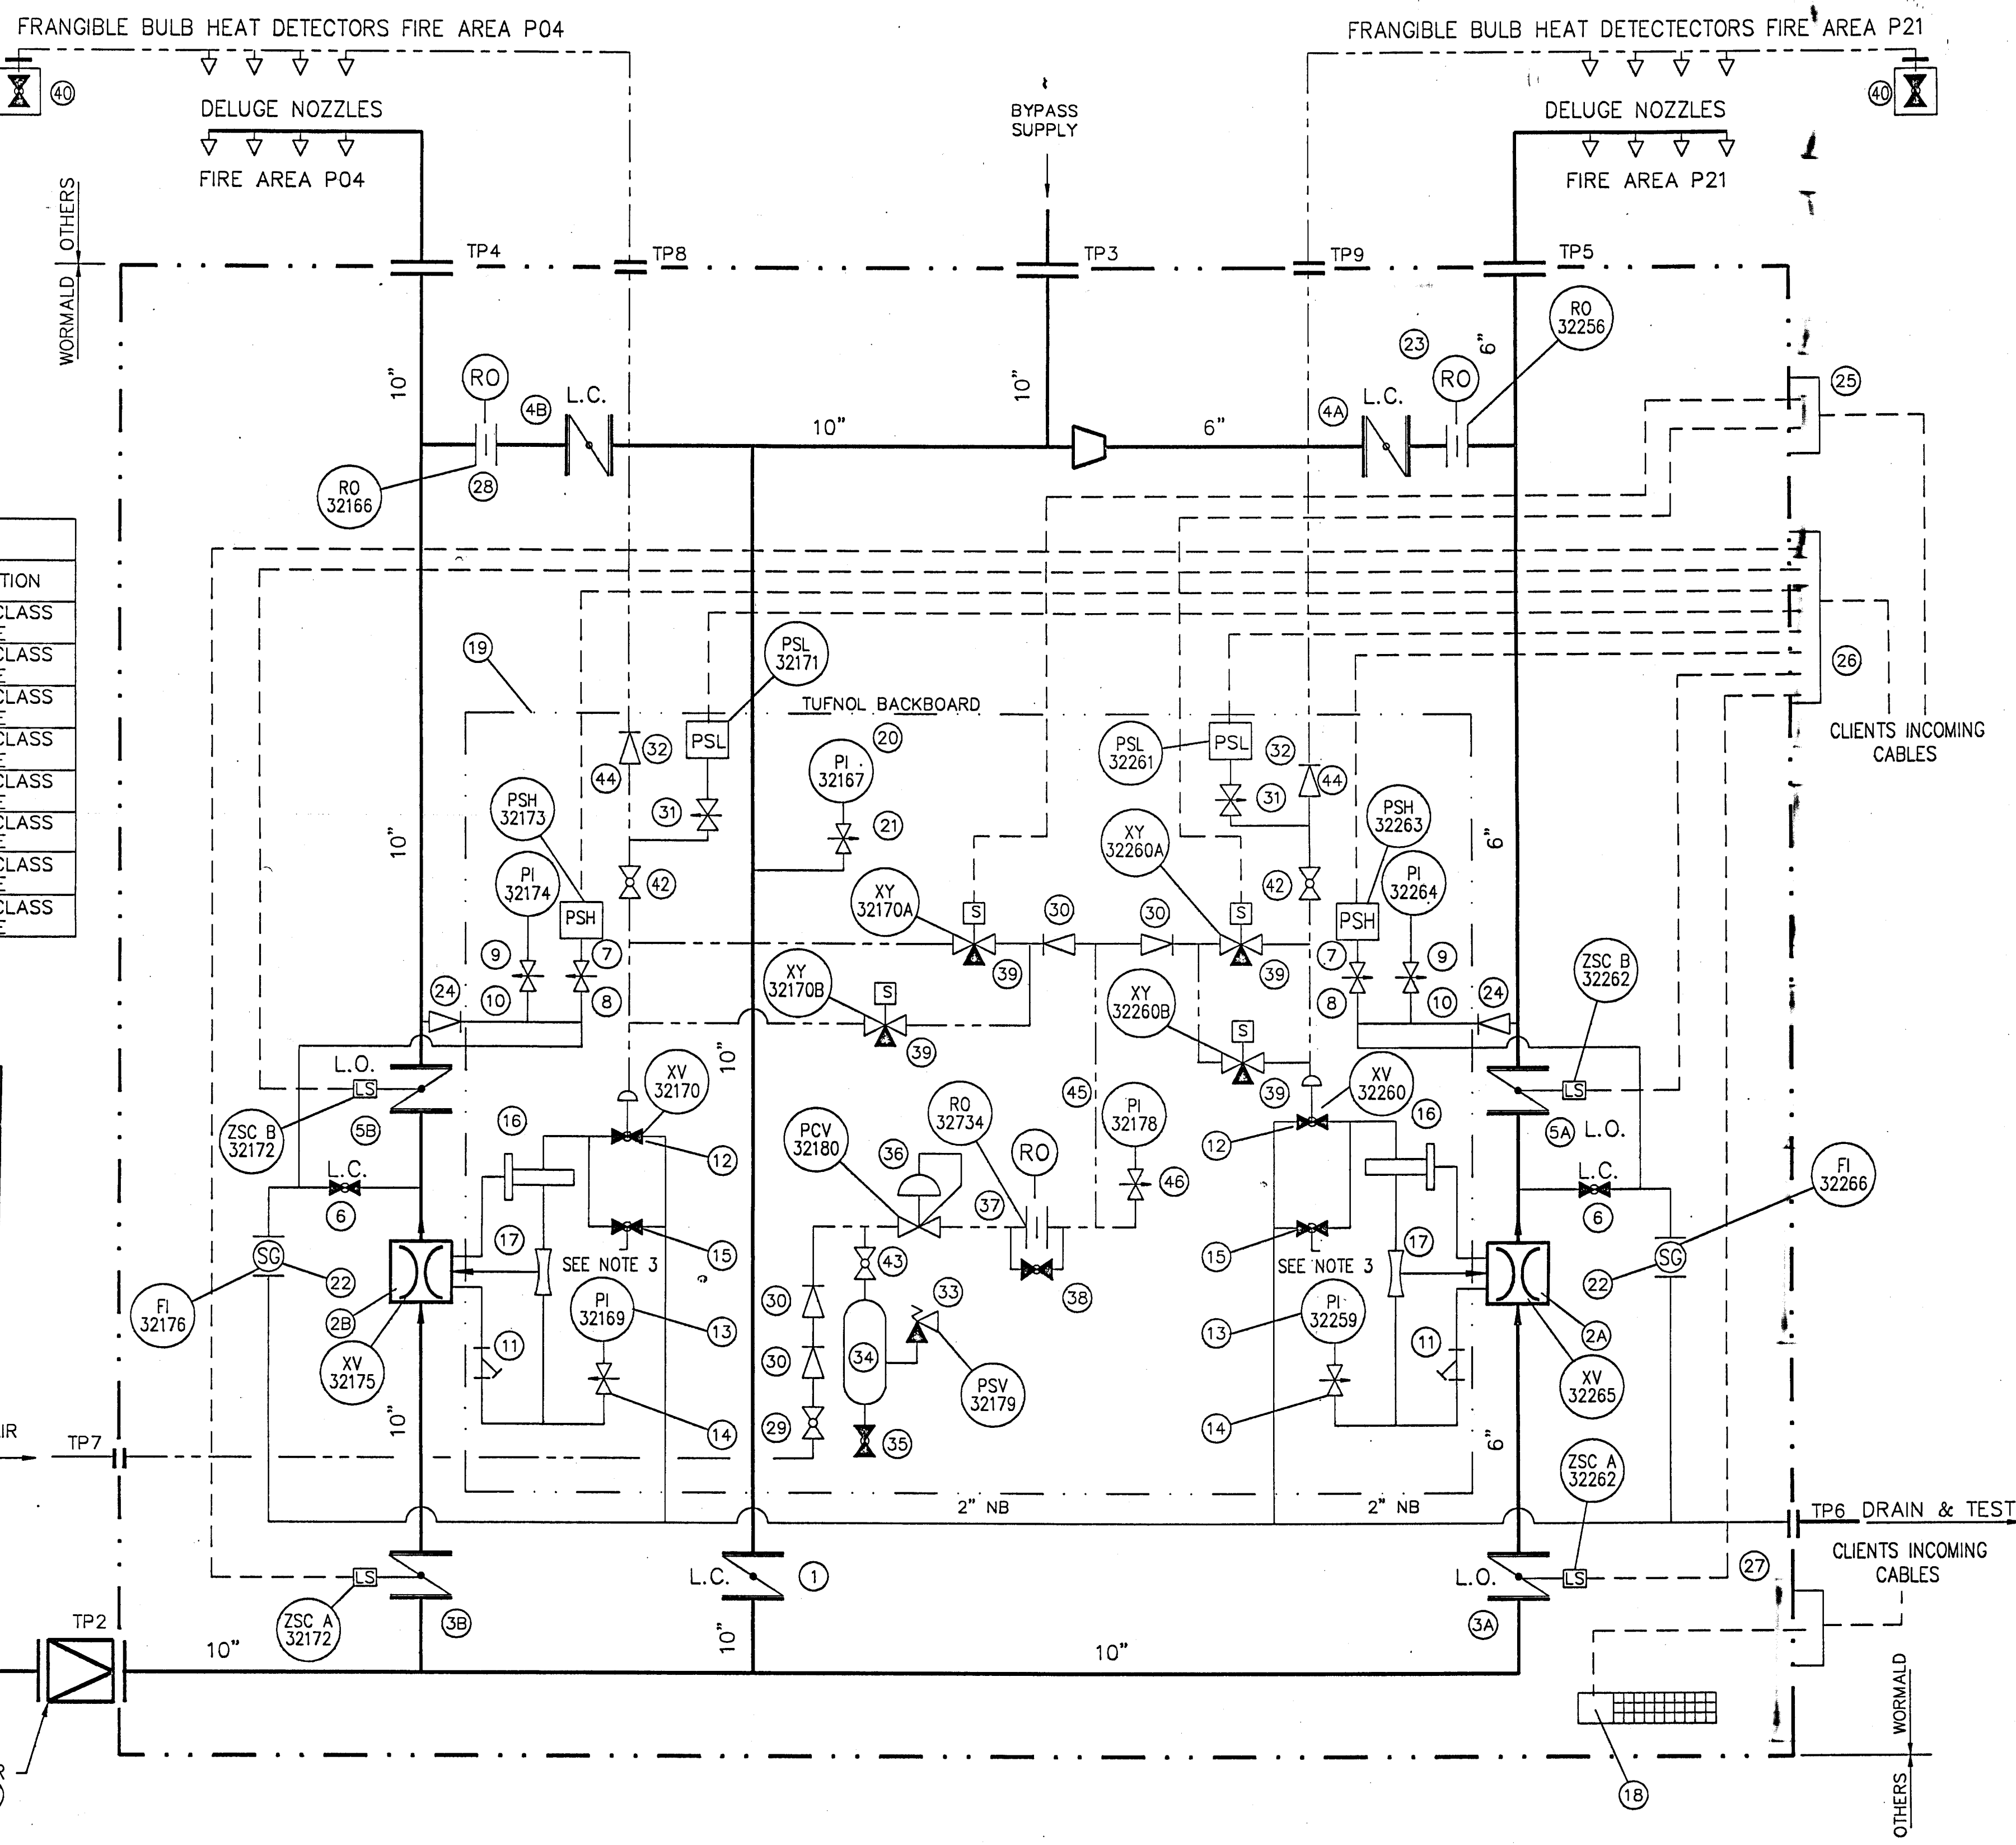

- NOTES
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH -
GENERAL ARRANGEMENT - WO.912551/C03/009
FABRICATION DETAIL - WO912551/C04/009
ELECTRICAL TERMINATION DETAIL - WO912551/F04/011
 - PROJECT PIPING SPECIFICATION - SCOTT FW 0000 PI SP 0001
 - LOCAL MANUAL RELEASE VALVE (ITEM 15) TO BE PANEL MOUNTED
BALL VALVE WITH HANDLE TO BE OPERATED FROM OUTSIDE SKID

COMPANY RETURN CODES		AMERADA HESS LIMITED	
<input type="checkbox"/> 1. Accepted "As Supplied"		SCOTT FIELD DEVELOPMENT	
<input type="checkbox"/> 2. Accepted - No Comments		DELUGE & SPRINKLER CONTROL SKIDS	
<input type="checkbox"/> 3. Qualified Acceptance - Minor Comments. Revises & Resubmit as "As Supplied" Work May Proceed		Equip Nos LD-3206A	
<input type="checkbox"/> 4. Qualified Acceptance - Minor Comments. Revises & Resubmit to Obtain Code 2 Work May Proceed		SDRS Codes D01	
<input type="checkbox"/> 5. Qualified Acceptance - Major Comments. Revises & Resubmit to Obtain Code 2 Work May Proceed		Module P12 Sheet 1 of 1	
<input type="checkbox"/> 6. Rejected - Revises & Resubmit immediately Work May Not Proceed in the Affected Areas		Purchase Order No Document No Rev	
<input type="checkbox"/> 7. Review Not Required		PO 160 D 010109 015	
Company's Signature: _____ Date: _____			

WORMALD ENGINEERING & CONTRACTING DIVISION			
PROJECT SCOTT FIELD DEVELOPMENT			
W.E. JOB N° WO912551		ITEM N°	
CLIENT AMERADA HESS LIMITED			
DRAWN BY P.BUCKLEY		DATE JAN 91	
CLIENTS ORDER N° T000 LC RM 0003 PO 160		DRAWING NUMBER WO.912551/D01/009	
TITLE PIPING AND INSTRUMENT DIAGRAM FOR 6" & 10" DELUGE VALVE SKID EQUIPMENT No LD-3206A		ISSUE 01 02 03 04 05	
CAD DRG REF D01-009			