The best detection setting depends on review capacity

Validation: 2021 to 2023 | 14 declared settings | four synthetic mechanisms | 36 unmodified months

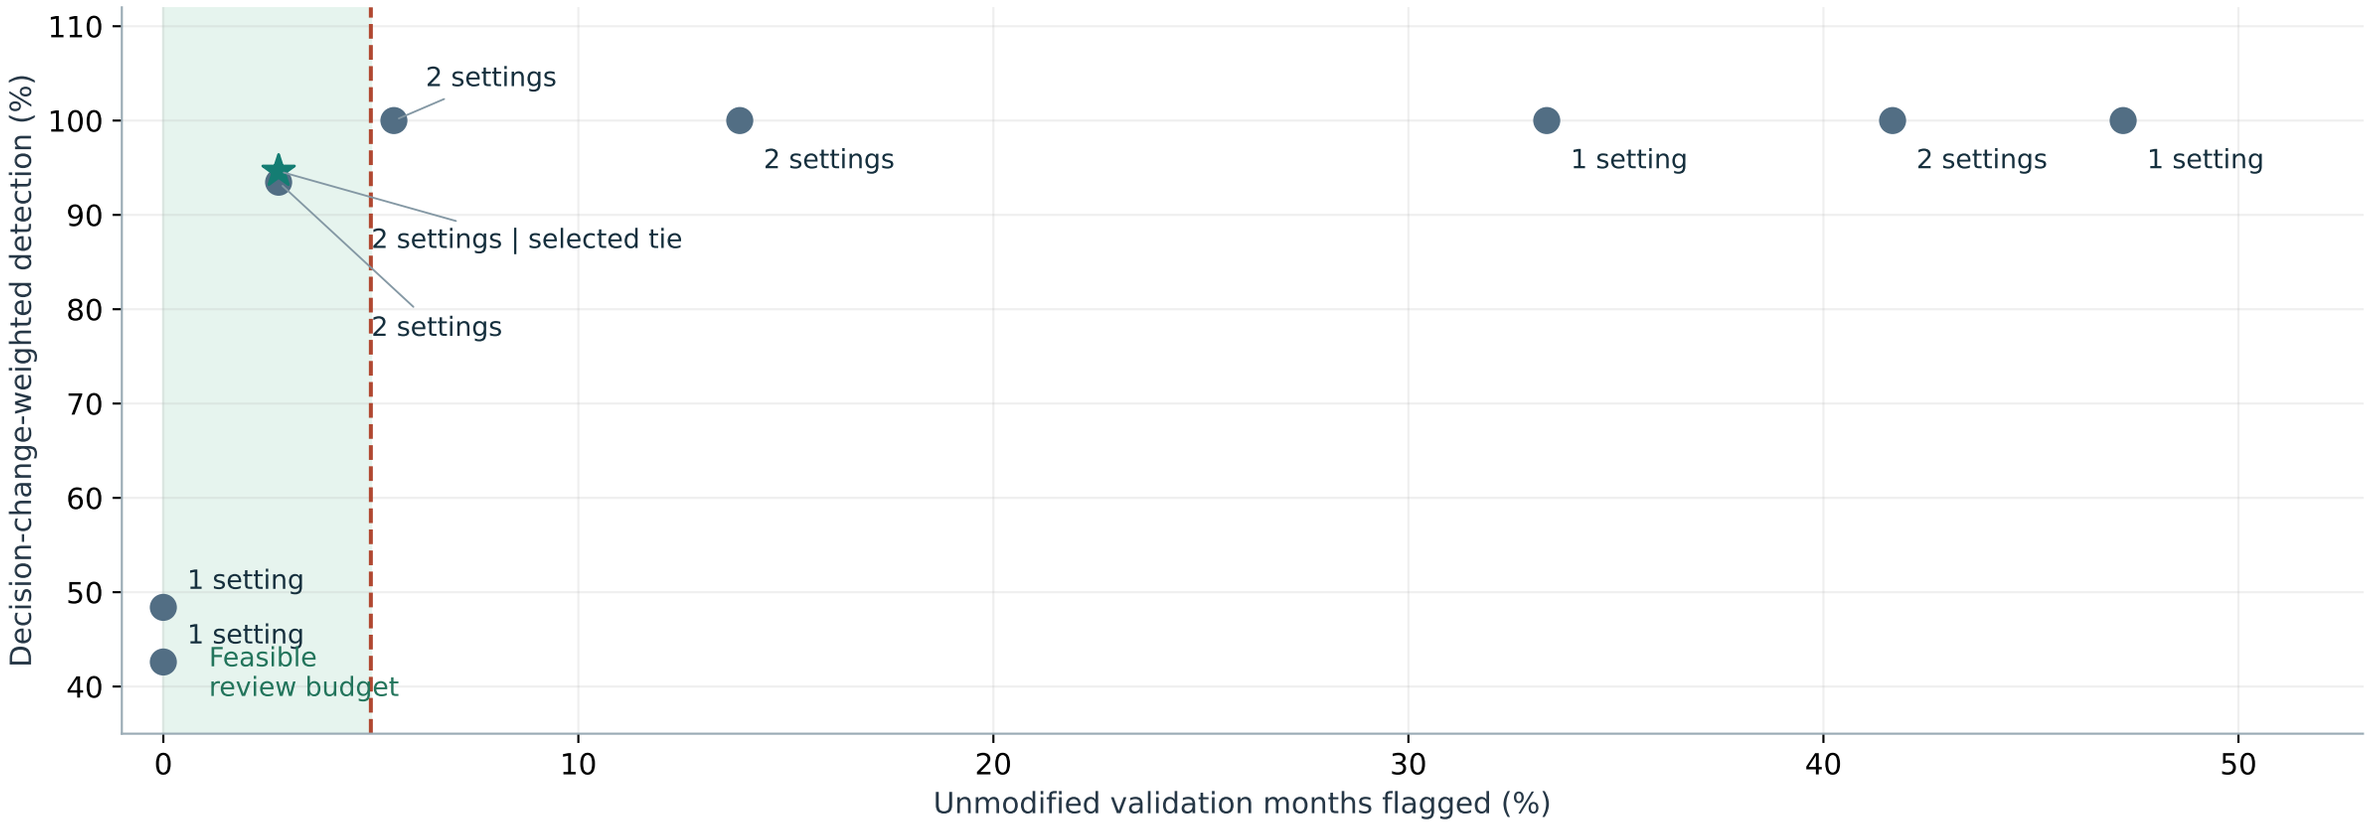

SYNTHETIC FAULTS ON MEASURED PUBLIC HISTORY

Coincident settings are grouped with counts. Selected: 6-month window, z > 8, relative deviation > 0.10; all trials retained.