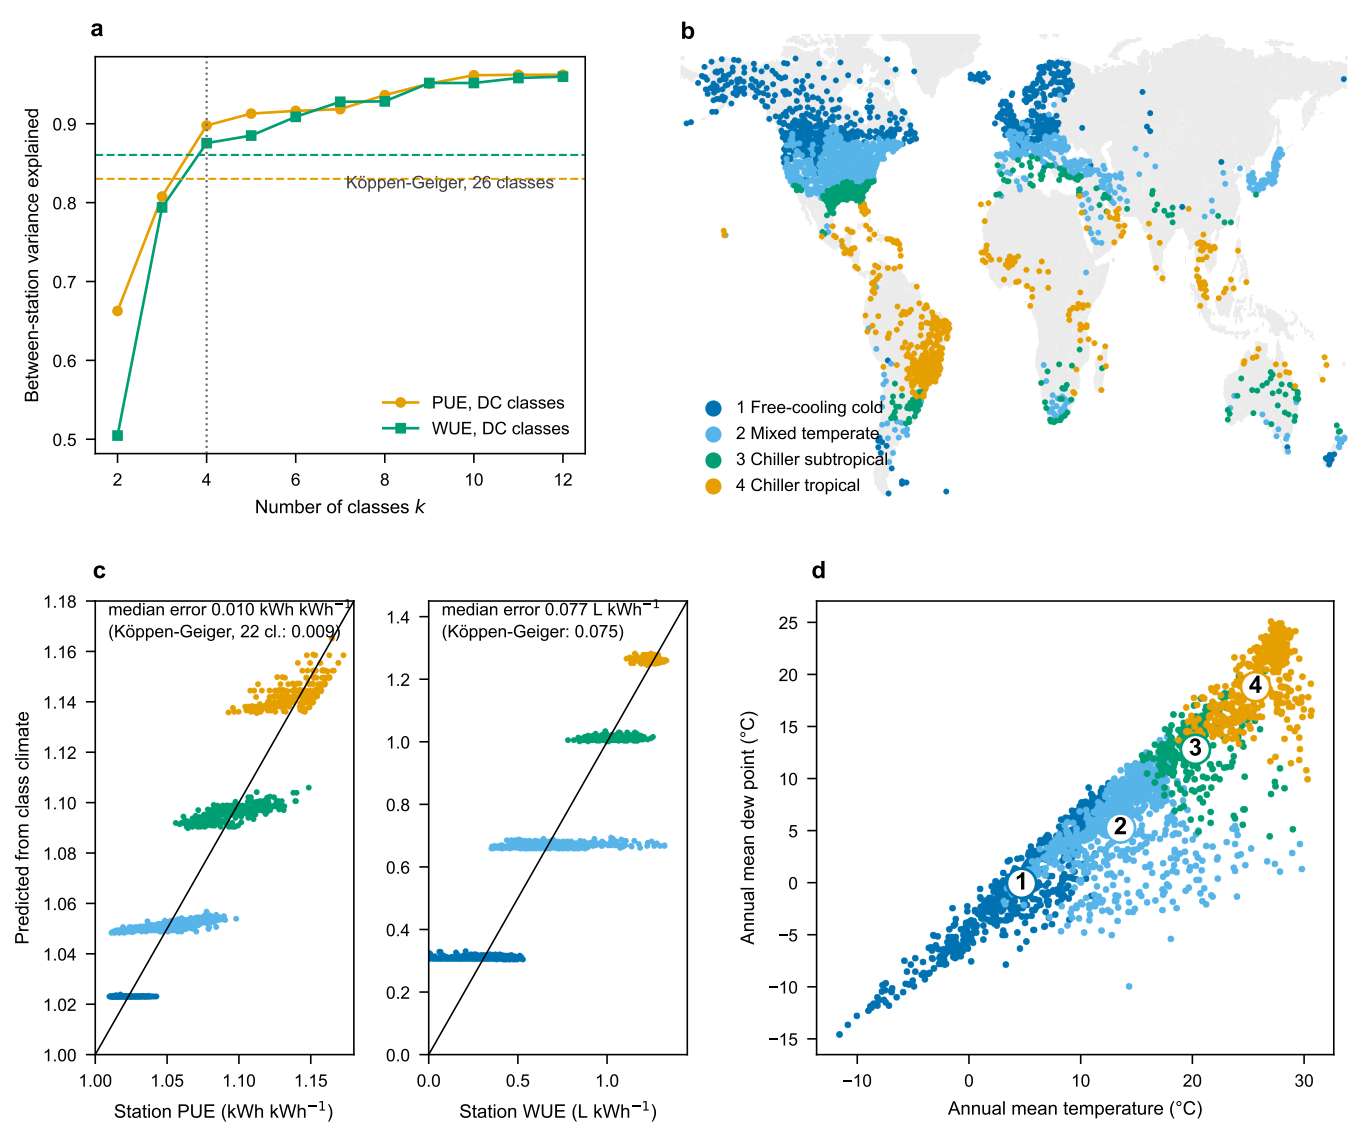

a
Between-station variance explained
0.9
0.8
0.7
0.6
0.5
Köppen-Geiger, 26 classes
PUE, DC classes
WUE, DC classes
2
4
6
8
10
12
Number of classes k
b
1 Free-cooling cold
2 Mixed temperate
3 Chiller subtropical
4 Chiller tropical
c
median error 0.010 kWh kWh−1
(Köppen-Geiger, 22 cl.: 0.009)
Predicted from class climate
1.18
1.16
1.14
1.12
1.10
1.08
1.06
1.04
1.02
1.00
1.00
1.05
1.10
1.15
Station PUE (kWh kWh−1)
median error 0.077 L kWh−1
(Köppen-Geiger: 0.075)
1.4
1.2
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.5
1.0
Station WUE (L kWh−1)
d
Annual mean dew point (°C)
25
20
15
10
5
0
−5
−10
−15
1
2
3
4
−10
0
10
20
30
Annual mean temperature (°C)