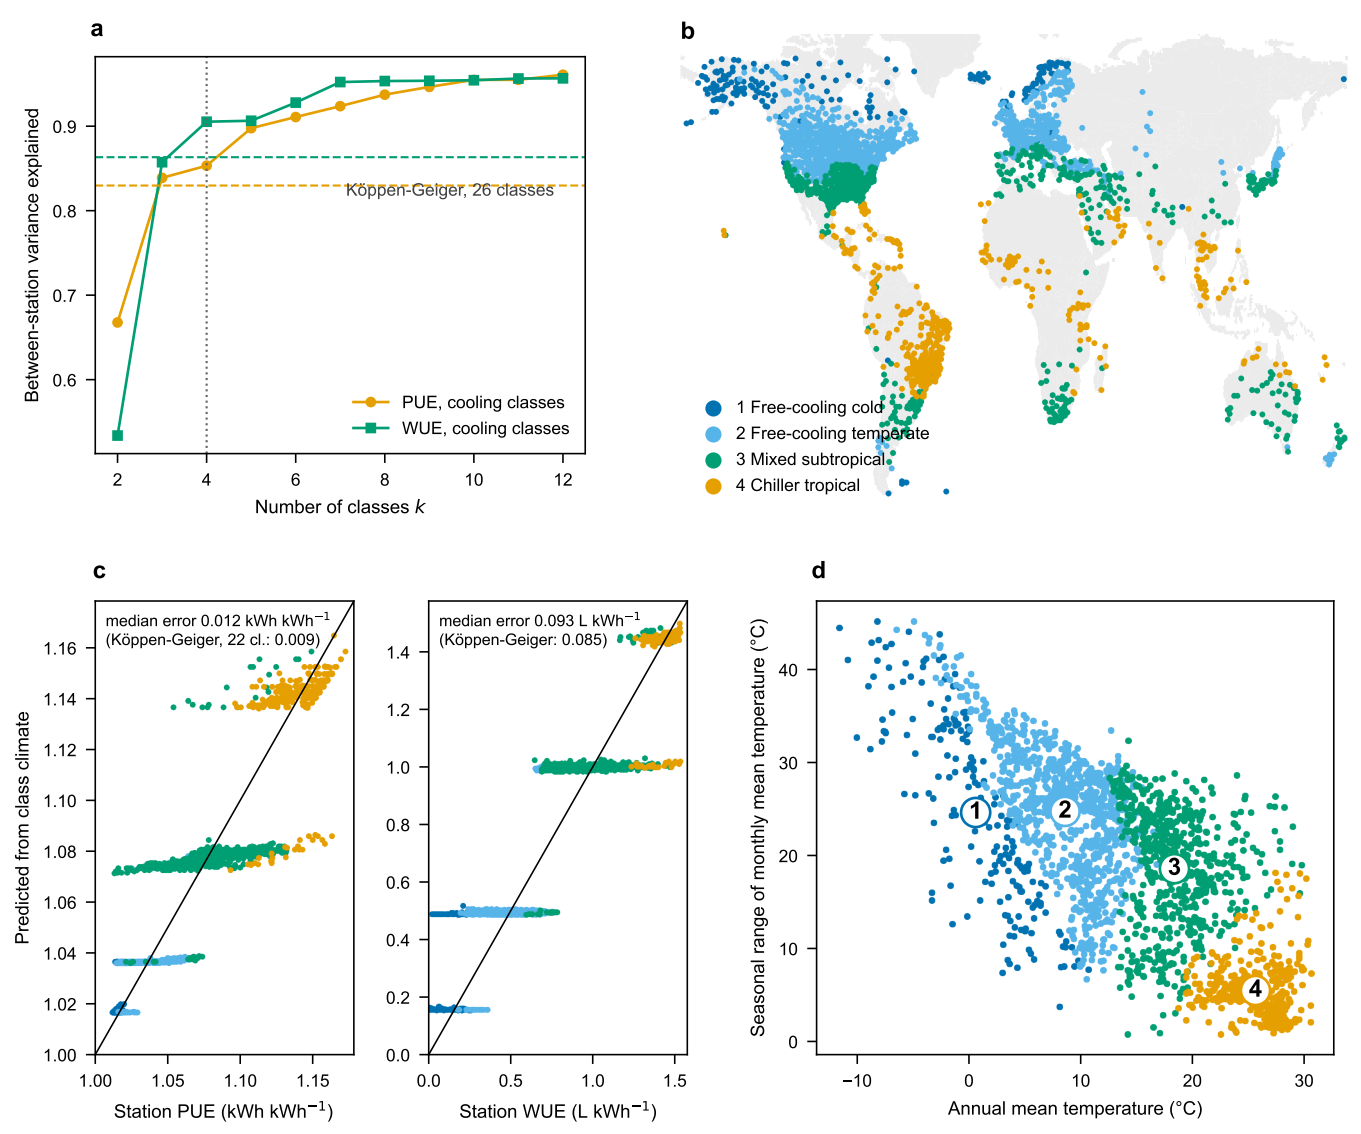

a
Between-station variance explained
0.9
0.8
0.7
0.6
Köppen-Geiger, 26 classes
PUE, cooling classes
WUE, cooling classes
2
4
6
8
10
12
Number of classes k
b
1 Free-cooling cold
2 Free-cooling temperate
3 Mixed subtropical
4 Chiller tropical
c
median error 0.012 kWh kWh^{-1}
(Köppen-Geiger, 22 cl.: 0.009)
Predicted from class climate
1.16
1.14
1.12
1.10
1.08
1.06
1.04
1.02
1.00
1.00
1.05
1.10
1.15
Station PUE (kWh kWh^{-1})
median error 0.093 L kWh^{-1}
(Köppen-Geiger: 0.085)
1.4
1.2
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.5
1.0
1.5
Station WUE (L kWh^{-1})
d
Seasonal range of monthly mean temperature (°C)
40
30
20
10
0
−10
0
10
20
30
Annual mean temperature (°C)
1
2
3
4