


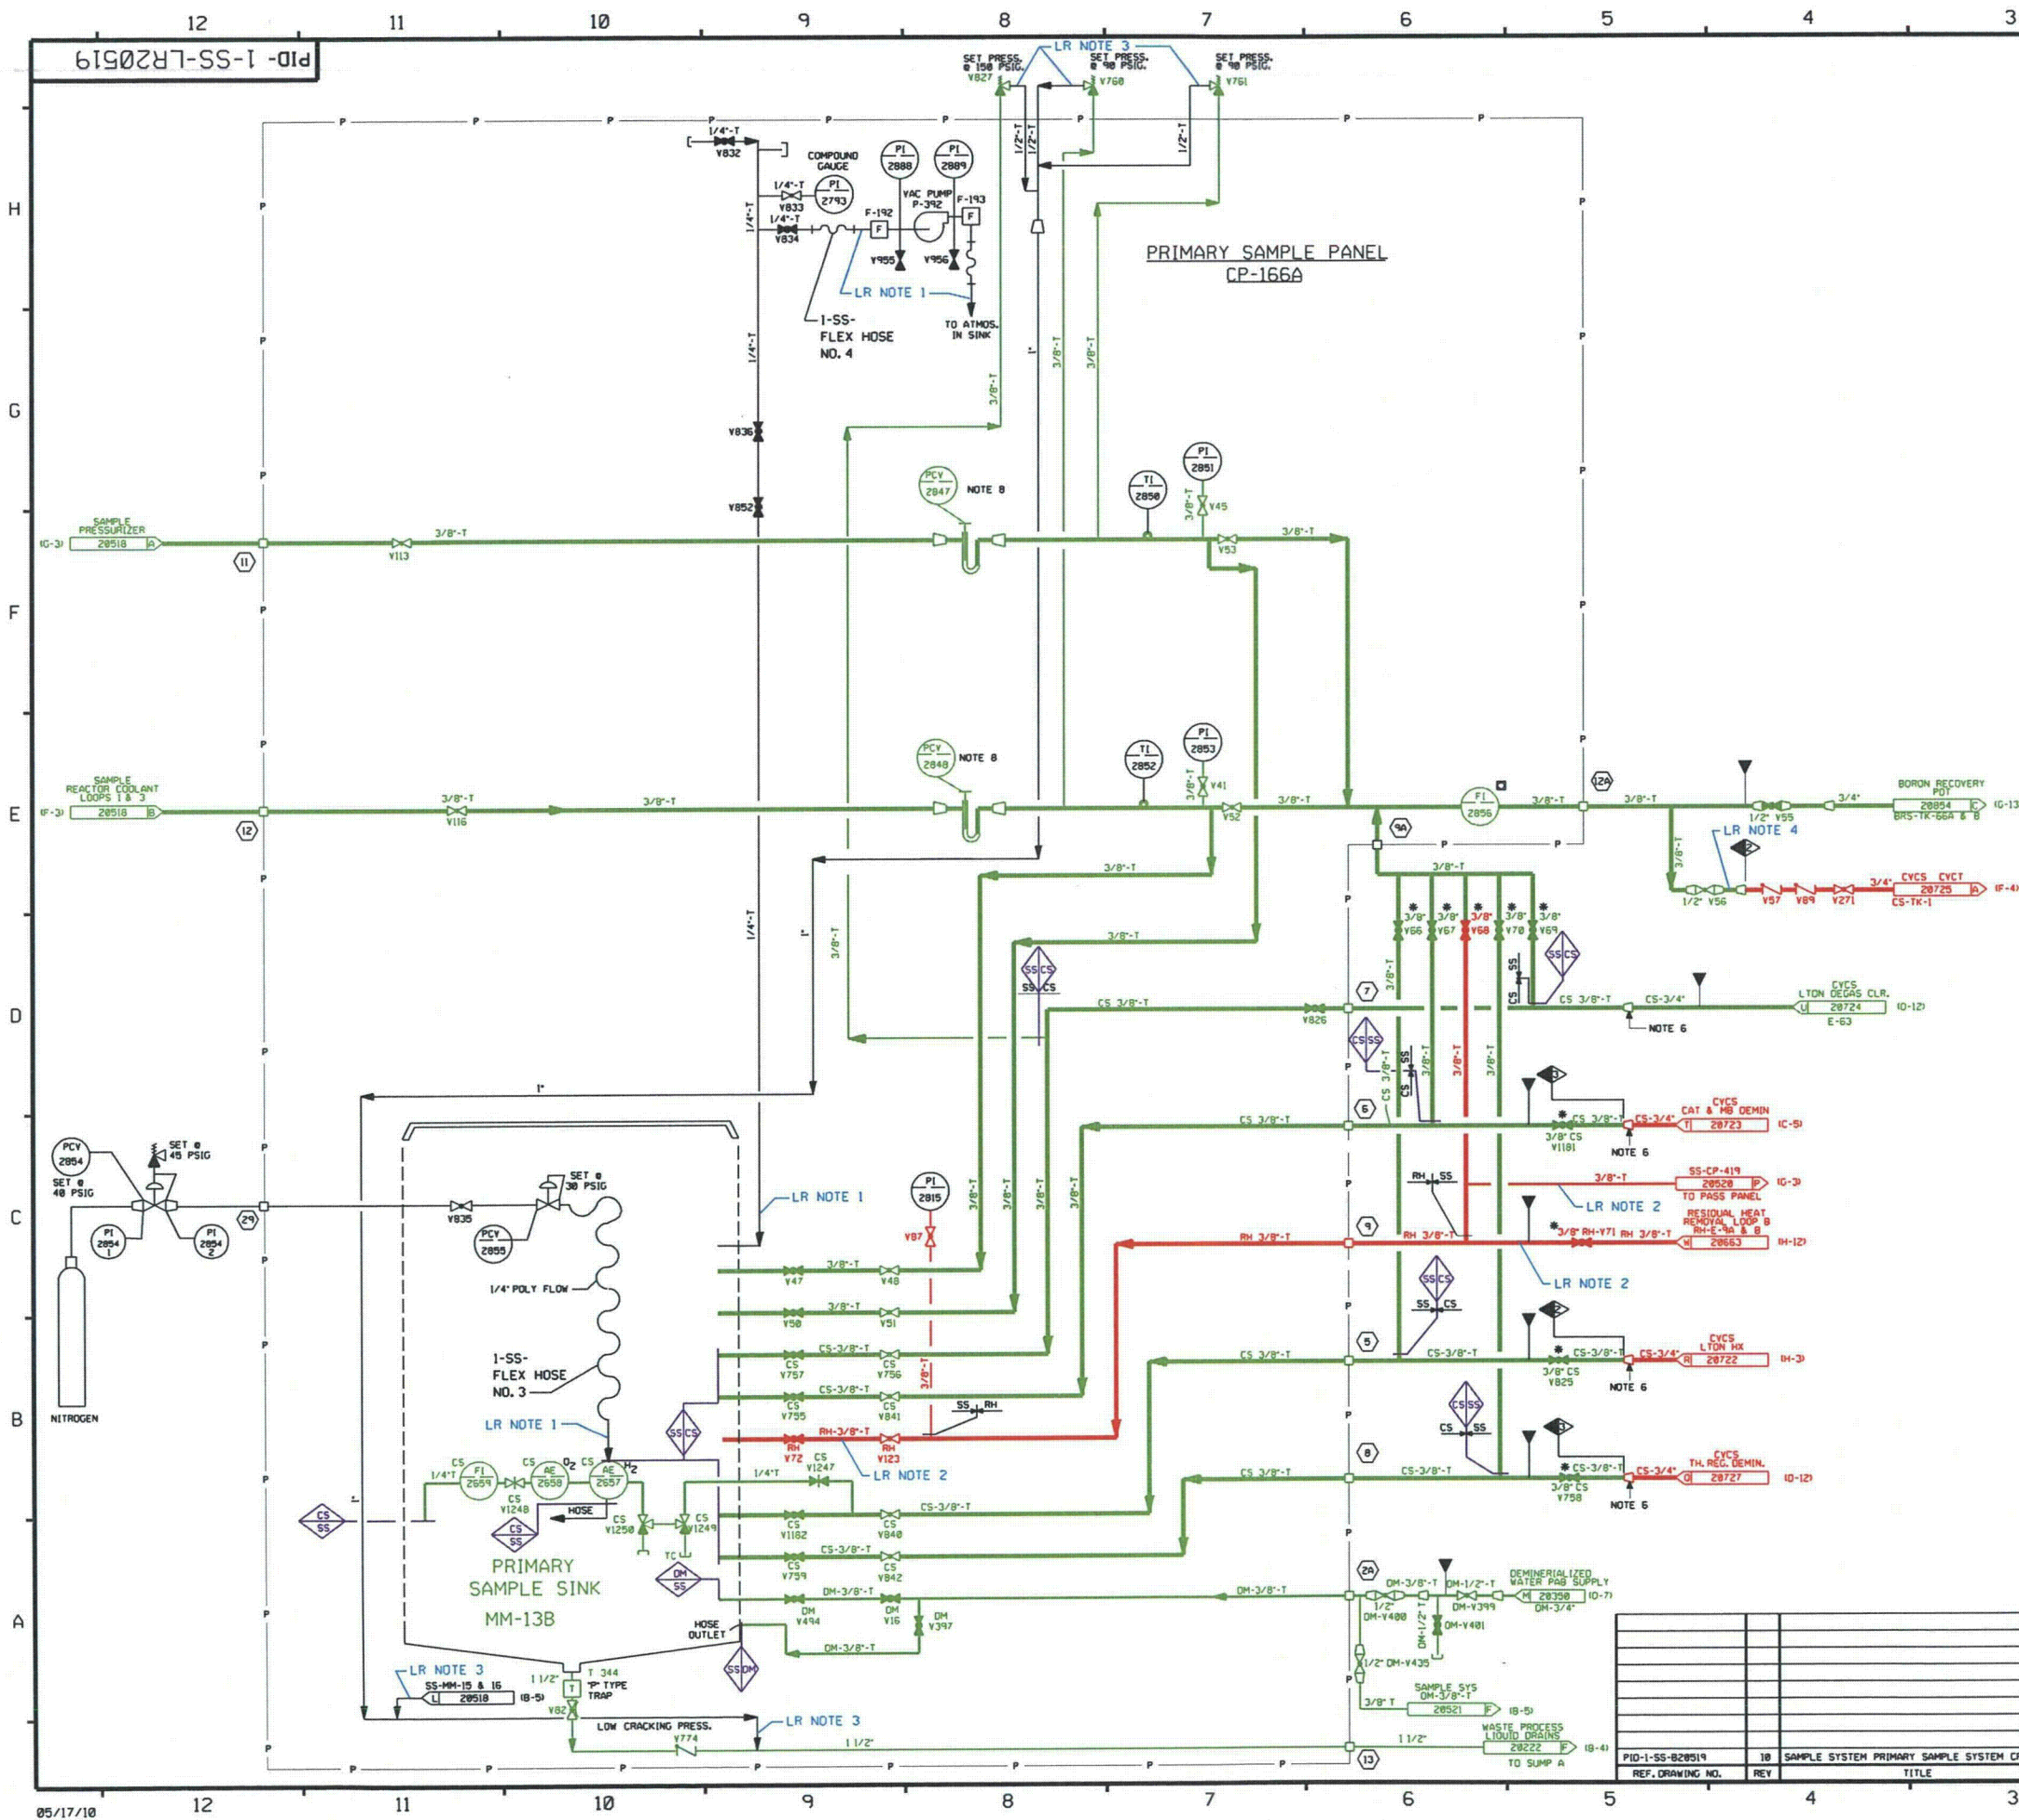

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

LR NOTES:

1. THIS PORTION OF THE SAMPLE SYSTEM IS NOT IN SCOPE BECAUSE THE INTERNAL ENVIRONMENT IS AIR/GAS.
2. PIPING IS IN SCOPE FOR CRITERION 10X3 FIRE PROTECTION.
3. PIPING HAS INTERNAL ENVIRONMENT OF AIR/GAS THEREFORE IS NOT IN SCOPE FOR LICENSE RENEWAL.
4. THE TRANSITION TO TUBING DOES NOT NEED AN EQUIVALENT ANCHOR TO ISOLATE THE CLASS BREAK AT VALVE SS-V-57. REFERENCE CALCULATIONS ARE MCD 565.80-CALC, MCD 10248-CALC AND MCD 503.20-CALC.

COMPONENTS SUBJECT TO AMR

RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.41(a)(1) AND/OR 10X3 AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.41(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR



INDICATES SYSTEM BOUNDARY INTERFACE
SS - SAMPLE SYSTEM
DM - DEMINERALIZED WATER SYSTEM
CS - CHEMICAL & VOLUME CONTROL SYSTEM

NOTES:


1. WORK THIS DRAWING WITH DRAWING 20516, 20518, 20520 THRU 20522.
2. ALL LINES, EQUIPMENT, COMPONENTS AND INSTRUMENTS HAVE SYSTEM PREFIX "SS" UNLESS OTHERWISE NOTED.
3. ALL TUBING 3/8" T AND MAT'L 2588 UNLESS OTHERWISE NOTED.
4. DELETED
5. DELETED
6. THESE REDUCERS ARE TO BE AS CLOSE AS POSSIBLE TO ROOT VALVE.
7. * THIS VALVE TO BE REACH ROD OPERATED FROM THE SAMPLE RM SIDE OF THE SAMPLE RM ROOM - SAMPLE WALL.
8. THIS EQUIPMENT HAS 1/4" TUBING CONNECTORS.
9. △ INDICATES REVISION LEVEL.
10. DELETED.
11. ○ CONTINUATION CONNECTION SEE PP-74882.

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED


REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					



SAMPLE SYSTEM
PRIMARY SAMPLE PANEL
CP-166A
LICENSE RENEWAL P&ID
PID-1-SS-LR20519

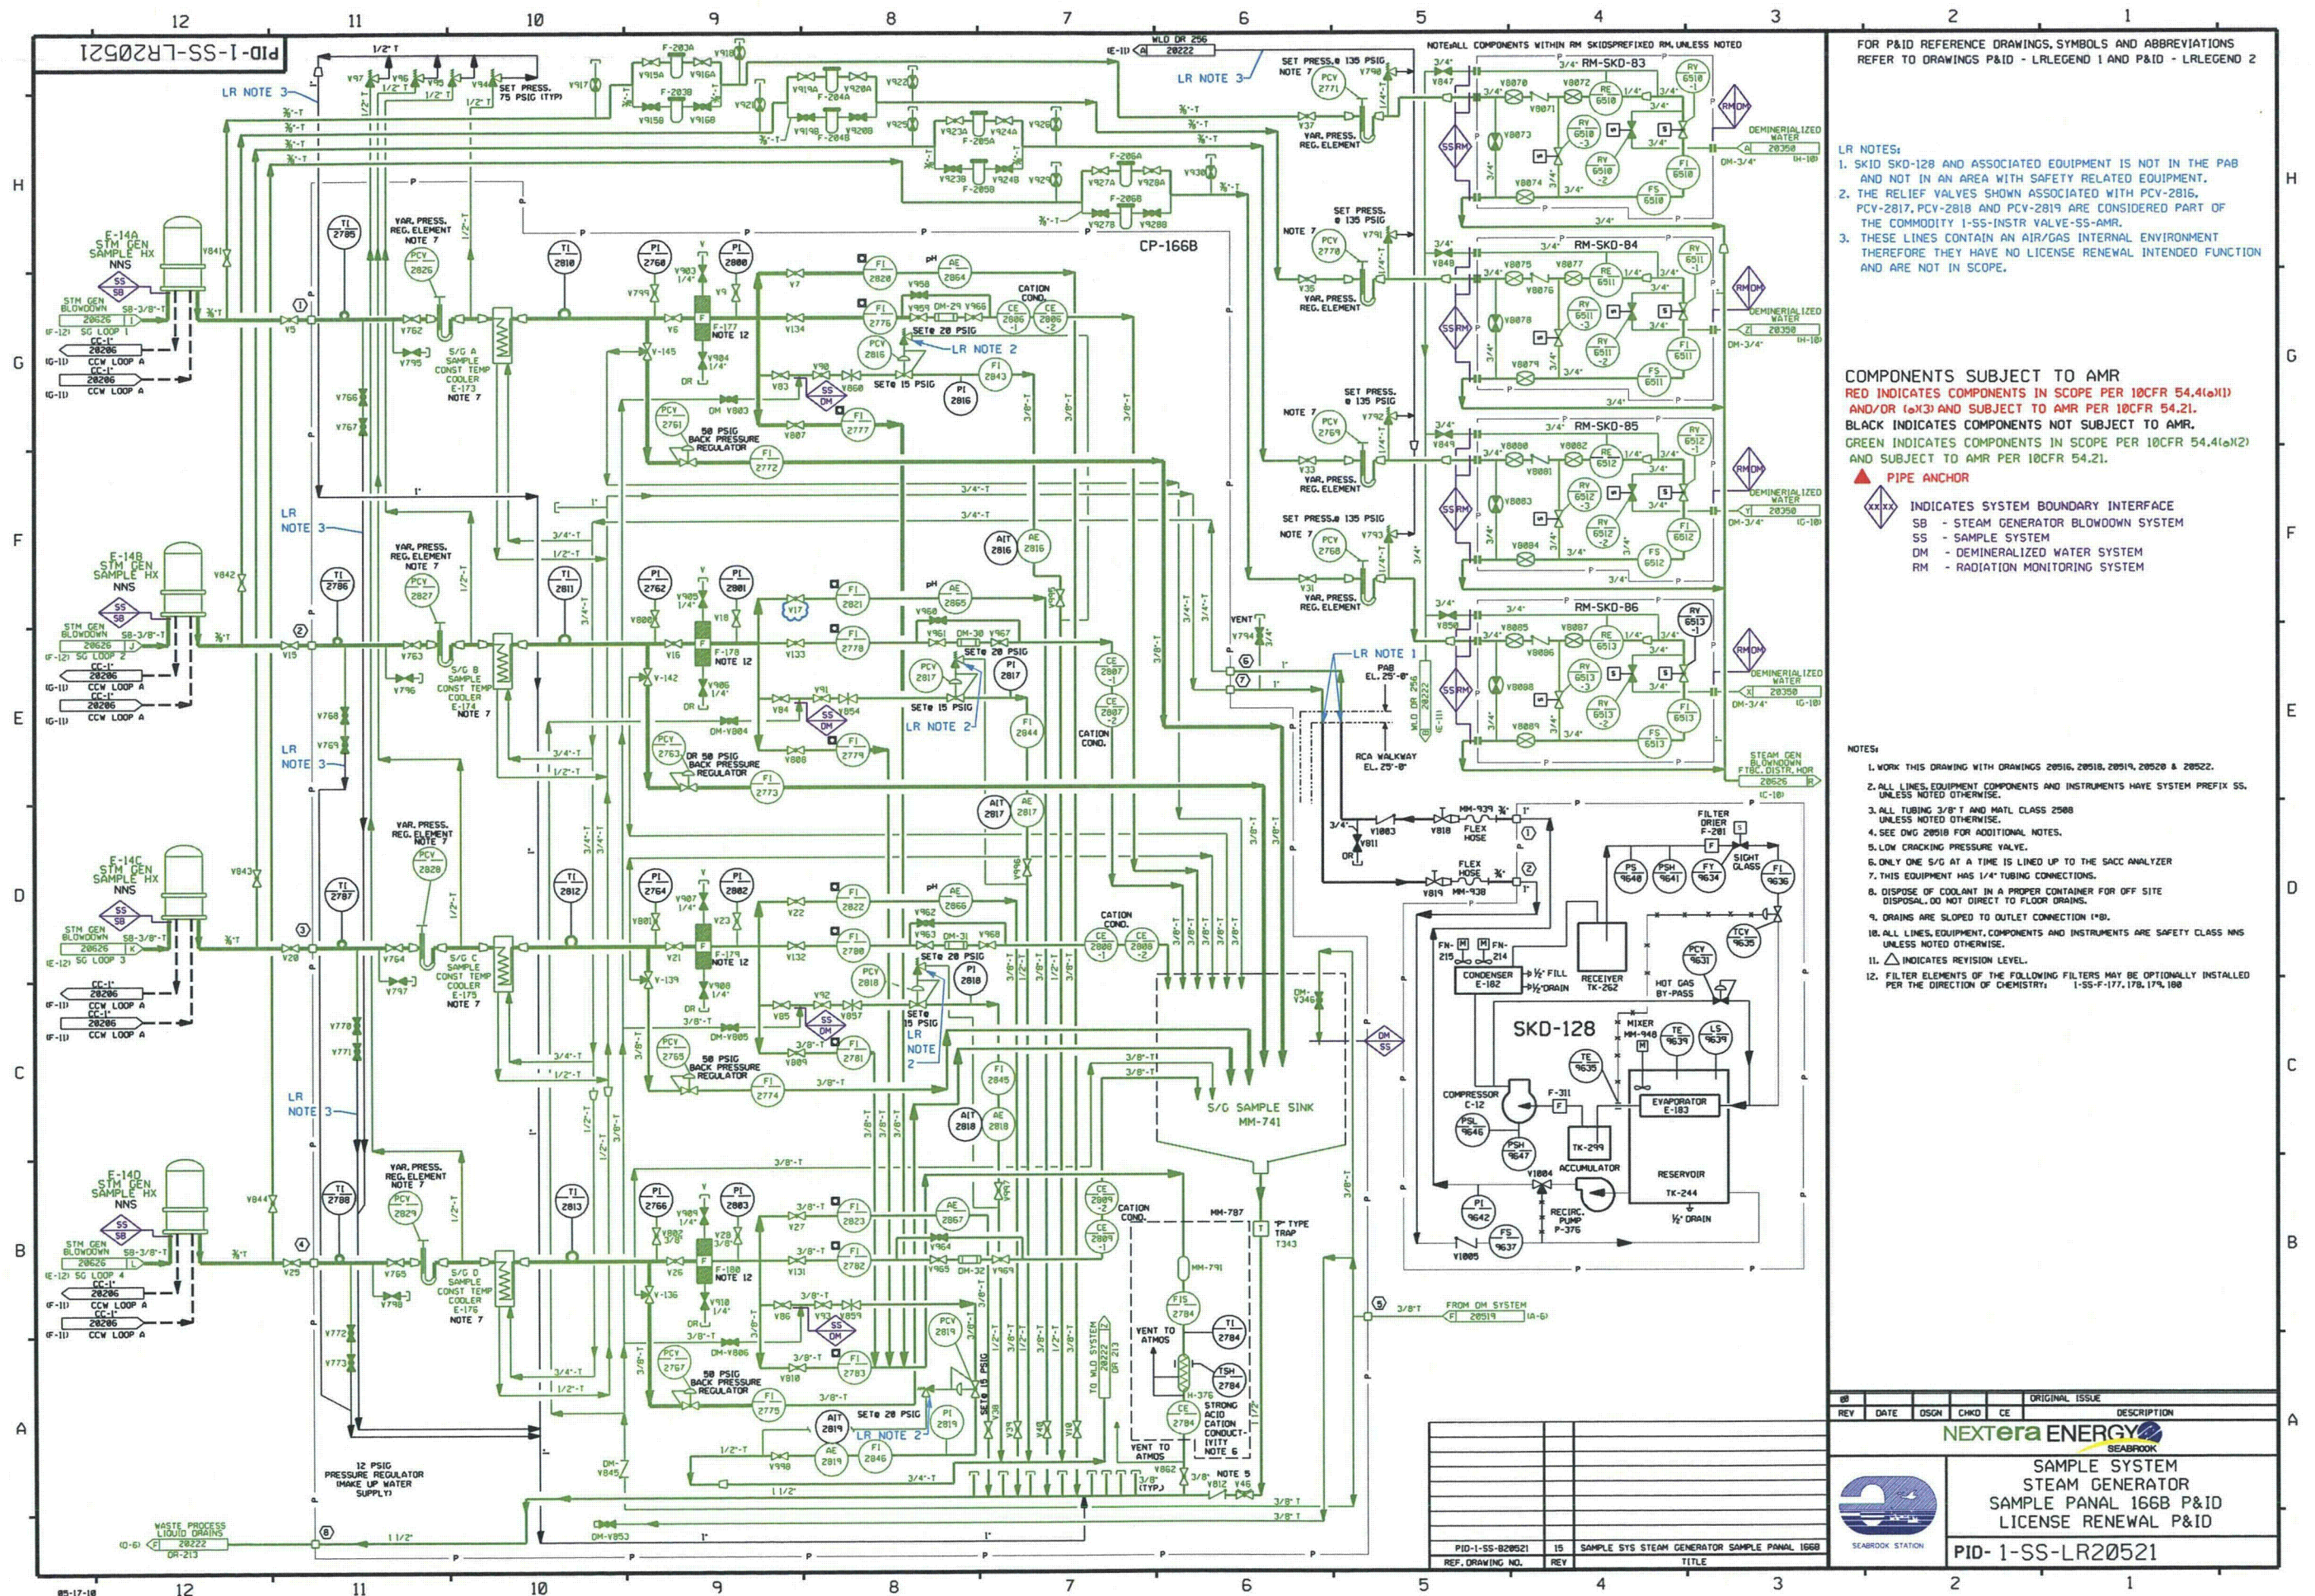

PID-1-SW-LR20794

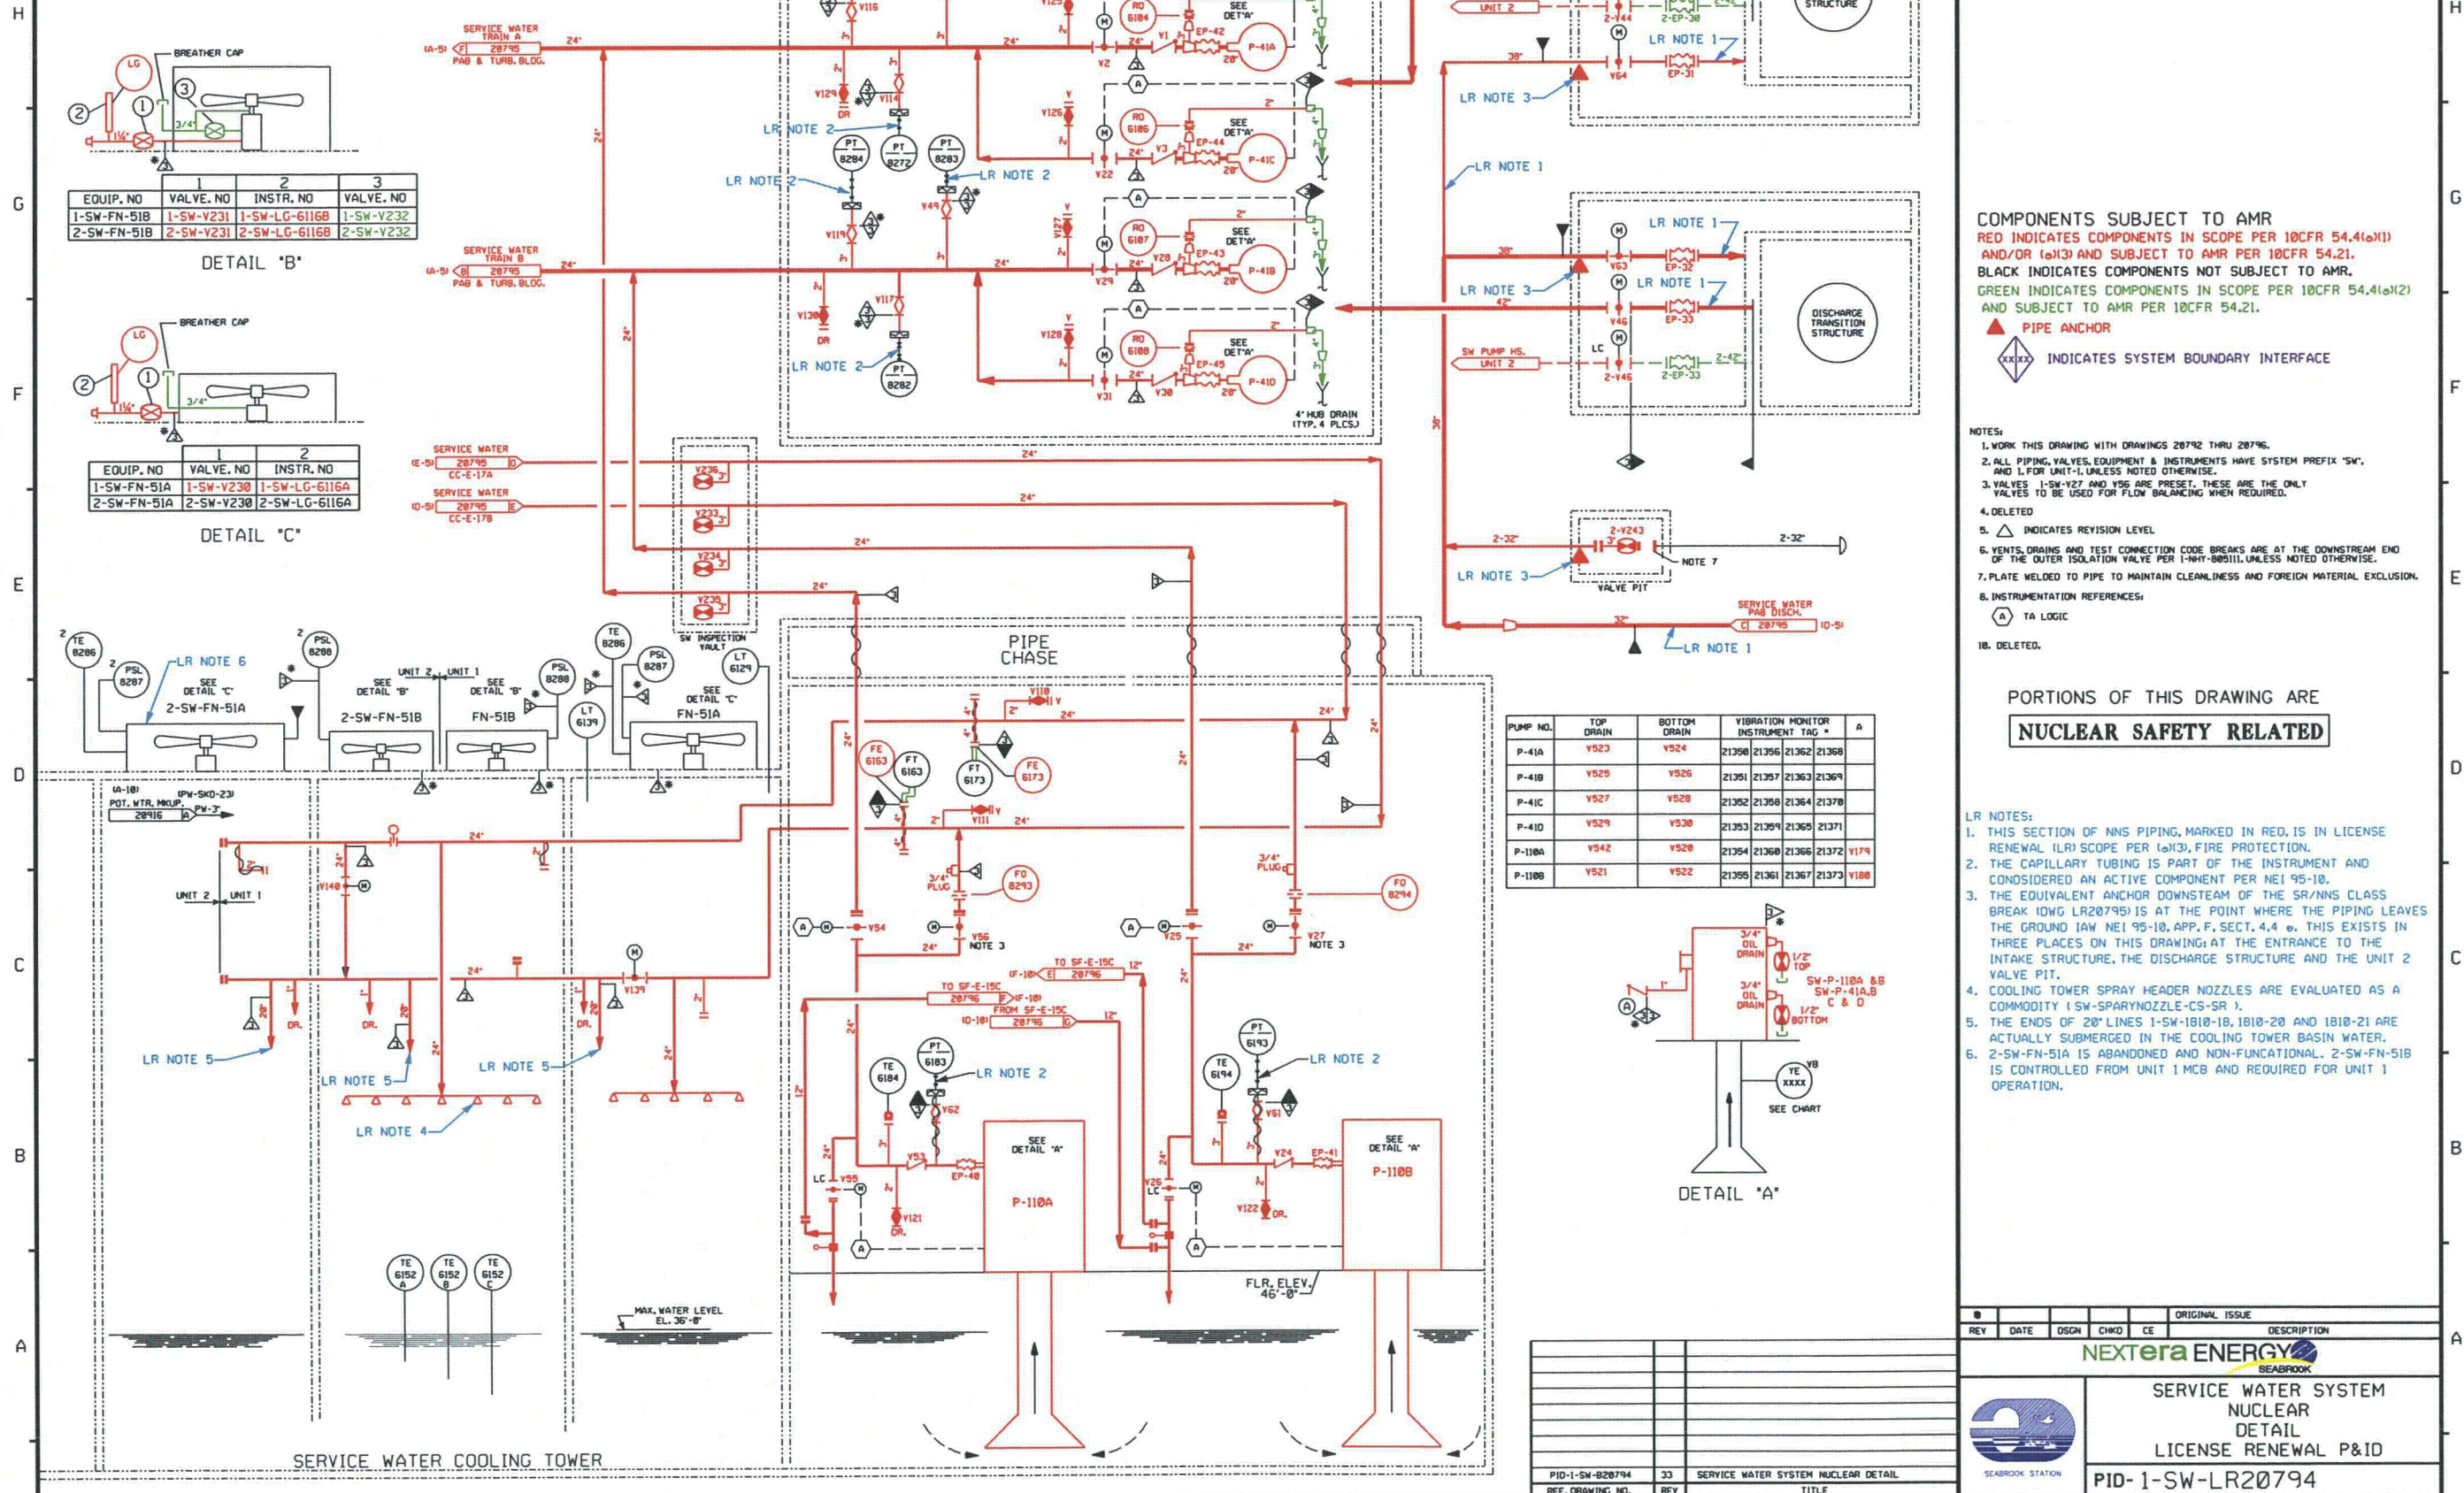


DETAIL "B"

EQUIP. NO	VALVE NO	INSTR. NO	VALVE NO
1-SW-FN-51B	1-SW-V231	1-SW-LG-6116B	1-SW-V232
2-SW-FN-51B	2-SW-V231	2-SW-LG-6116B	2-SW-V232

DETAIL "C"

EQUIP. NO	VALVE NO	INSTR. NO
1-SW-FN-51A	1-SW-V230	1-SW-LG-6116A
2-SW-FN-51A	2-SW-V230	2-SW-LG-6116A

PUMP NO.	TOP DRAIN	BOTTOM DRAIN	VIBRATION MONITOR INSTRUMENT TAG #	A
P-41A	Y523	Y524	21350 21356 21362 21368	
P-41B	Y525	Y526	21351 21357 21363 21369	
P-41C	Y527	Y528	21352 21358 21364 21370	
P-41D	Y529	Y530	21353 21359 21365 21371	
P-110A	Y542	Y528	21354 21360 21366 21372	Y179
P-110B	Y521	Y522	21355 21361 21367 21373	Y180

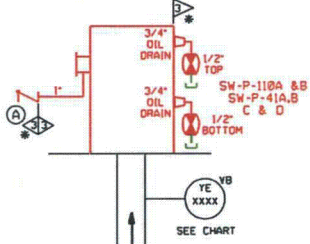

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID - LRLEGENO 1 AND P&ID - LRLEGENO 2

COMPONENTS SUBJECT TO AMR
 RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
 BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
 GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.
 ▲ PIPE ANCHOR
 XXXX INDICATES SYSTEM BOUNDARY INTERFACE

- NOTES:**
1. WORK THIS DRAWING WITH DRAWINGS 20792 THRU 20796.
 2. ALL PIPING, VALVES, EQUIPMENT & INSTRUMENTS HAVE SYSTEM PREFIX "SW", AND "L" FOR UNIT-1, UNLESS NOTED OTHERWISE.
 3. VALVES 1-SW-V27 AND V56 ARE PRESET. THESE ARE THE ONLY VALVES TO BE USED FOR FLOW BALANCING WHEN REQUIRED.
 4. DELETED
 5. △ INDICATES REVISION LEVEL
 6. VENTS, DRAINS AND TEST CONNECTION CODE BREAKS ARE AT THE DOWNSTREAM END OF THE OUTER ISOLATION VALVE PER 1-WHY-805111, UNLESS NOTED OTHERWISE.
 7. PLATE WELDED TO PIPE TO MAINTAIN CLEANLINESS AND FOREIGN MATERIAL EXCLUSION.
 8. INSTRUMENTATION REFERENCES:
 (A) TA LOGIC
 10. DELETED.

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

- LR NOTES:**
1. THIS SECTION OF NNS PIPING, MARKED IN RED, IS IN LICENSE RENEWAL (LR) SCOPE PER (a)(3), FIRE PROTECTION.
 2. THE CAPILLARY TUBING IS PART OF THE INSTRUMENT AND CONSIDERED AN ACTIVE COMPONENT PER NEI 95-10.
 3. THE EQUIVALENT ANCHOR DOWNSTREAM OF THE SR/NNS CLASS BREAK IDWG LR20795 IS AT THE POINT WHERE THE PIPING LEAVES THE GROUND (AW NEI 95-10, APP. F, SECT. 4.4). THIS EXISTS IN THREE PLACES ON THIS DRAWING: AT THE ENTRANCE TO THE INTAKE STRUCTURE, THE DISCHARGE STRUCTURE AND THE UNIT 2 VALVE PIT.
 4. COOLING TOWER SPRAY HEADER NOZZLES ARE EVALUATED AS A COMMODITY (SW-SPARYNOZZLE-CS-SR).
 5. THE ENDS OF 20" LINES 1-SW-1810-18, 1810-20 AND 1810-21 ARE ACTUALLY SUBMERGED IN THE COOLING TOWER BASIN WATER.
 6. 2-SW-FN-51A IS ABANDONED AND NON-FUNCTIONAL. 2-SW-FN-51B IS CONTROLLED FROM UNIT 1 MCB AND REQUIRED FOR UNIT 1 OPERATION.

REV	DATE	DSGN	CHKD	CE	ORIGINAL ISSUE	DESCRIPTION

		SERVICE WATER SYSTEM NUCLEAR DETAIL LICENSE RENEWAL P&ID
		PID-1-SW-LR20794