random gaps; ±5 % is the monthly bias limit for calibrated models in ASHRAE Guideline 14; months with little demand left out

General weather hidden (temperature, humidity, pressure, wind)

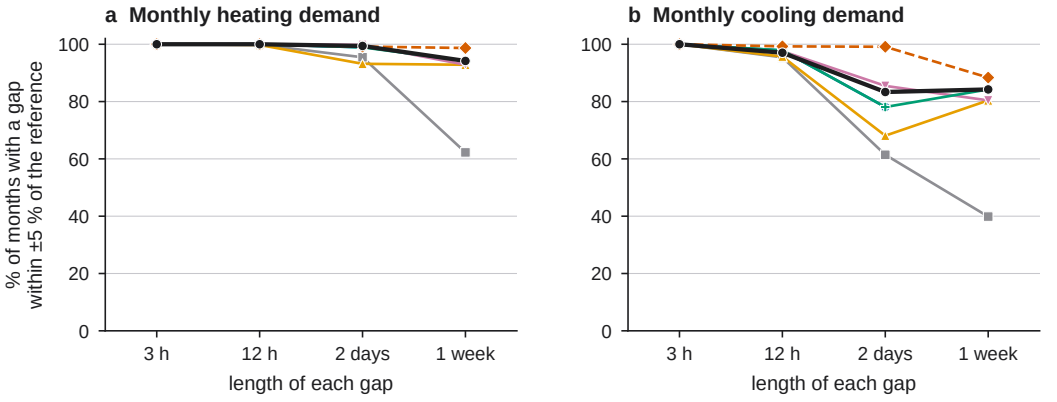

Solar radiation hidden (global, direct and diffuse)

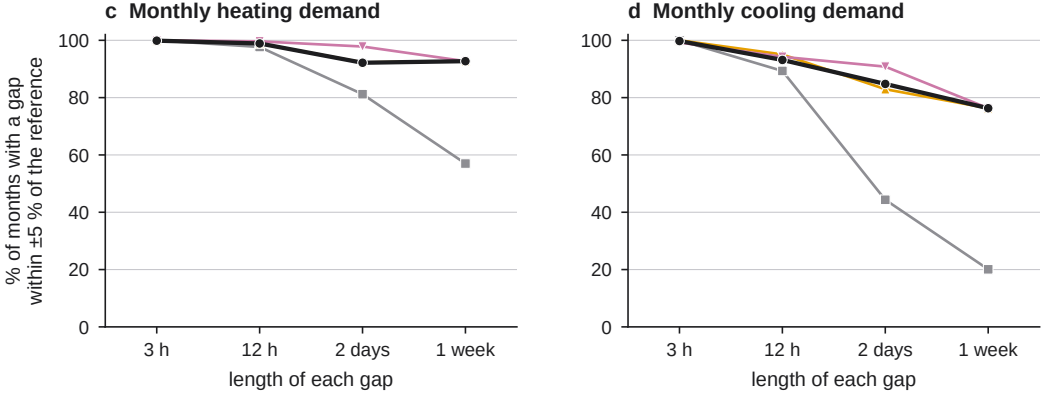

* only gaps where a nearby station passed the test

filling over time stops at 48 h and matches the older order up to 2 days

solar (c, d) has no nearby-station step, so filling over time matches smhi2epw up to 2 days; above 2 days smhi2epw and diyepw-style use ERA5, so all three match at 1 week