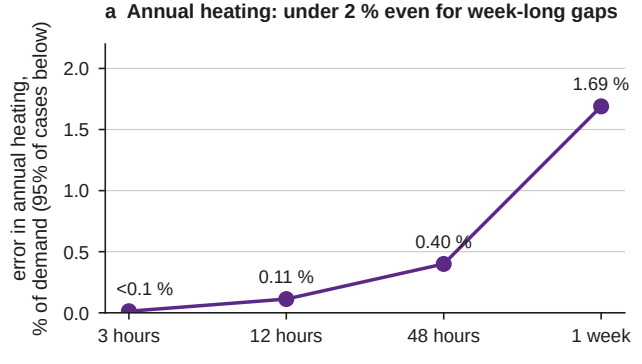
a Annual heating: under 2 % even for week-long gaps
error in annual heating,
% of demand (95% of cases below)
2.0
1.5
1.0
0.5
0.0
<0.1 %
0.11 %
0.40 %
1.69 %
3 hours
12 hours
48 hours
1 week

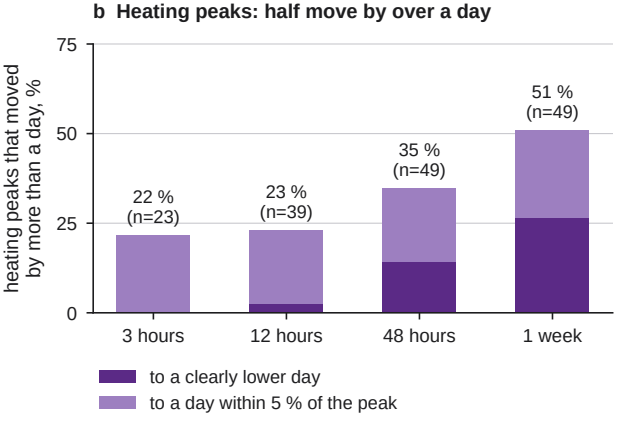
b Heating peaks: half move by over a day
heating peaks that moved
by more than a day, %
75
50
25
0
22 %
(n=23)
23 %
(n=39)
35 %
(n=49)
51 %
(n=49)
3 hours
12 hours
48 hours
1 week
to a clearly lower day
to a day within 5 % of the peak