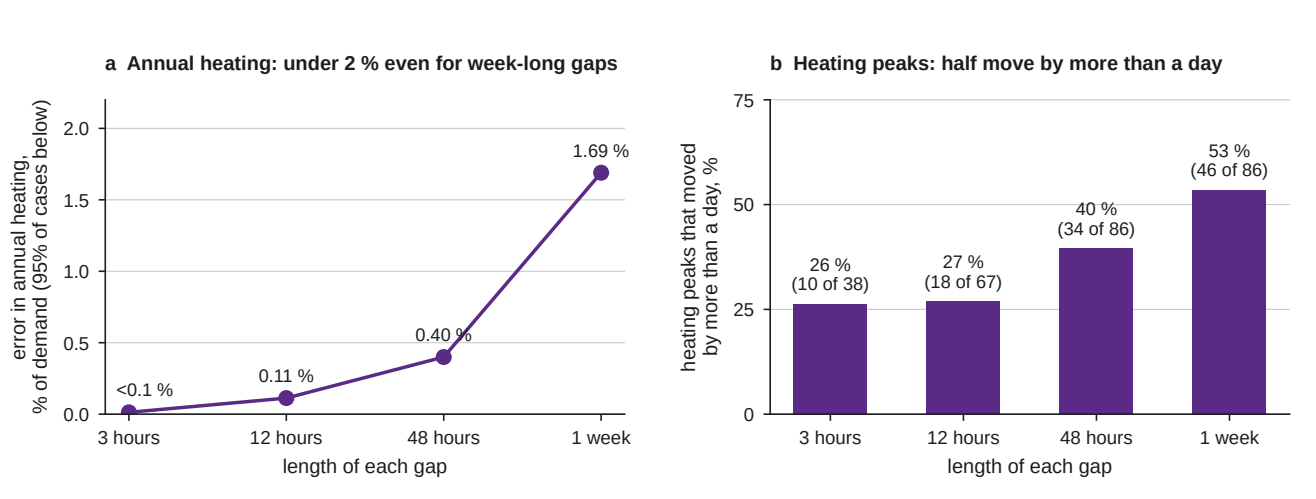
a Annual heating: under 2 % even for week-long gaps
error in annual heating,
% of demand (95% of cases below)
2.0
1.5
1.0
0.5
0.0
<0.1 %
0.11 %
0.40 %
1.69 %
3 hours
12 hours
48 hours
1 week
length of each gap
b Heating peaks: half move by more than a day
heating peaks that moved
by more than a day, %
75
50
25
0
26 %
(10 of 38)
27 %
(18 of 67)
40 %
(34 of 86)
53 %
(46 of 86)
3 hours
12 hours
48 hours
1 week
length of each gap