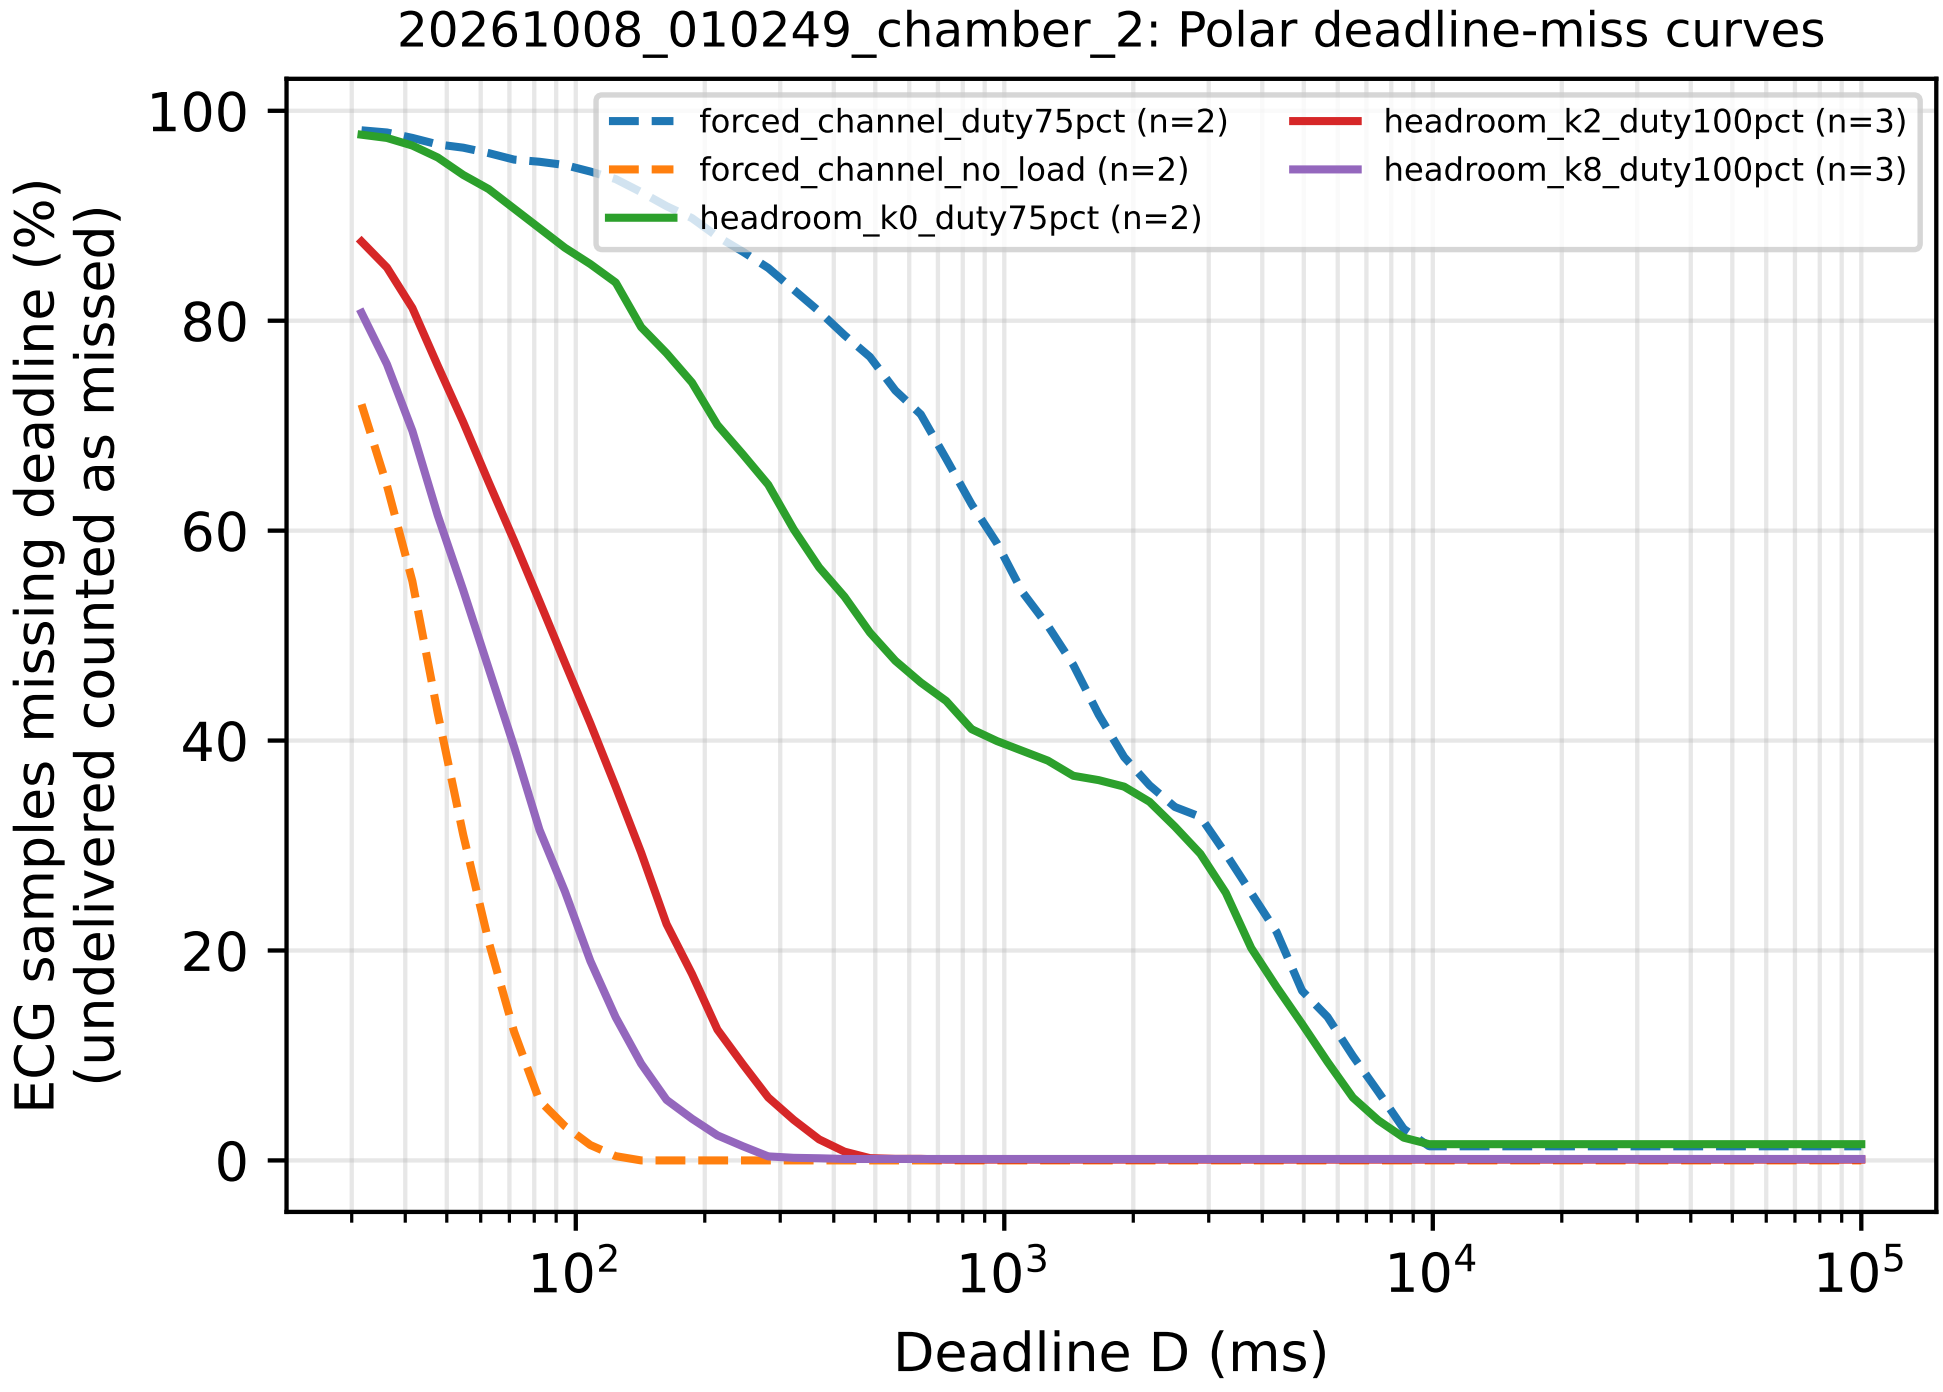
20261008_010249_chamber_2: Polar deadline-miss curves
forced_channel_duty75pct (n=2)
forced_channel_no_load (n=2)
headroom_k0_duty75pct (n=2)
headroom_k2_duty100pct (n=3)
headroom_k8_duty100pct (n=3)
ECG samples missing deadline (%)
(undelivered counted as missed)
100
80
60
40
20
0
10^2
10^3
10^4
10^5
Deadline D (ms)