Coherence between 24h and 6h analyses

The FREQ Procedure

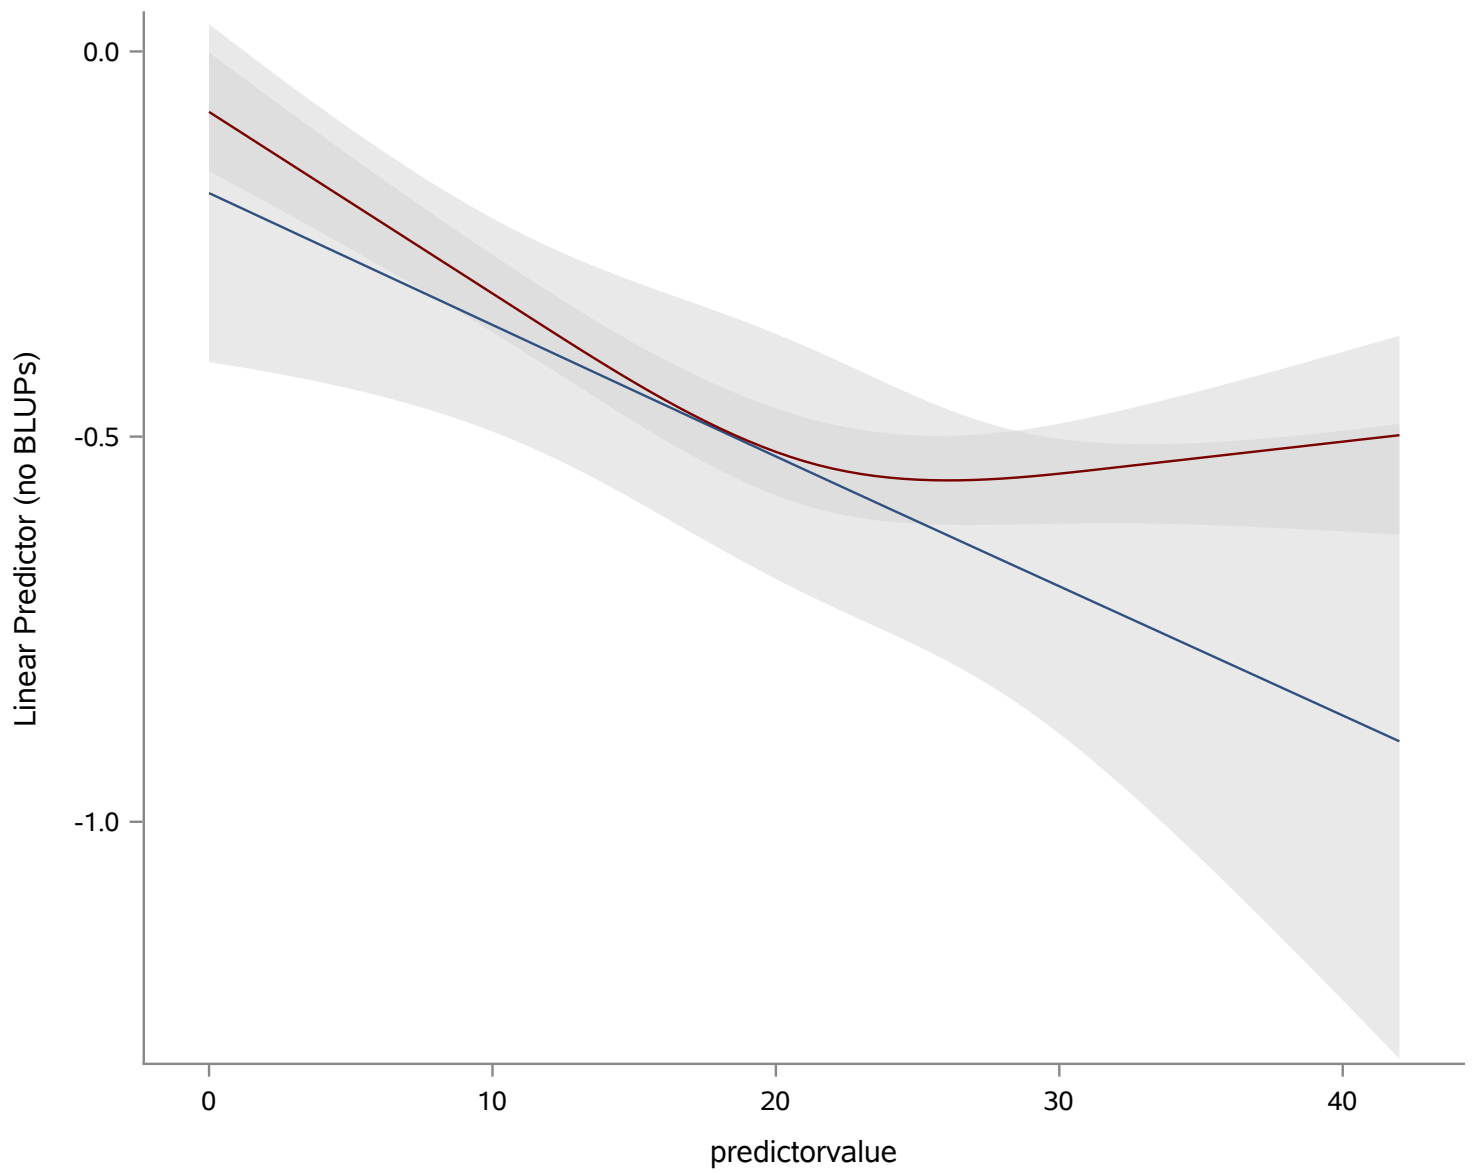| Frequency Percent Row Pct	Table of bon_p24 by sig6		
	sig6		
bon_p24	**0**	**1**	**Total**
0	6 18.18 46.15	7 21.21 53.85	13 39.39
1	12 36.36 60.00	8 24.24 40.00	20 60.61
Total	18 54.55	15 45.45	33 100.00

Significant also in 6h
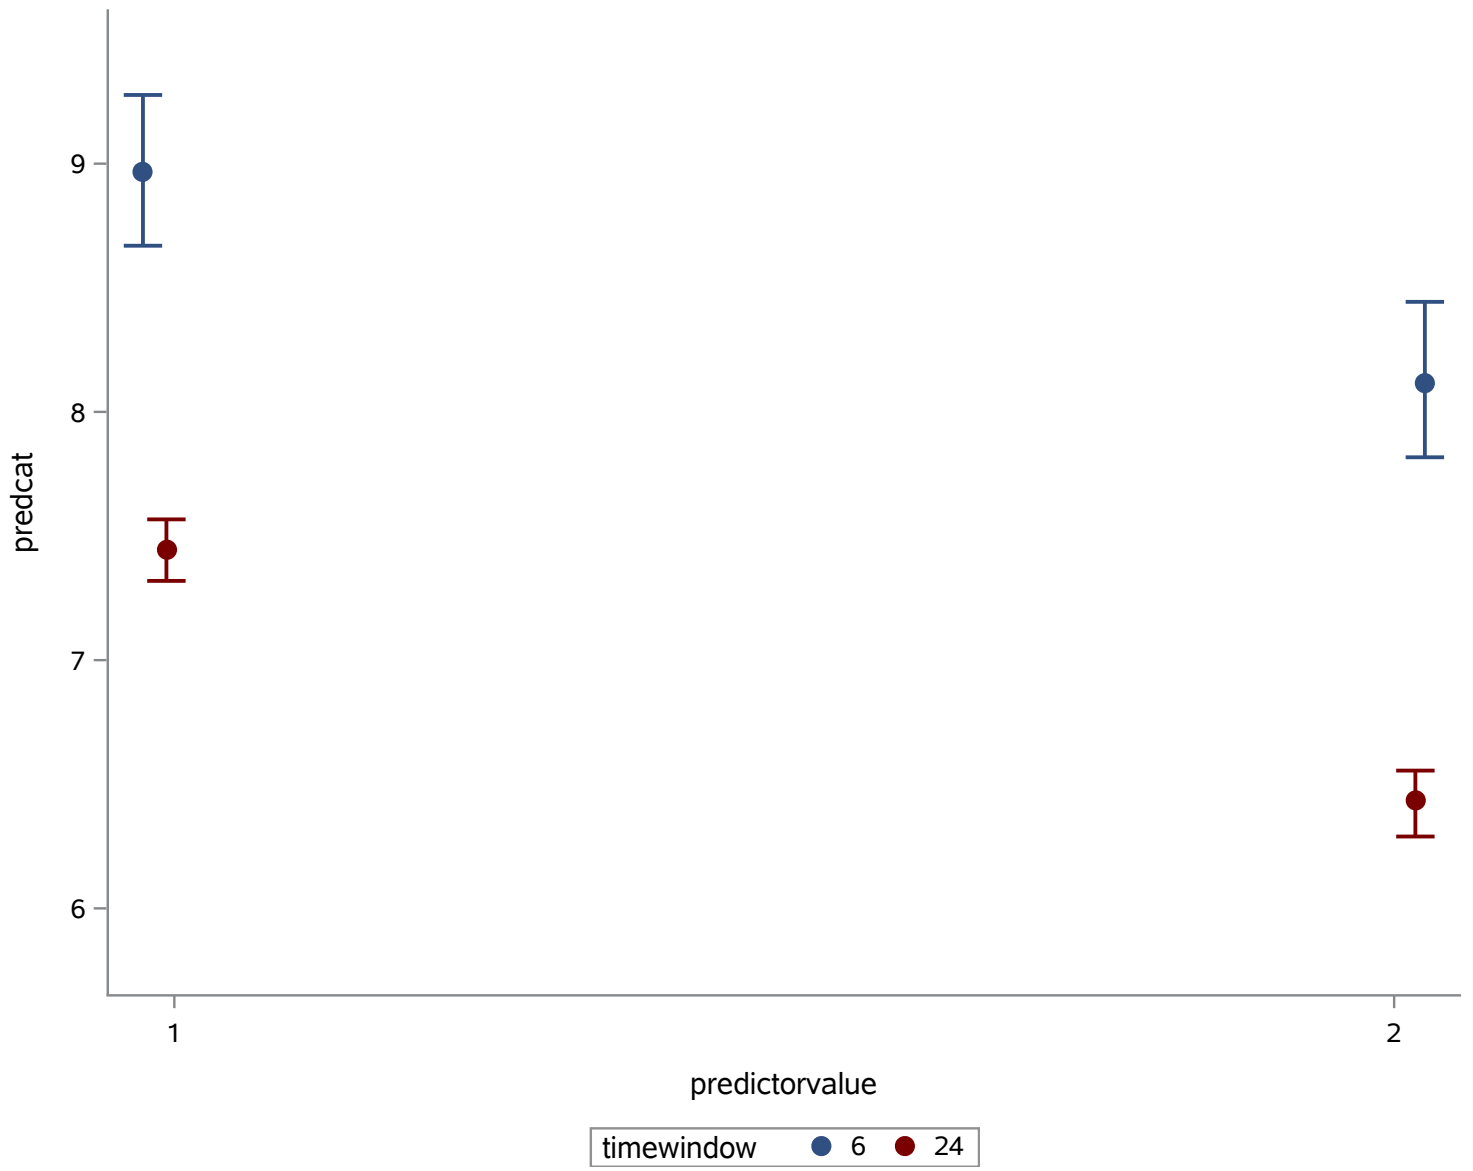
label=HB predictor=meandonorhb
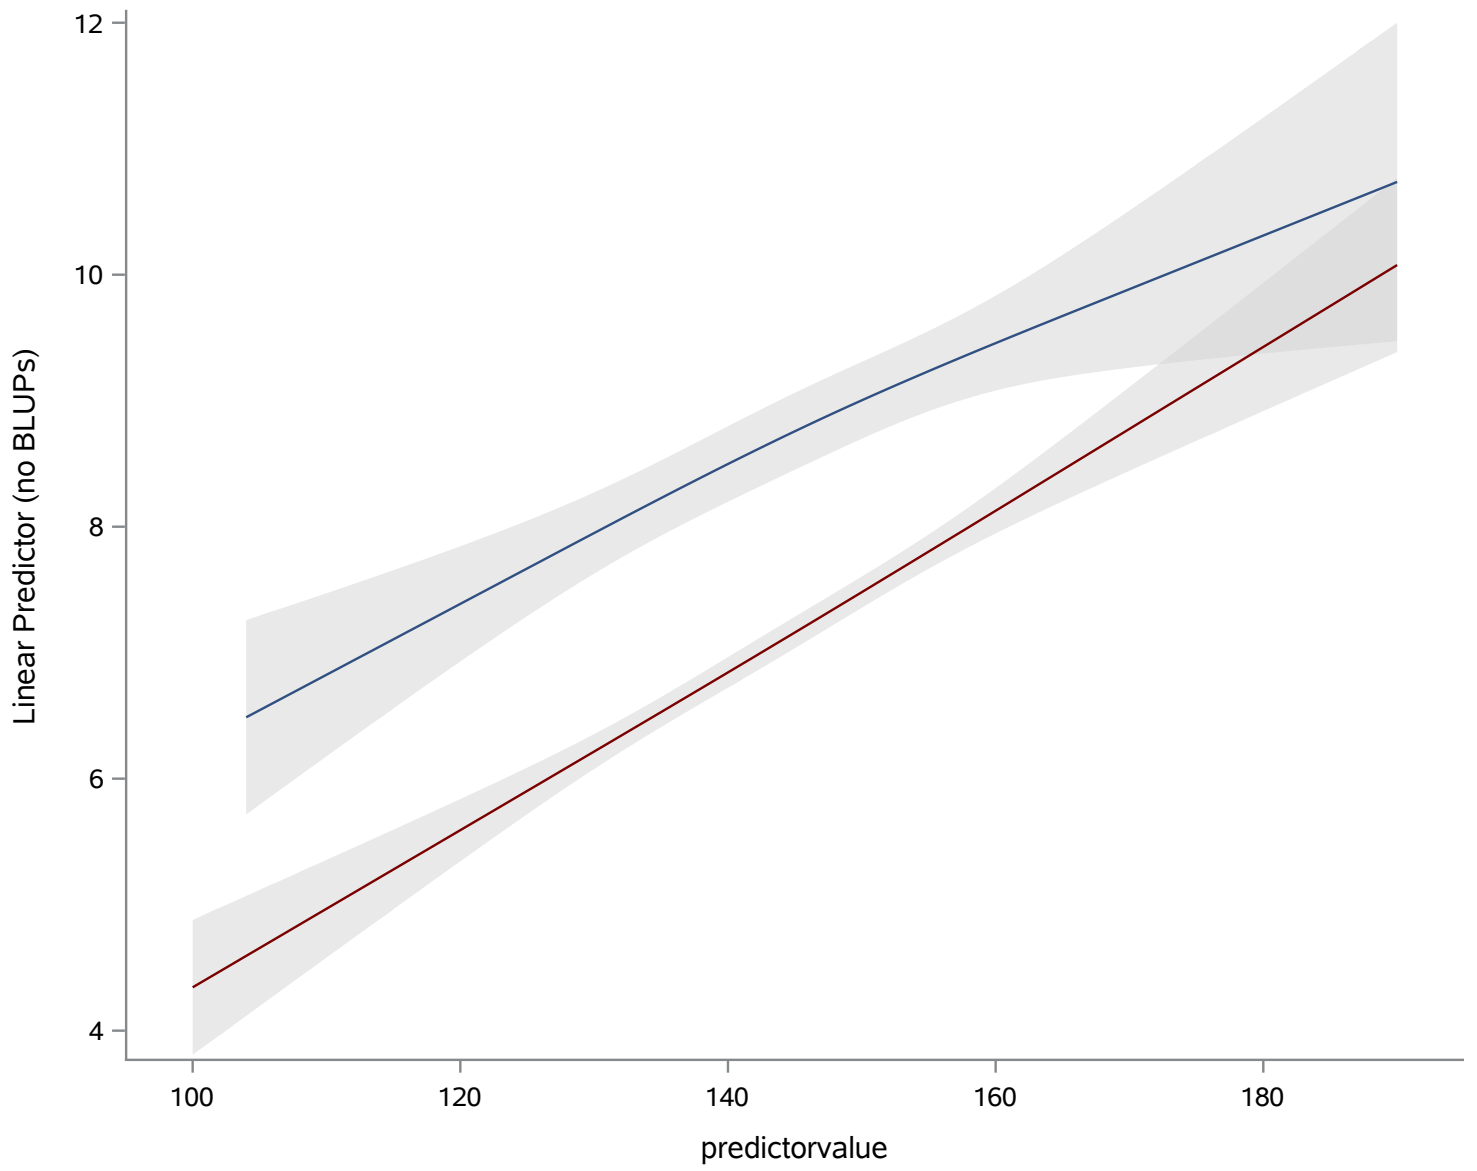
Significant also in 6h
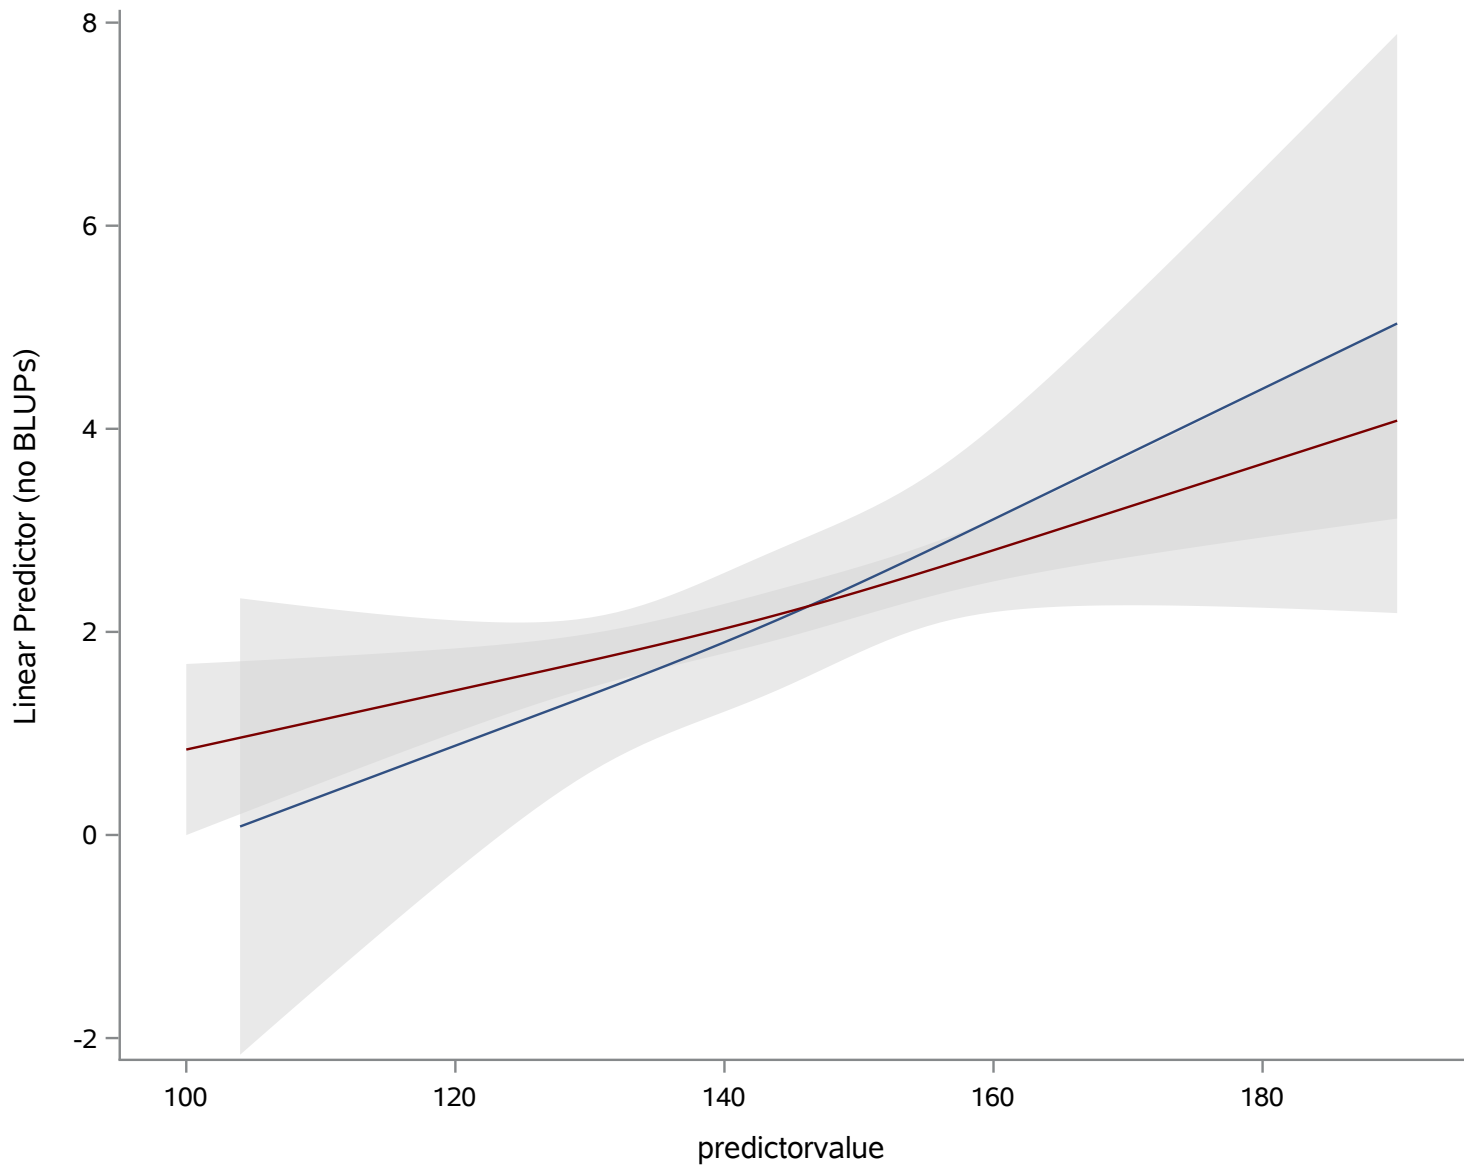
label=MCV predictor=meanstoragetime

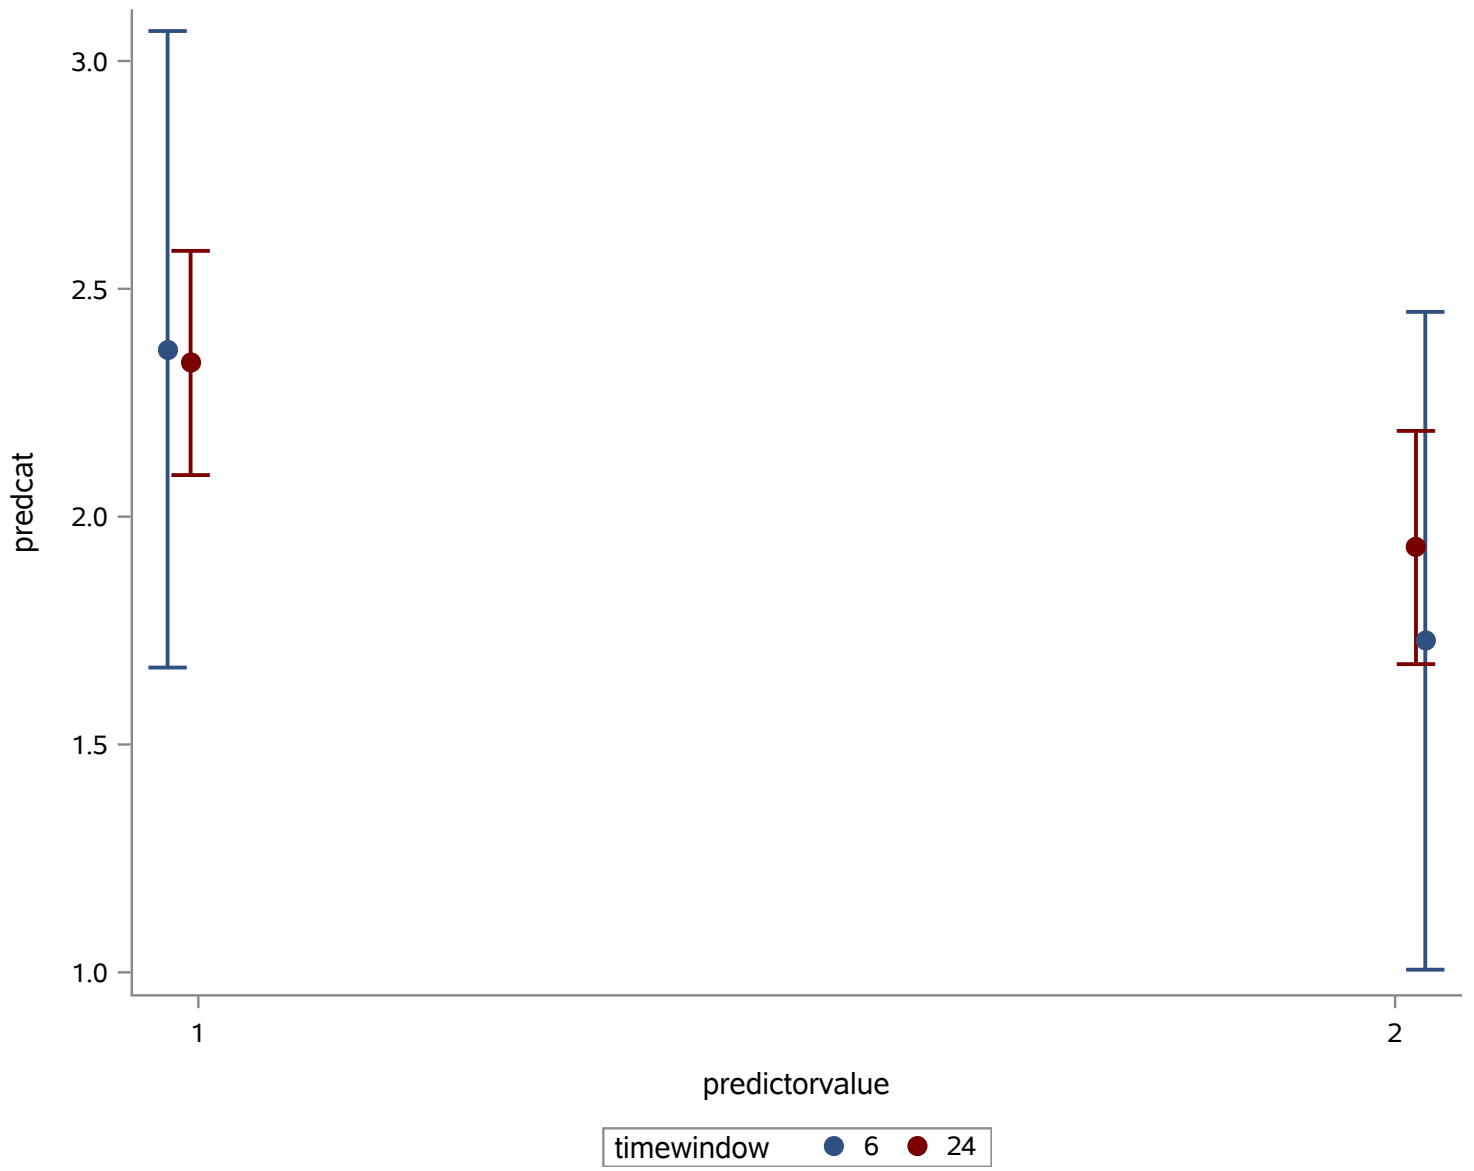**Significant also in 6h**

label=HB predictor=meandonorsex

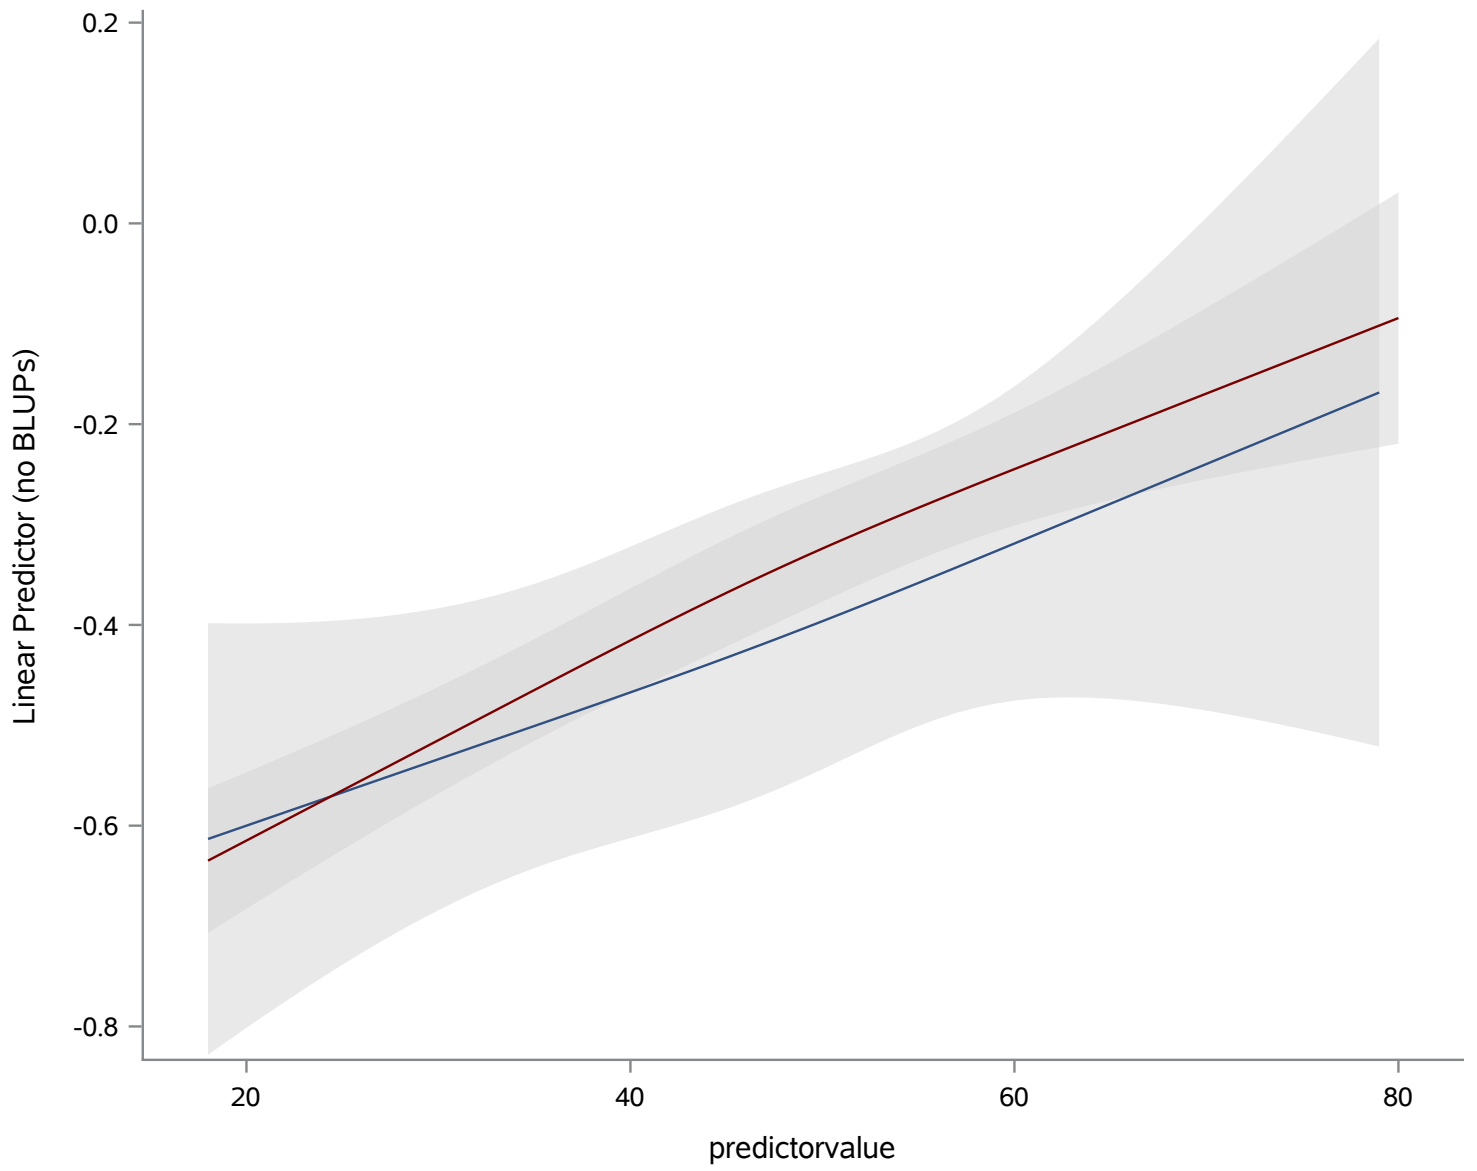**Significant also in 6h**

label=MCHC predictor=meandonorhb

Significant also in 6h
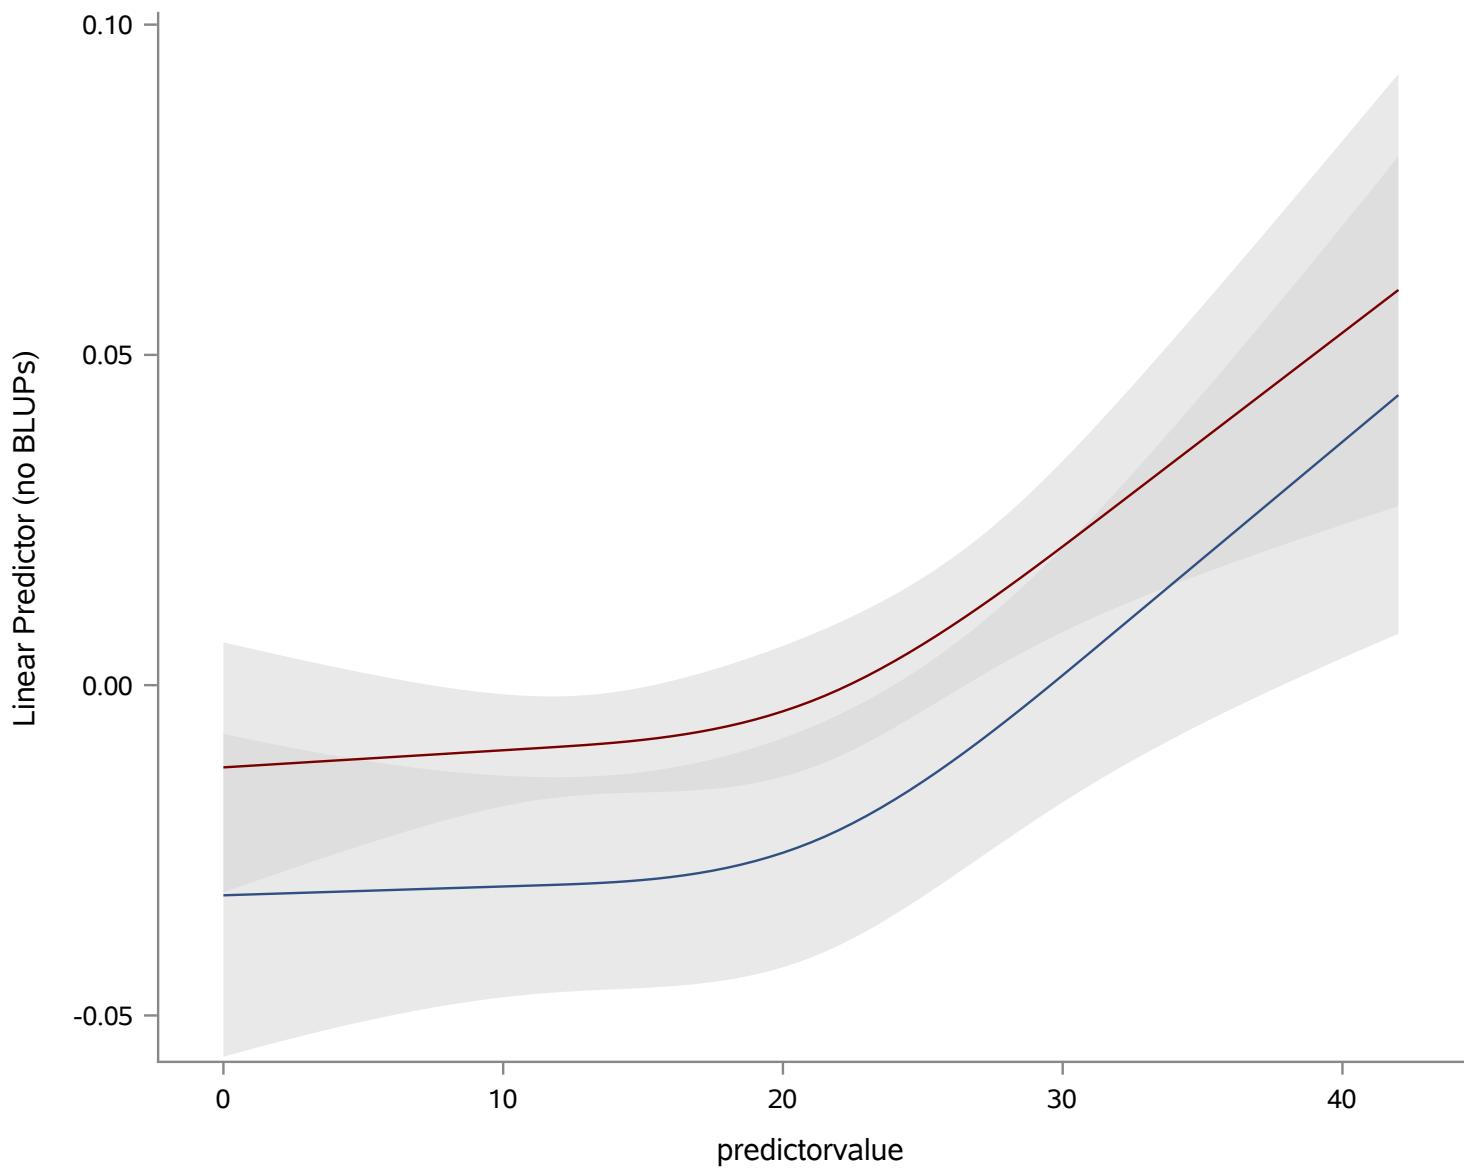
label=MCHC predictor=meandonorsex

Significant also in 6h
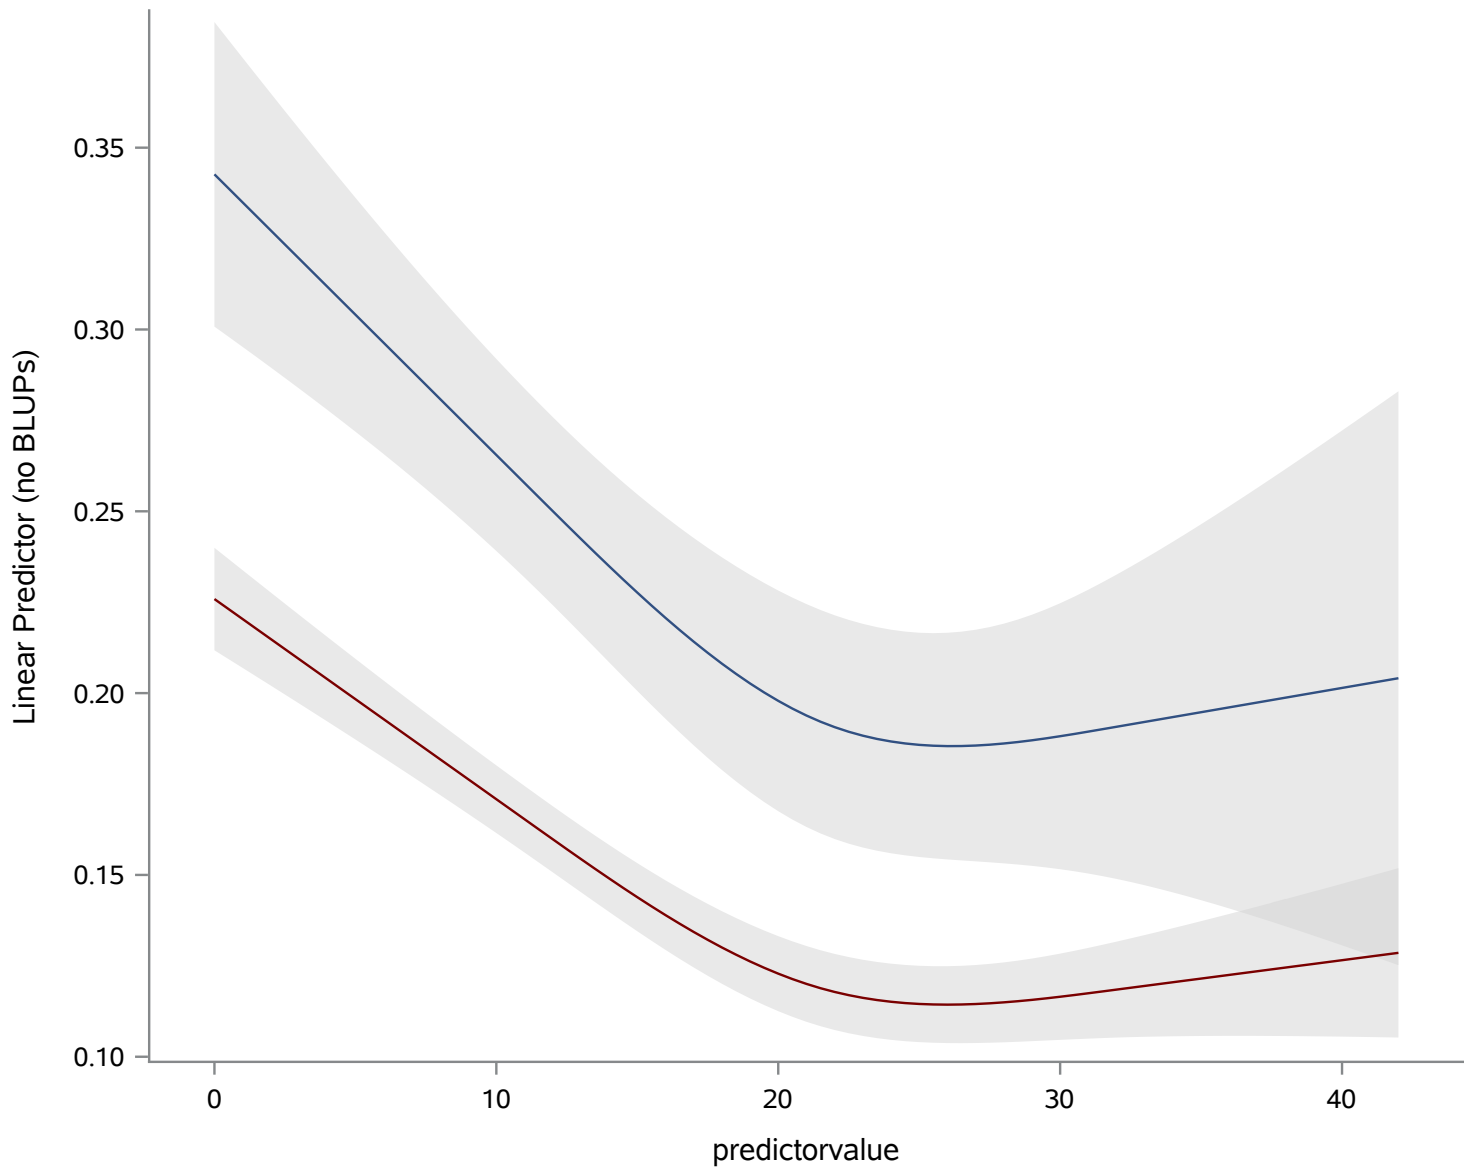
label=MCV predictor=meandonorage

Significant also in 6h
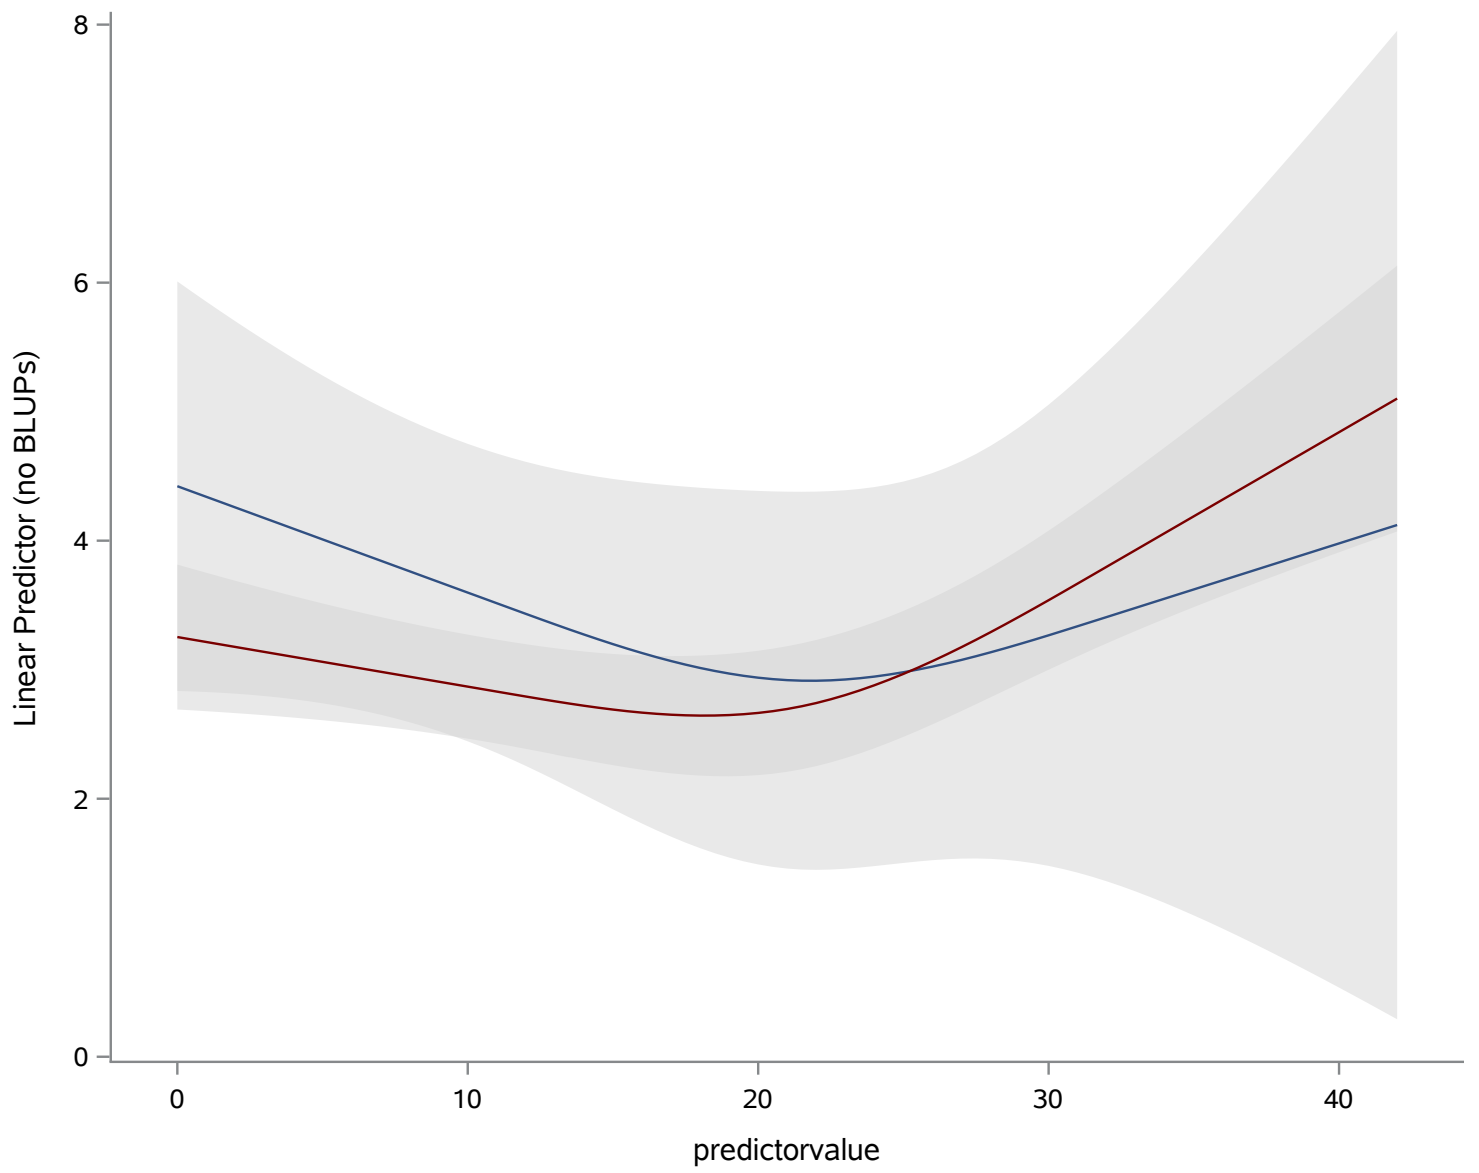
label=COHB predictor=meanstoragetime

Significant also in 6h
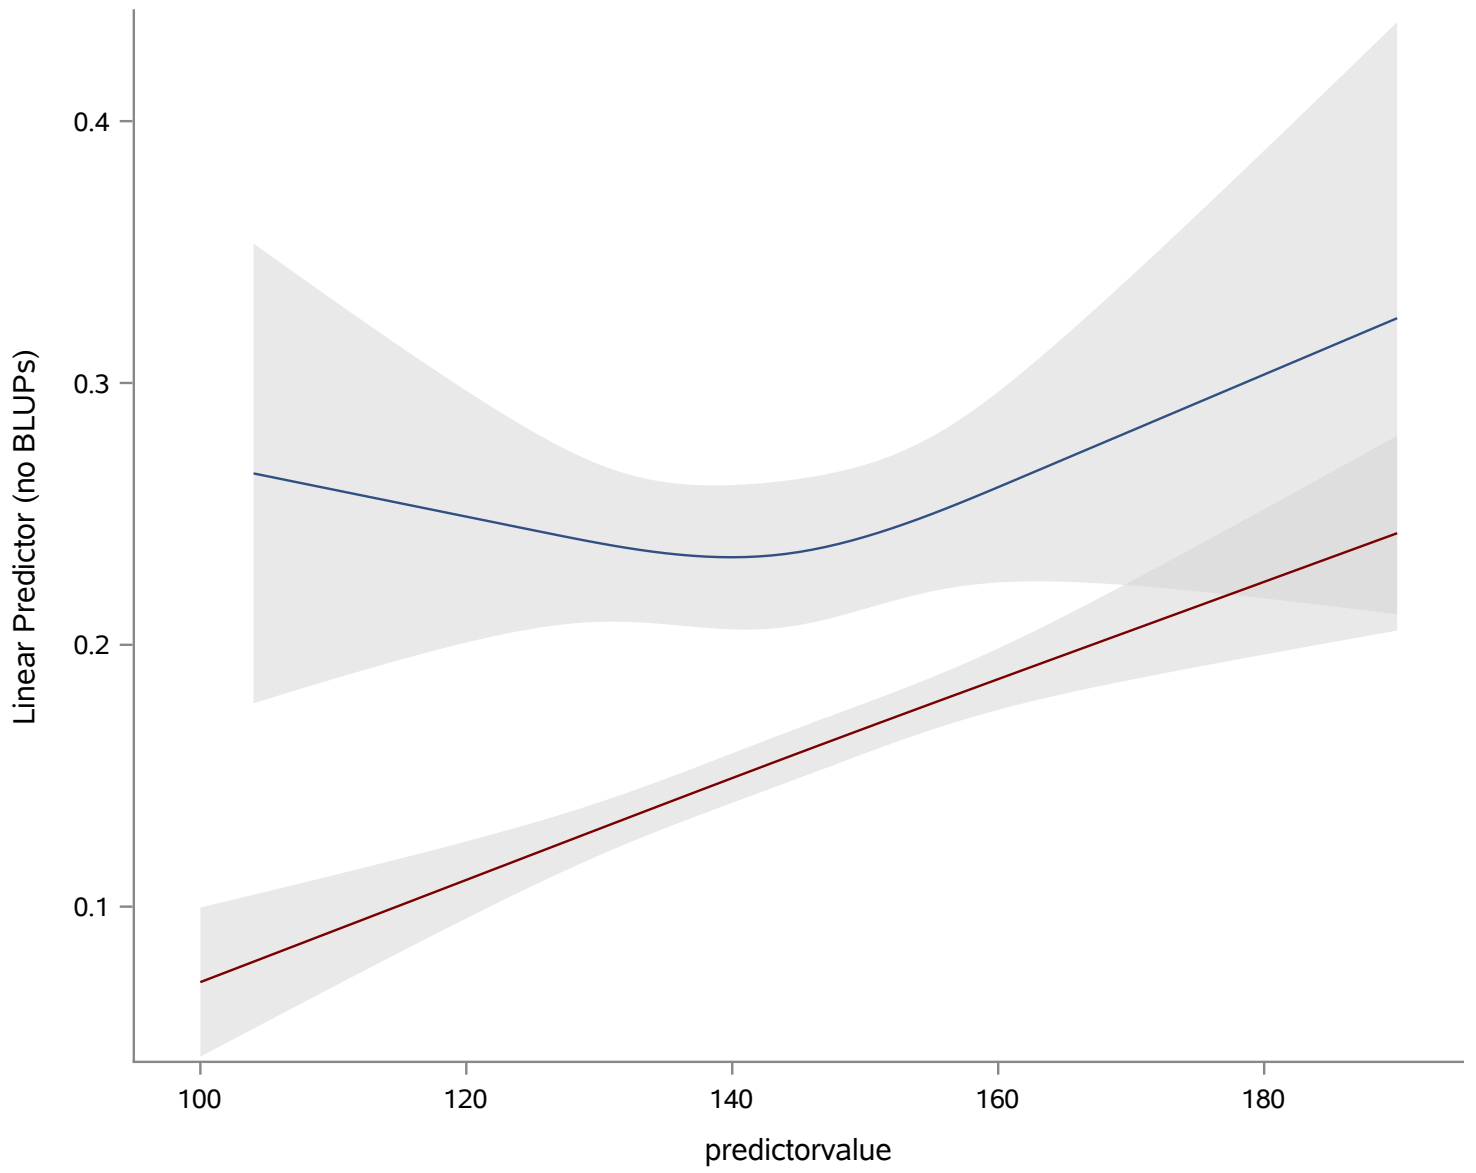
label=ERYTRO predictor=meanstoragetime

Not significant in 6h
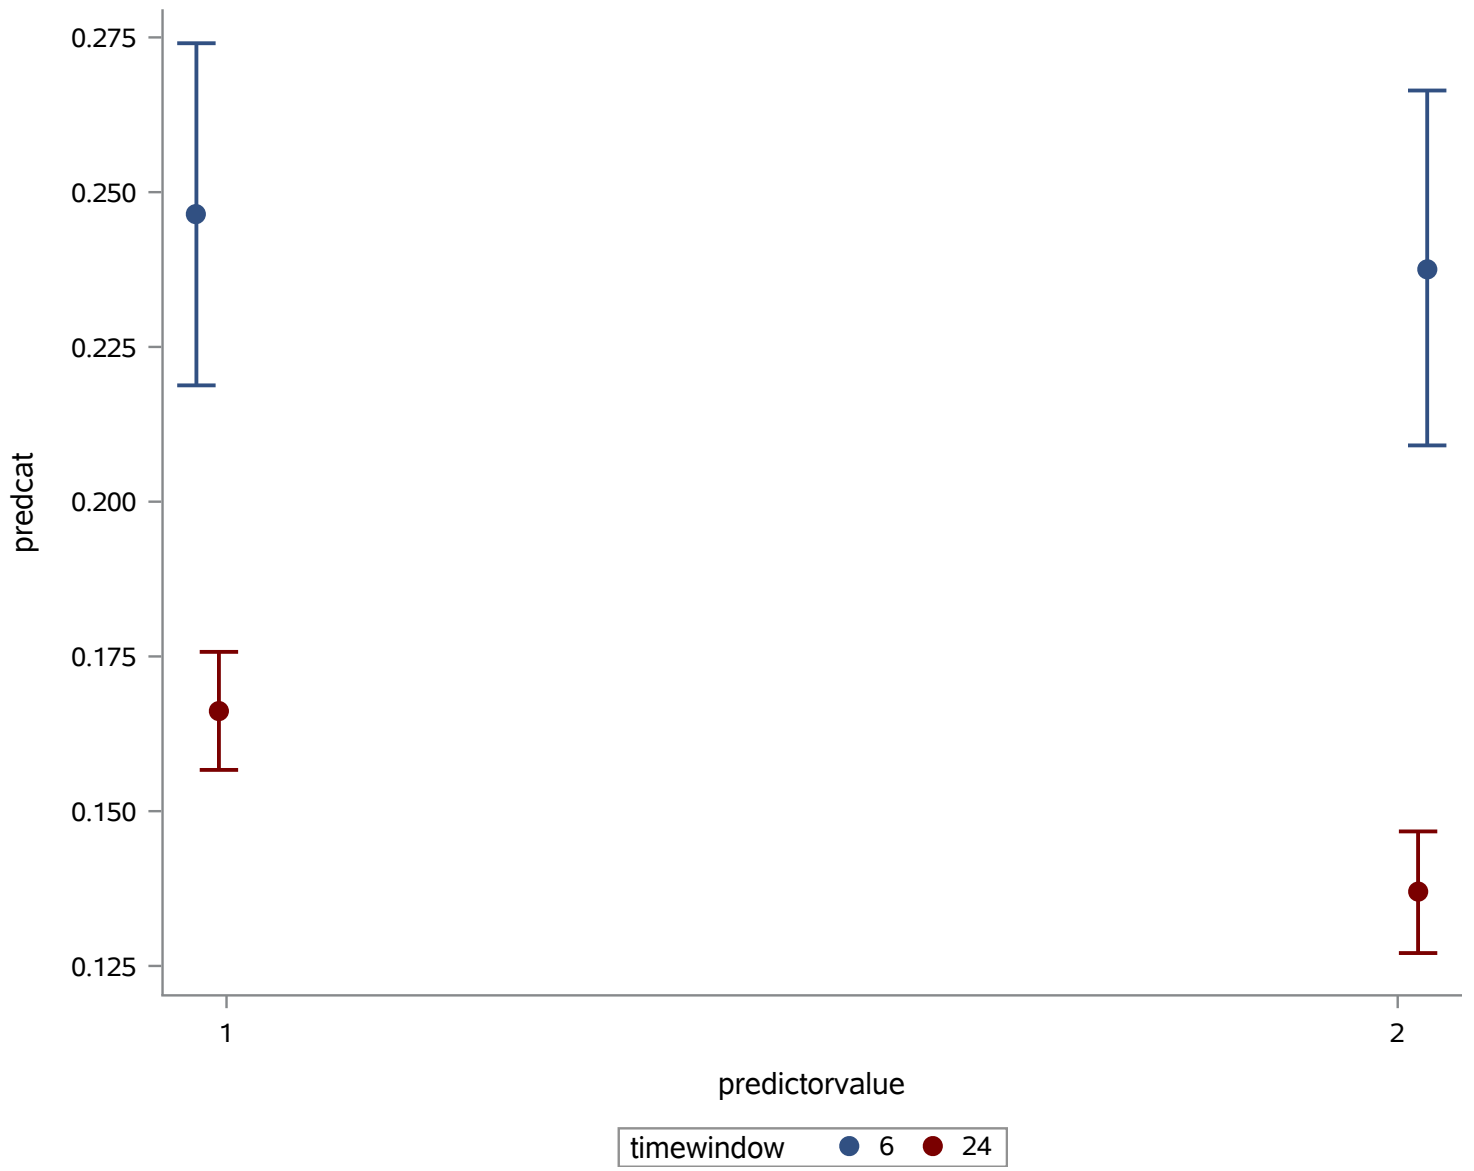
label=BILI predictor=meanstoragetime

Not significant in 6h
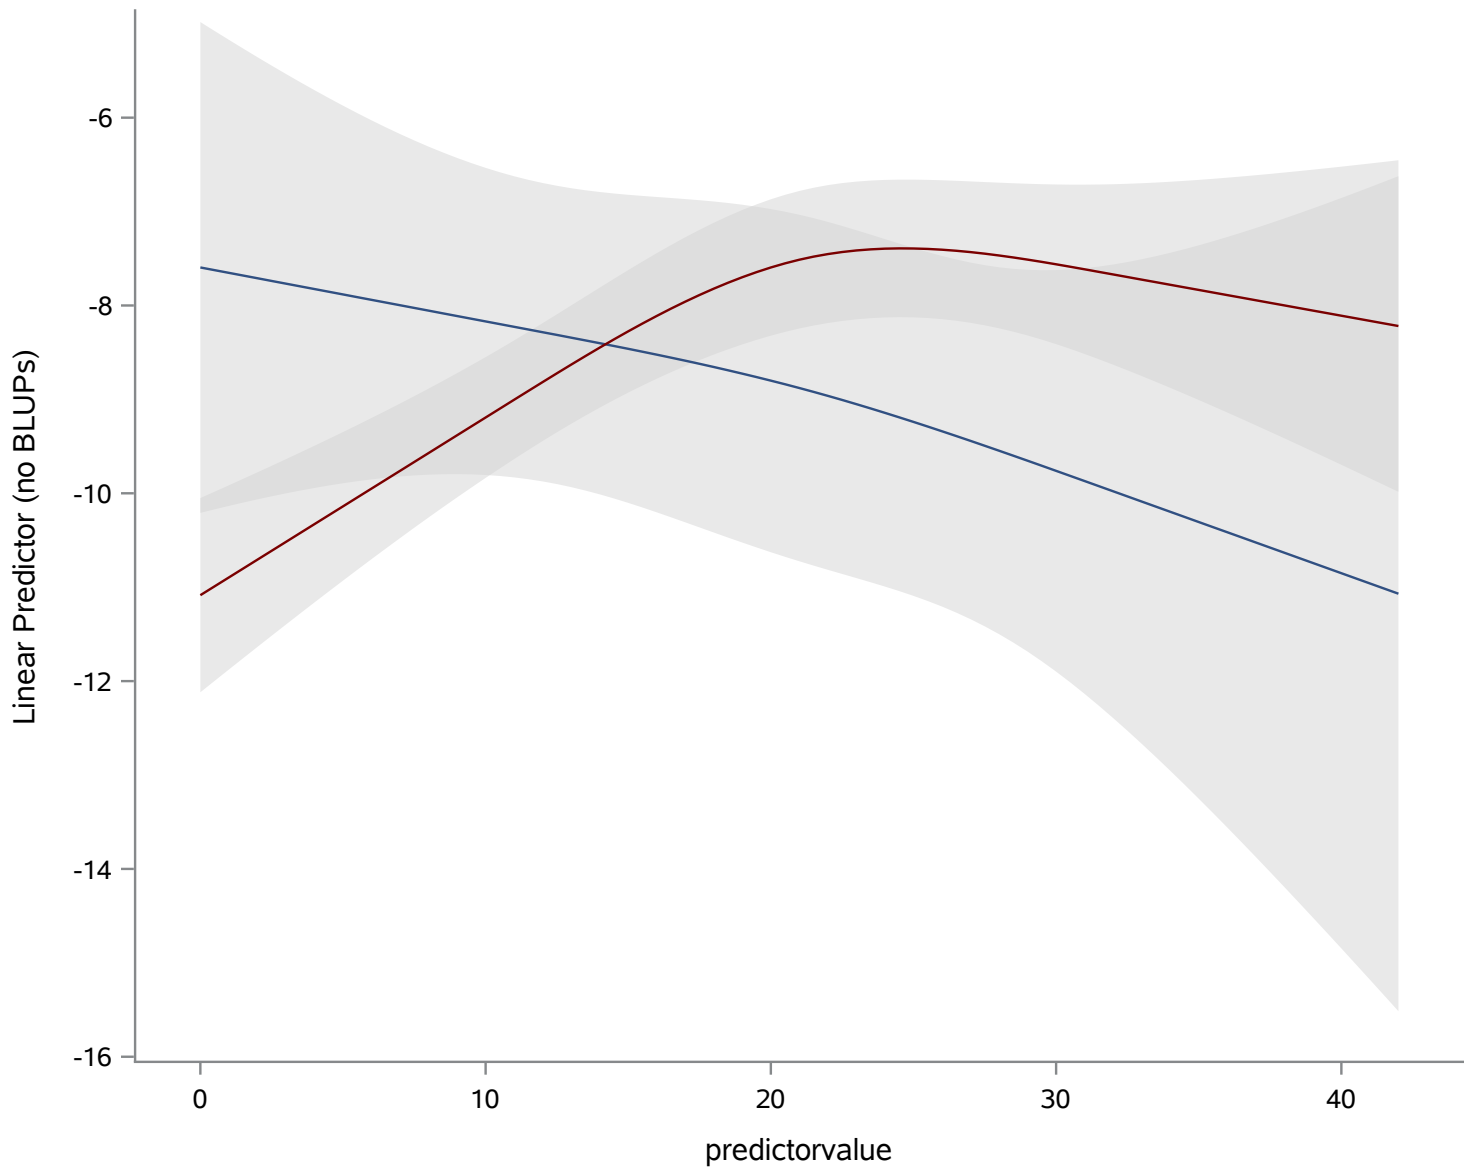
label=ERYTRO predictor=meandonorhb

Not significant in 6h
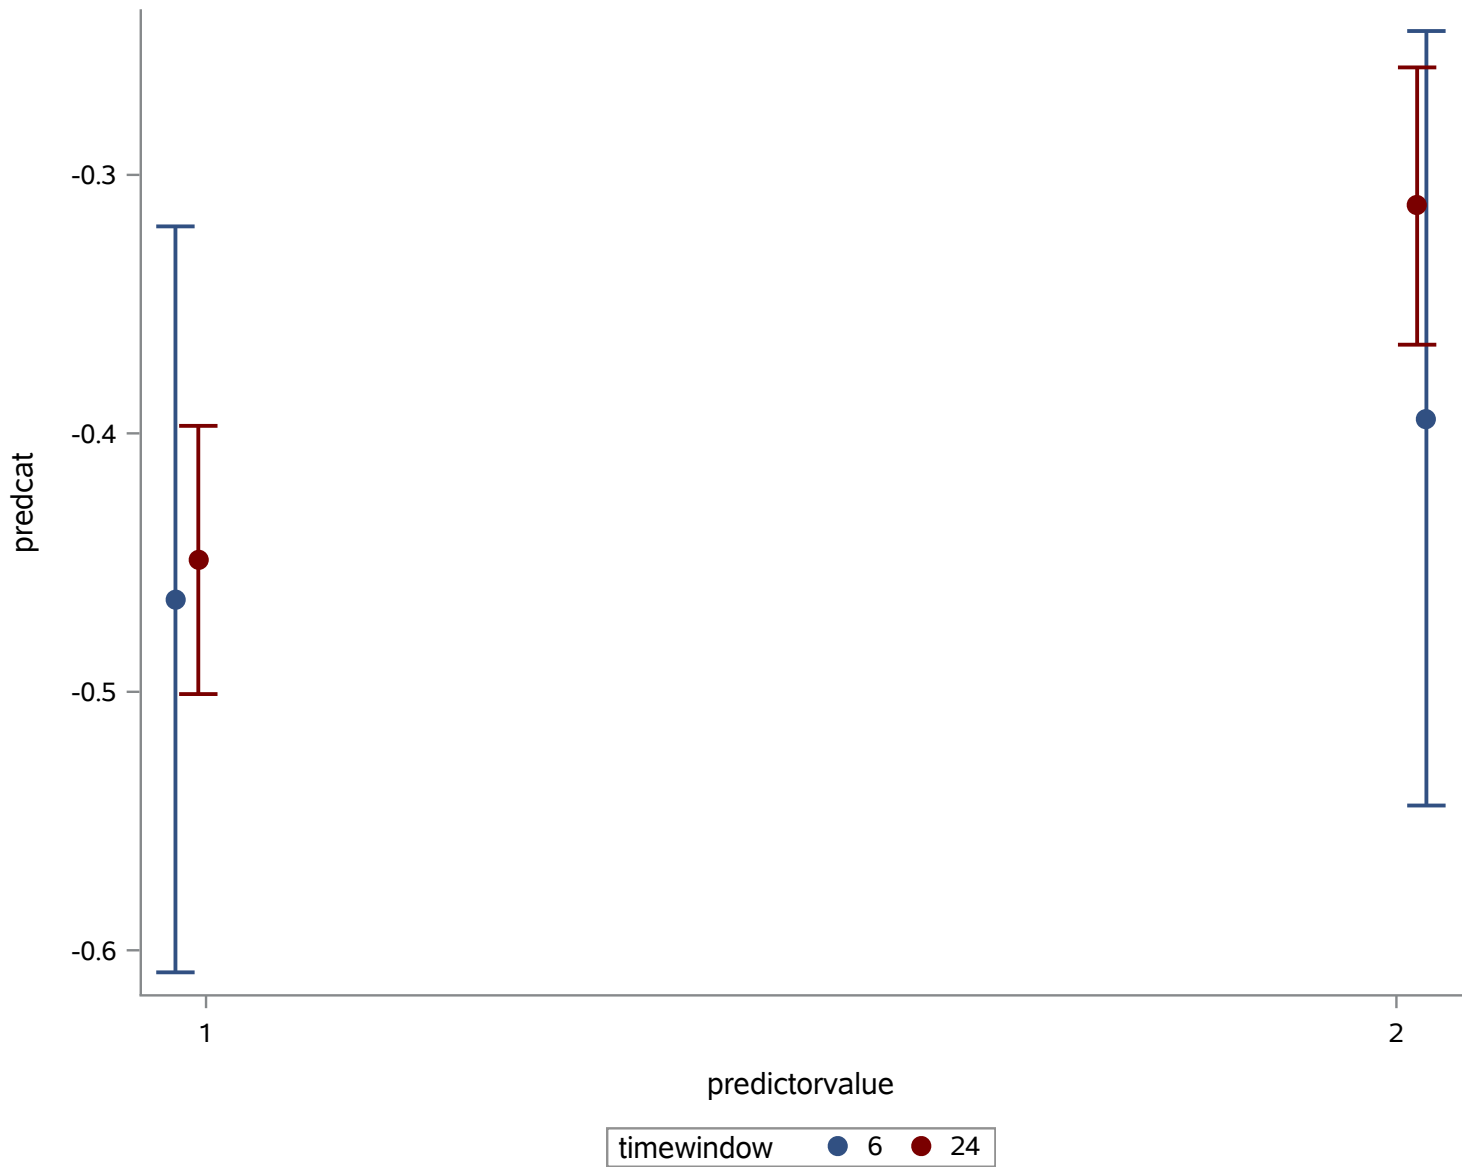
label=ERYTRO predictor=meandonorsex

Not significant in 6h
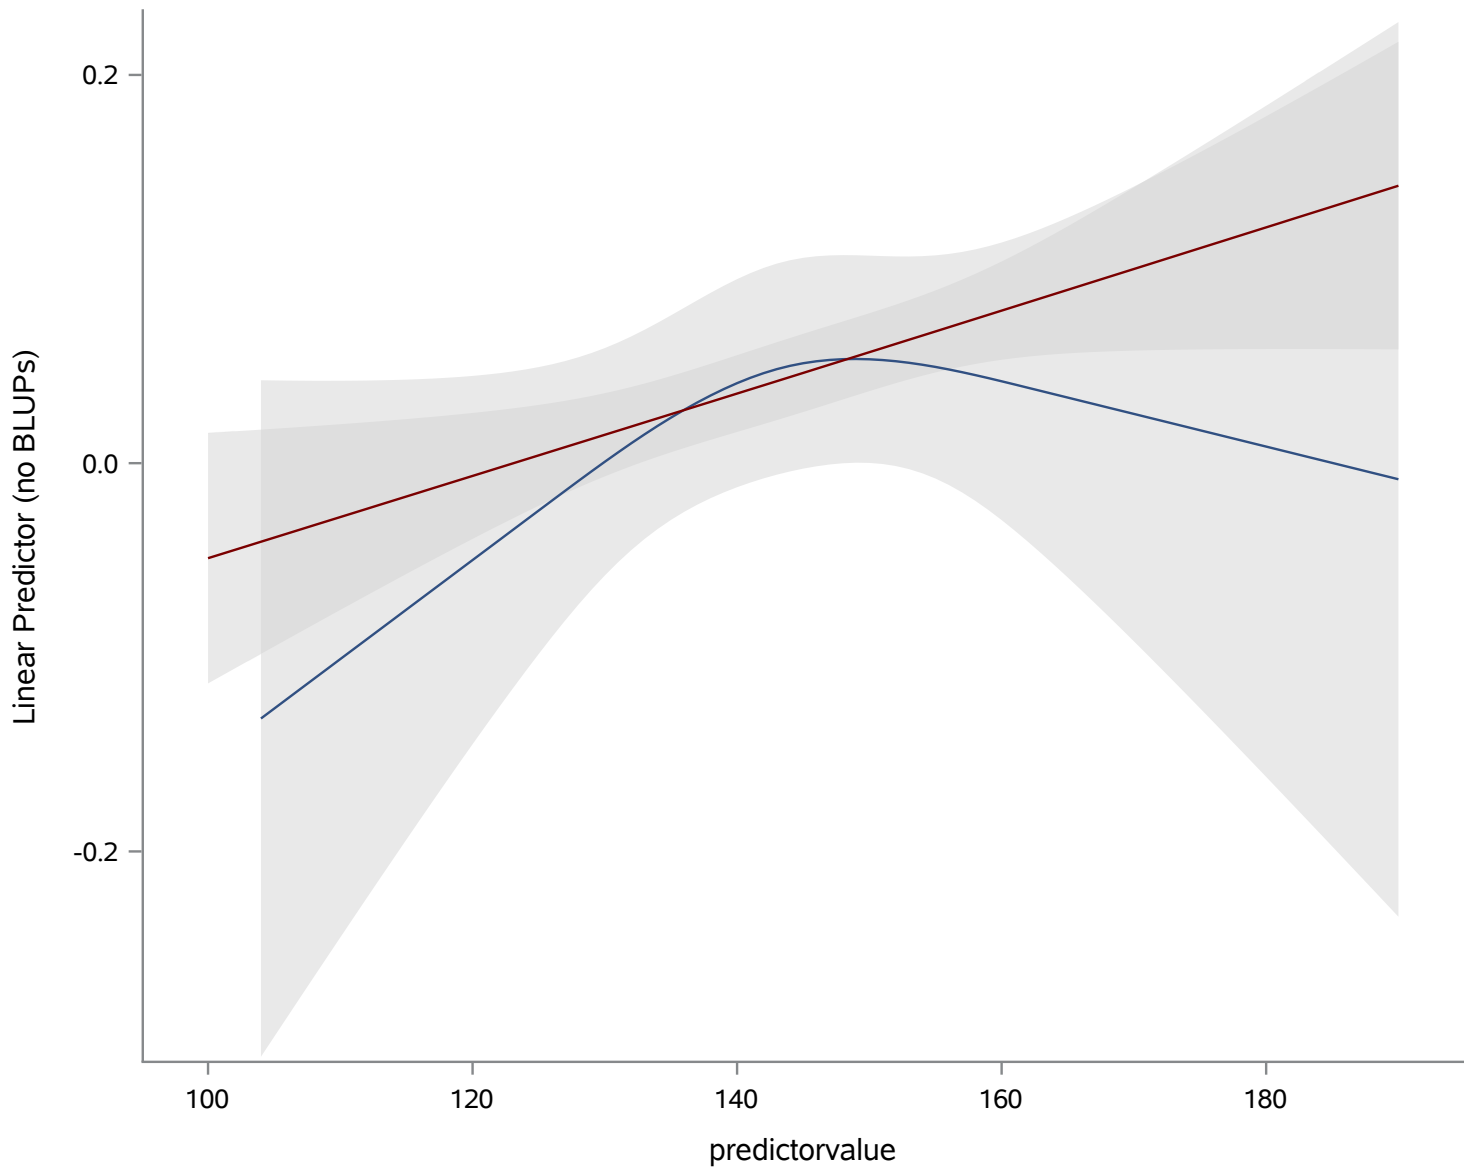
label=TPK predictor=meanstoragetime

Not significant in 6h
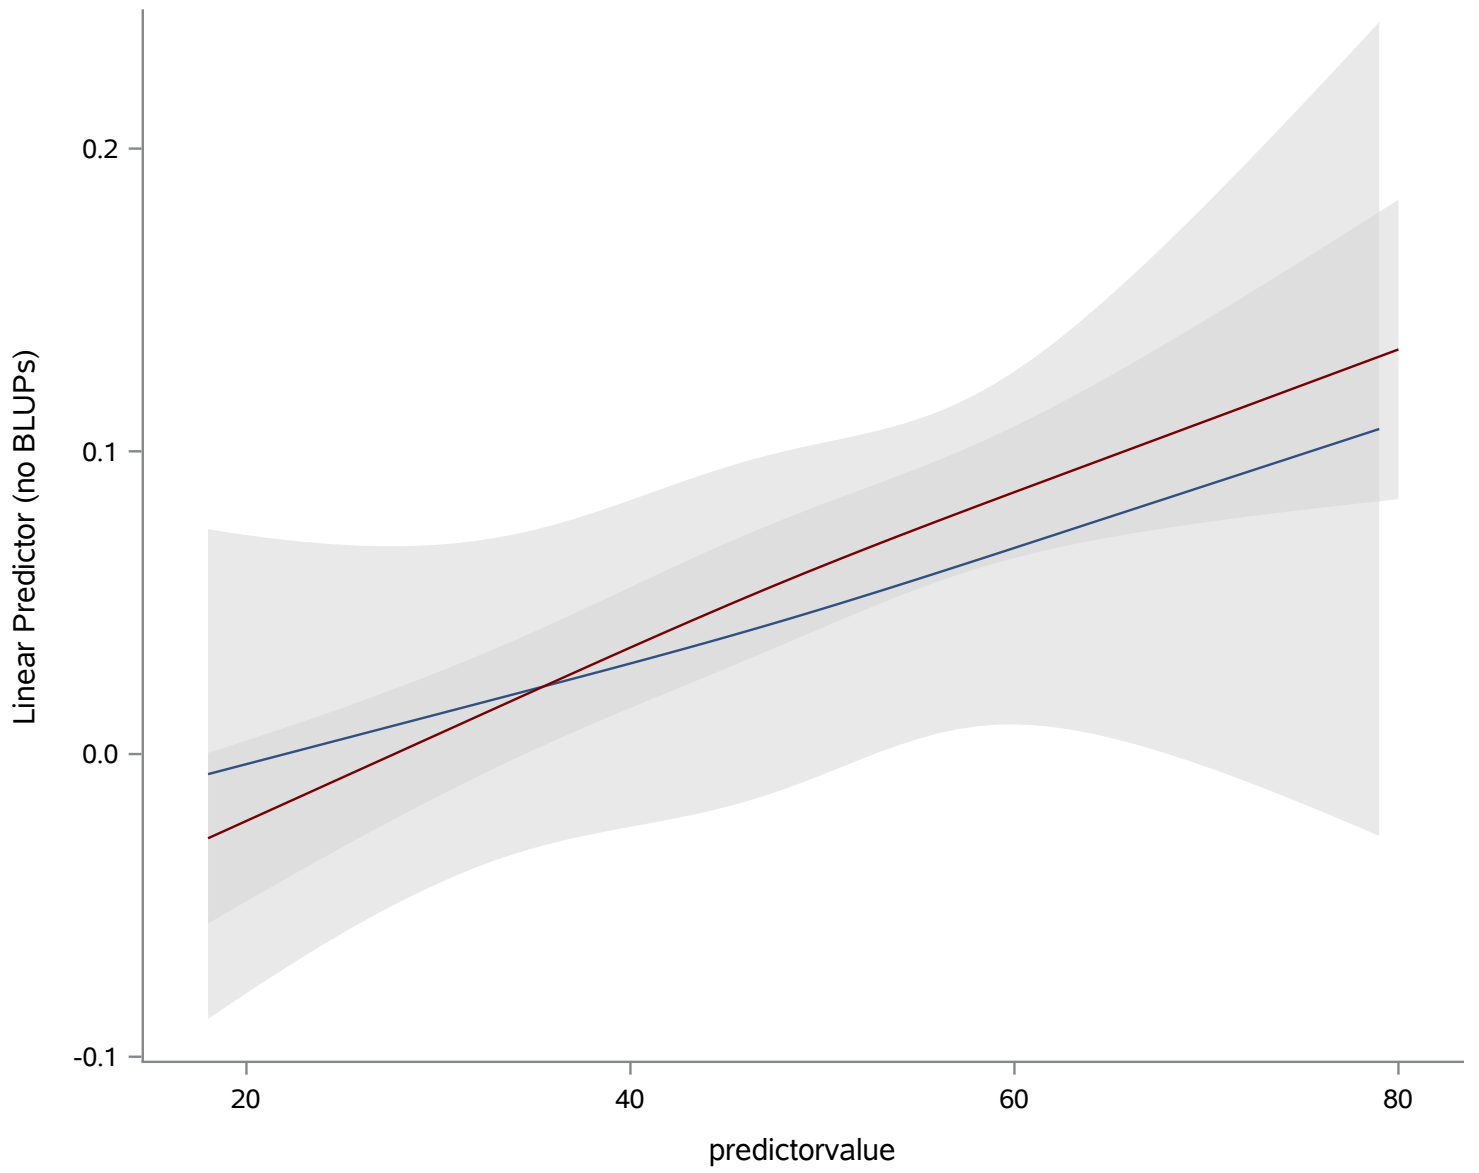
label=MCV predictor=meandonorsex

Not significant in 6h
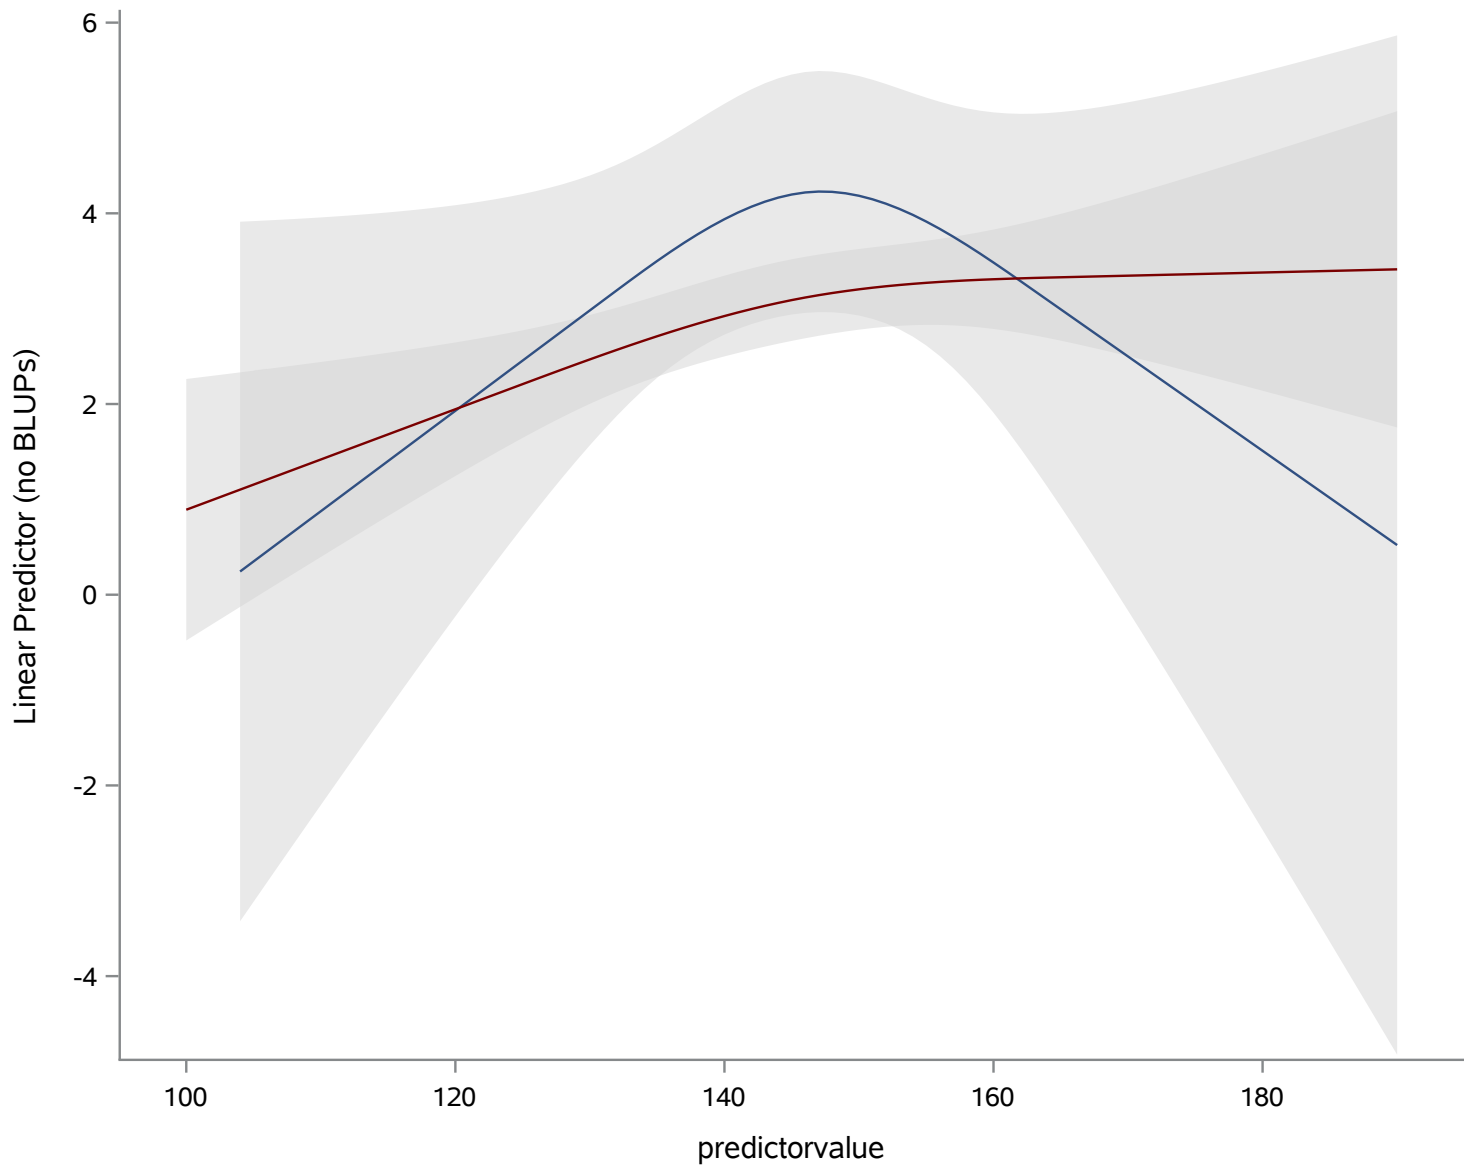
label=MCH predictor=meandonorhb

Not significant in 6h
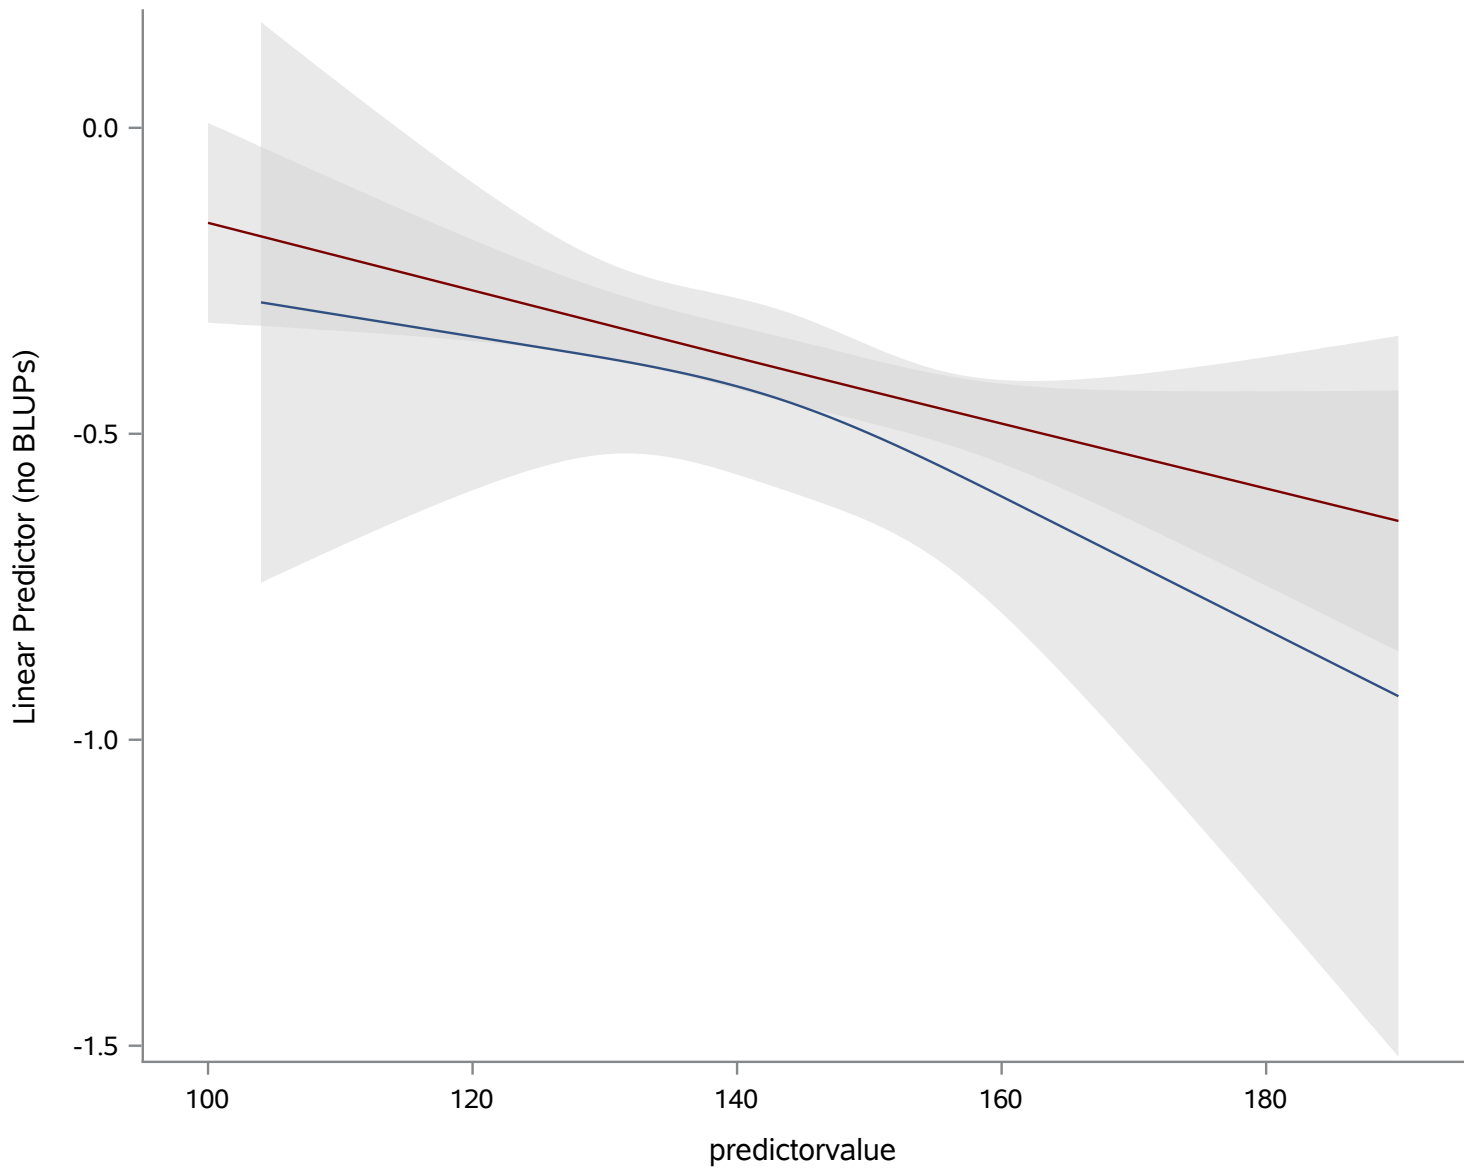
label=MCH predictor=meandonorage

Not significant in 6h
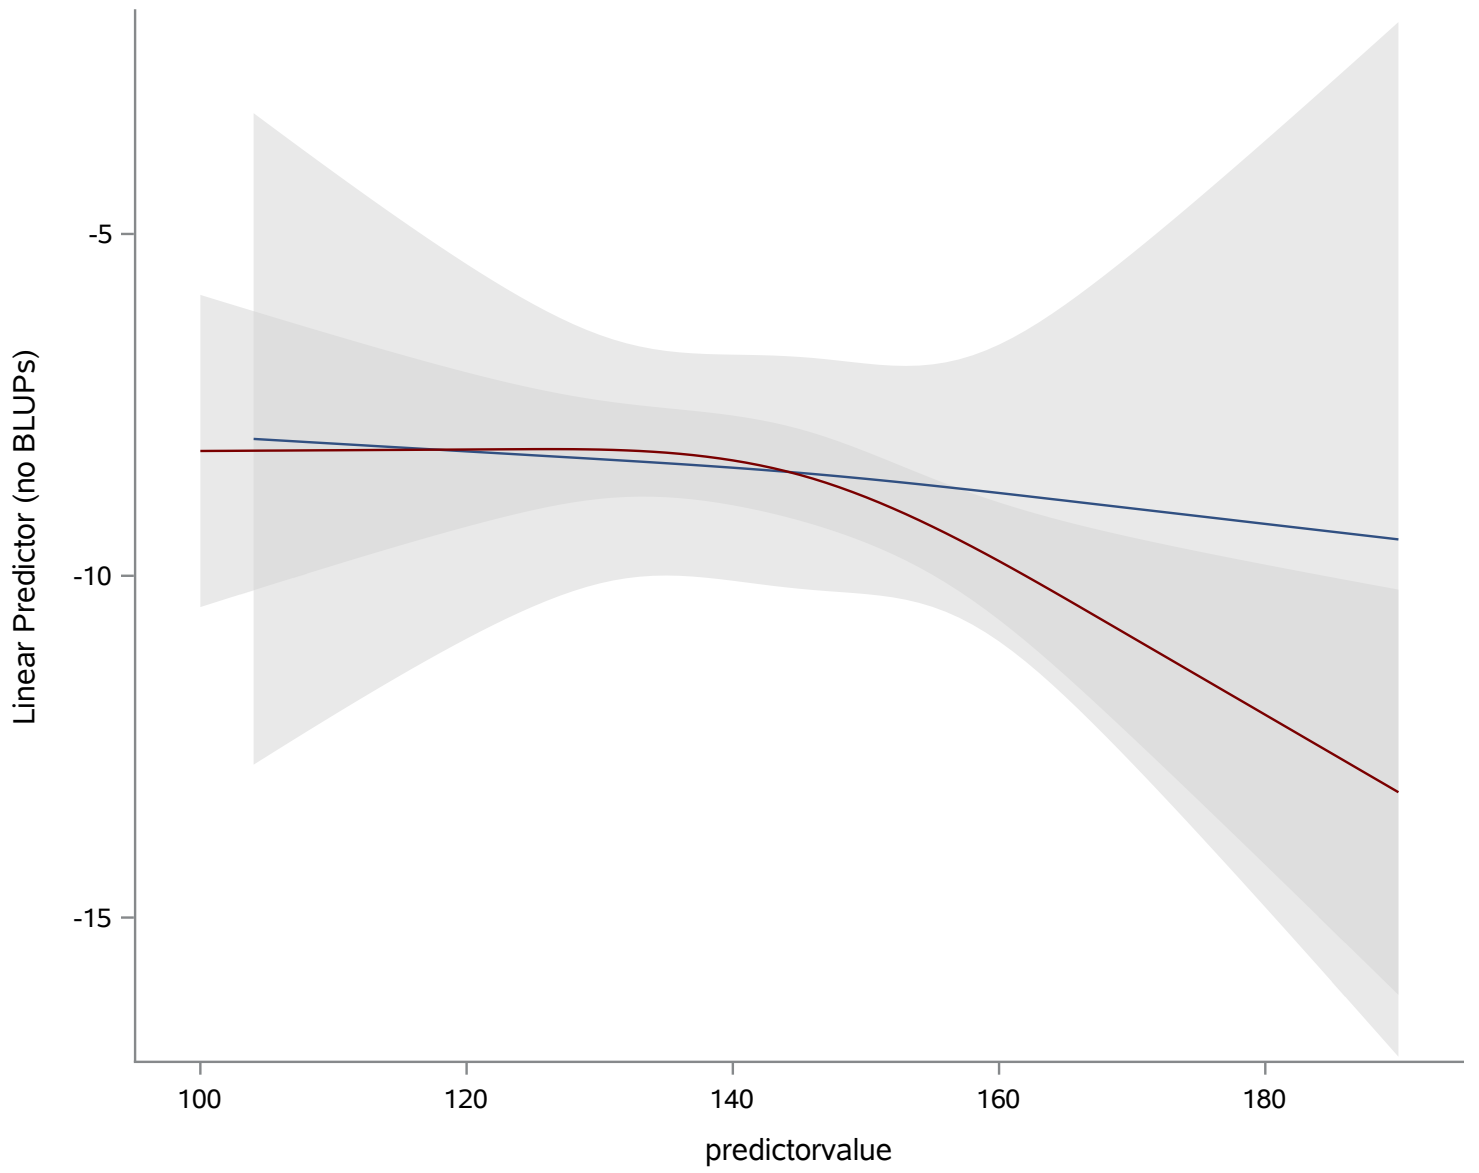
label=BILI predictor=meandonorhb

Not significant in 6h
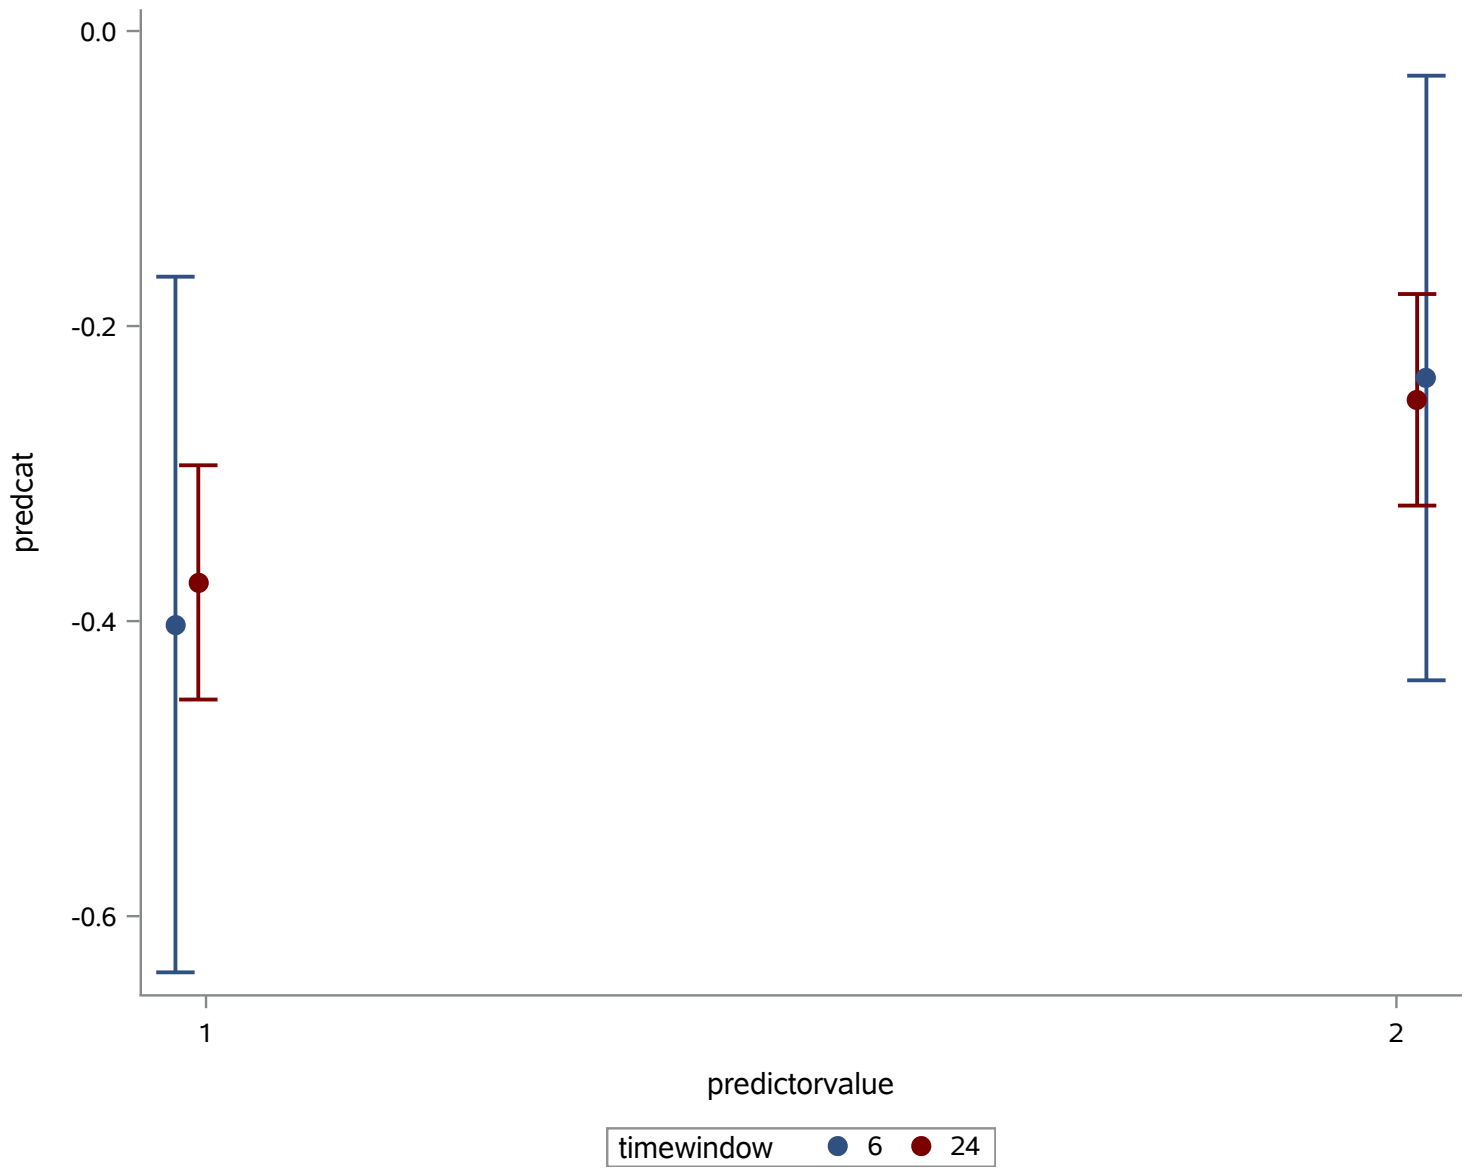
label=MCV predictor=meandonorhb

Not significant in 6h

label=TPK predictor=meandonorhb

Not significant in 6h

label=MCV predictor=donorparity

Not significant in 6h

label=KREA predictor=meanstoragetime