




Location of Main Power replacement with 80A breaker

#4

new wire (approx. 150ft each)  
total 450ft plus Ground

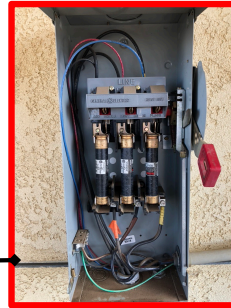

AC disconnect  
new one required with  
70A Fuse

#6

new wire (approx. 50ft each)  
Existing conduit is 3/4 in



New AC unit

#4



Condenser disconnect  
Reuse of old panel 15A fuse

#12

Connection to  
condenser



New condenser unit