



4 in conduit
from ATS



empty 3 in
conduit UPS
shed

need to connect the 4 in conduit from
the ATS to the 3 in conduit going into
the UPS shed



3 in conduit
from UPS shed
to PDP2




3 in conduit
from UPS shed
to PDP2

need to remove the box here and
replace with a bend. This conduit will
be used to supply the PDP2 from the
UPS



Need to replace these two conduits with ones that have fittings and are not just stuck in the panel and sealed up with silicone

They go to the cable vault next to the fence and have all cable going to the different buildings and equipment on the observatory

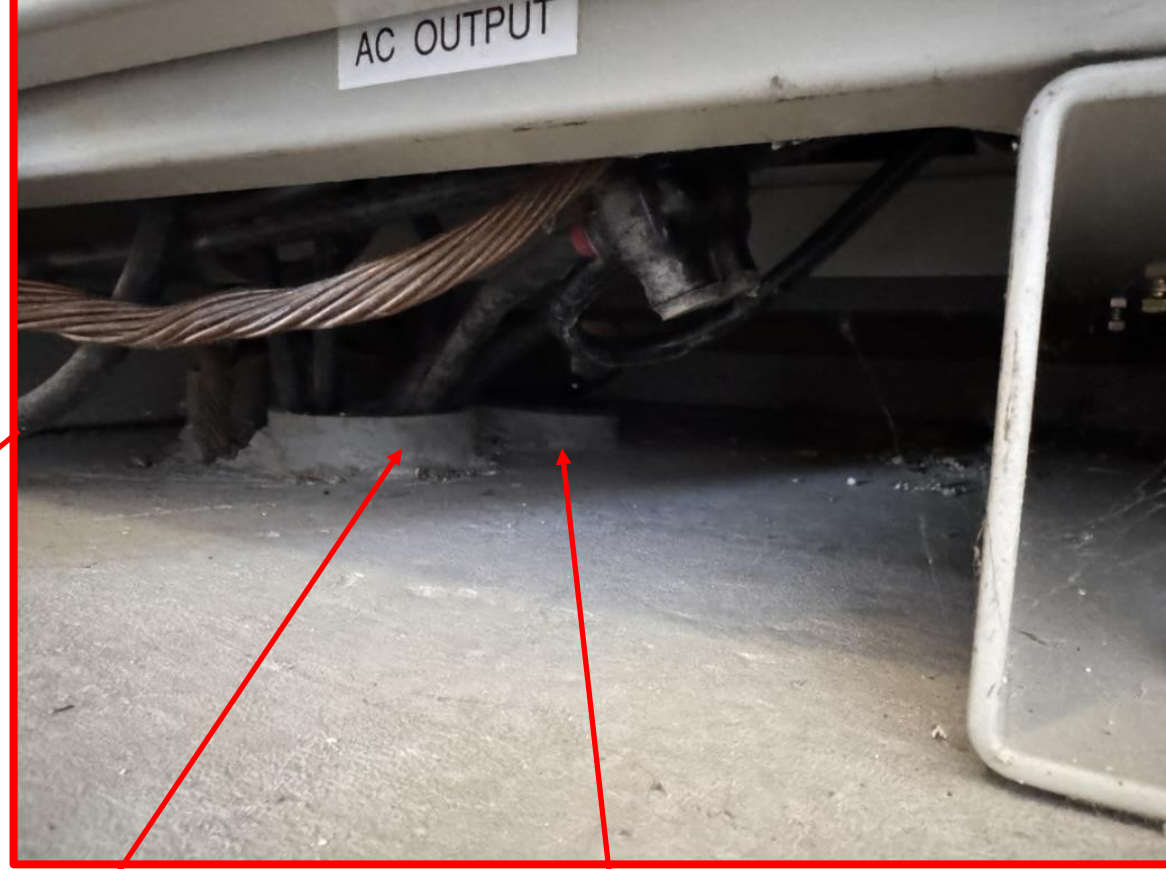

3 in conduit
going to PDP2

empty 3 in conduit that
needs to be connected to
the 4 in one going to the
transfer switch



Need to replace these two conduits with ones that have fittings and are not just stuck in the panel and sealed up with silicone

3 in conduit from UPS shed to PDP2