

AI

AI

: 2025-09-03 10:10:39

: AI-System

: DeeFacto AI Service

Cleanroom Environment Regular Report

Zone: b

Period: 2025-08-27 9:50:00 ~ 2025-08-27 9:53:00

Shift: Morning

1. Sensor Type 12-Hour Graphs


electrostatic

Average: 54.6V

Maximum: 80.0V

Minimum: 30.5V

Graph

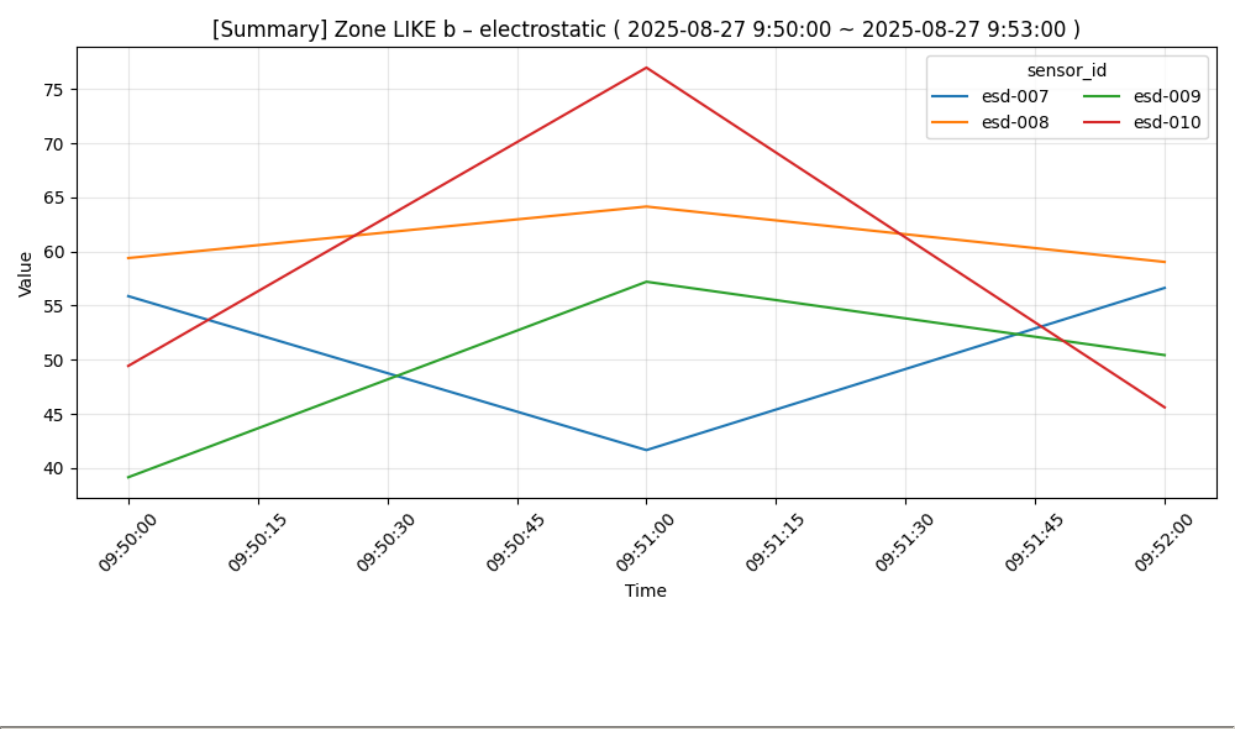


humidity

Average: 45.2%RH

Maximum: 49.9%RH

Minimum: 40.0%RH

Graph

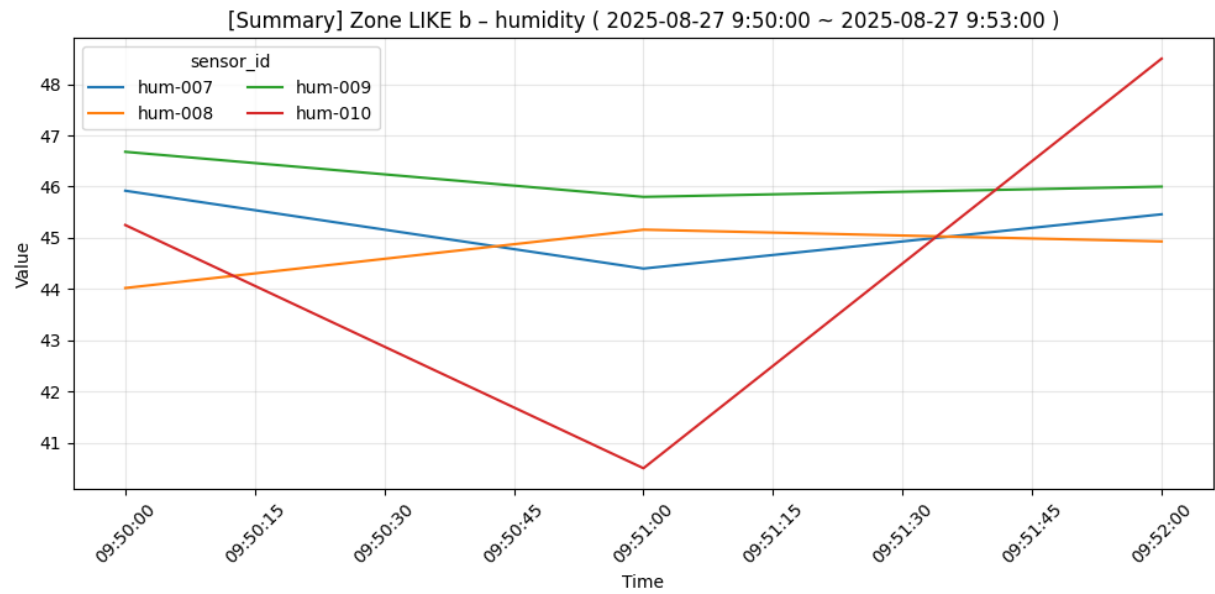


particle_0_1um

Average: 934.4PPM

Maximum: 999.6PPM

Minimum: 850.1PPM

Graph

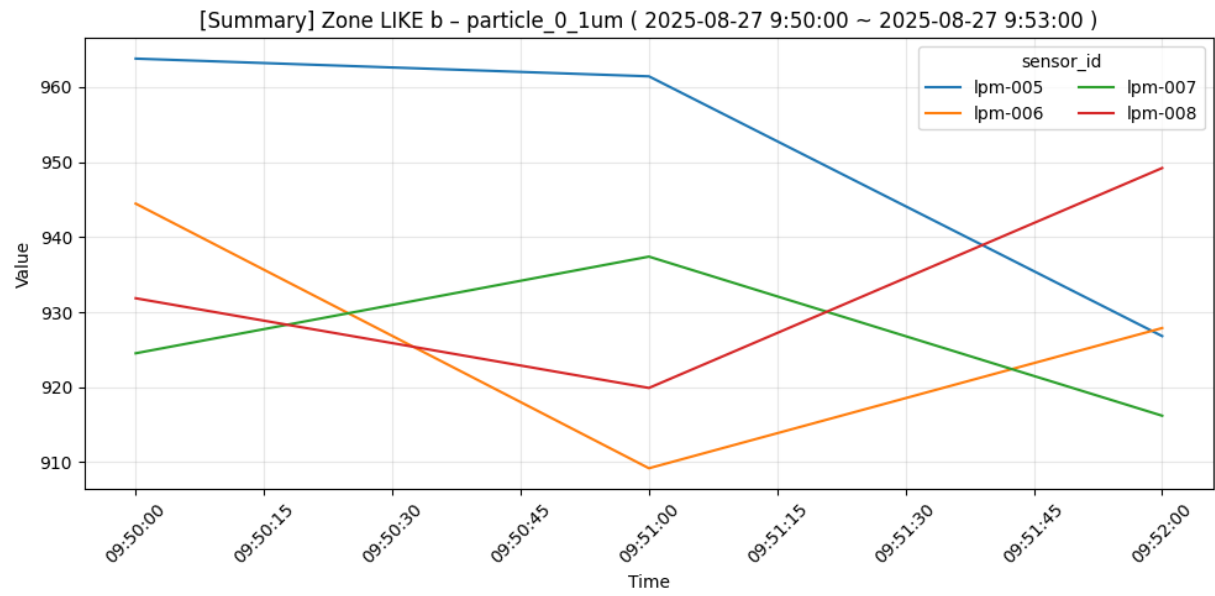


particle_0_3um

Average: 90.2PPM

Maximum: 101.9PPM

Minimum: 82.0PPM

Graph

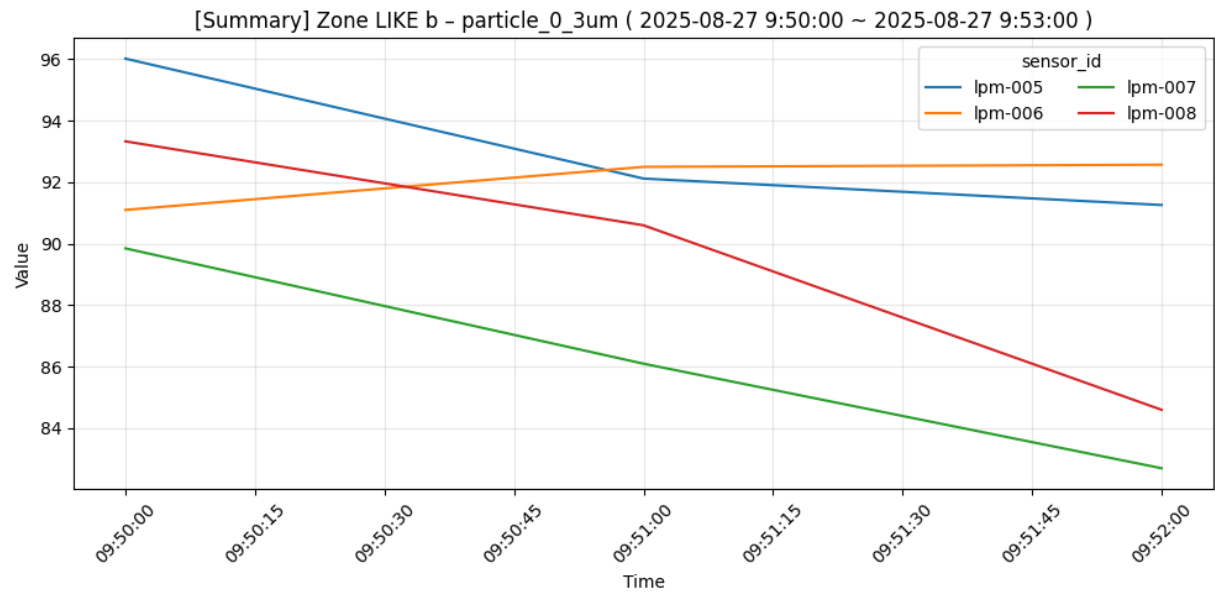


particle_0_5um

Average: 28.4PPM

Maximum: 35.0PPM

Minimum: 20.1PPM

Graph

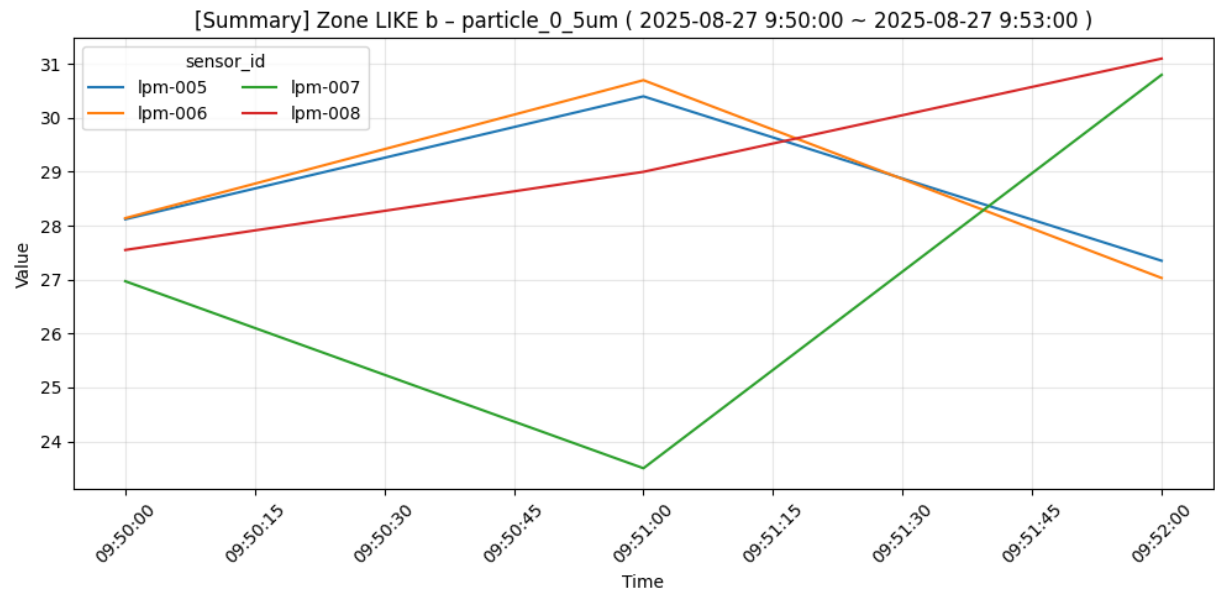


temperature

Average: 21.5°C

Maximum: 25.0°C

Minimum: 20.0°C

Graph

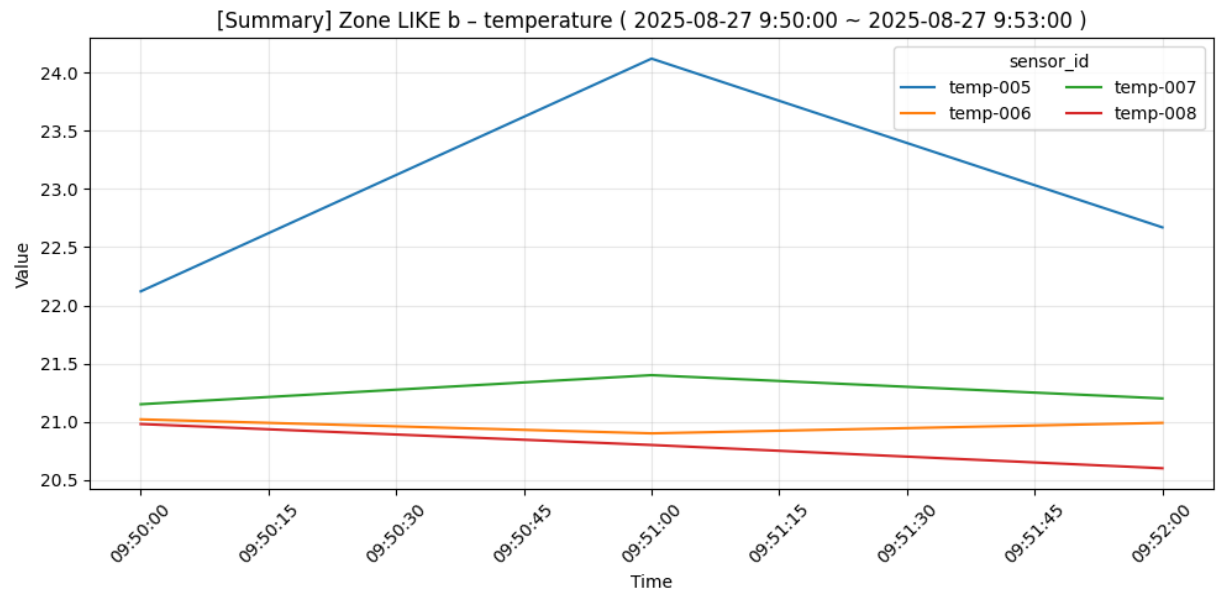


winddirection

Average: -2.8deg

Maximum: 14.0deg

Minimum: -13.9deg

Graph

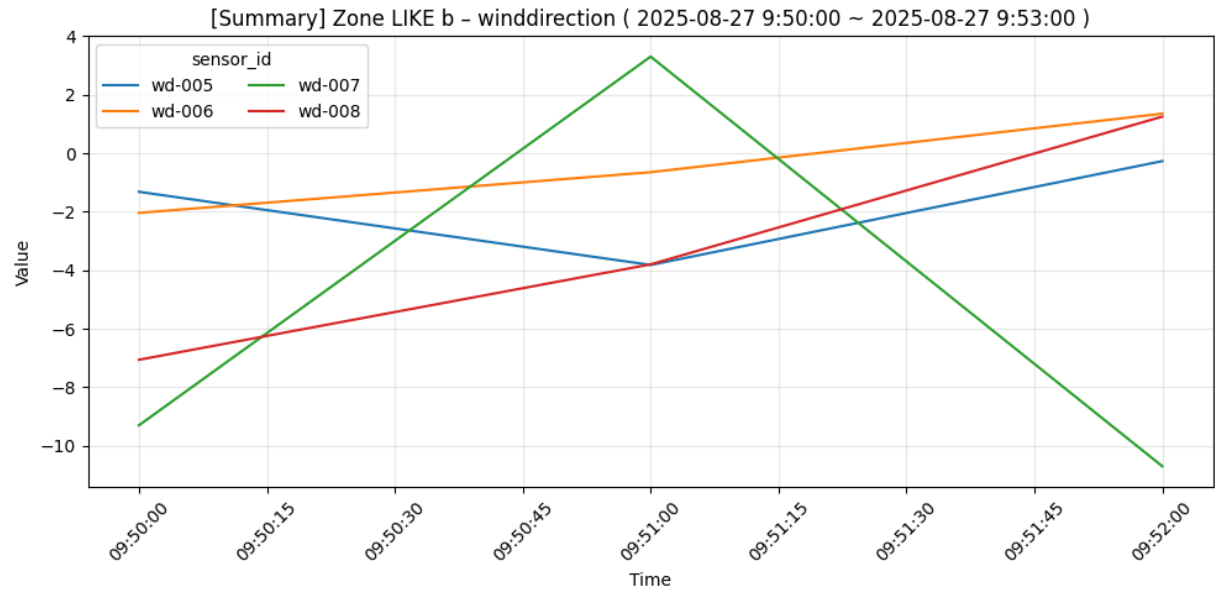

2. Threshold Exceeding Issues


Issue 1 - temperature Exceeded

Occurrence Time: 2025-08-27 09:50:26

Sensor ID: TEMP-005

Measured Value: 24.9°C

Graph

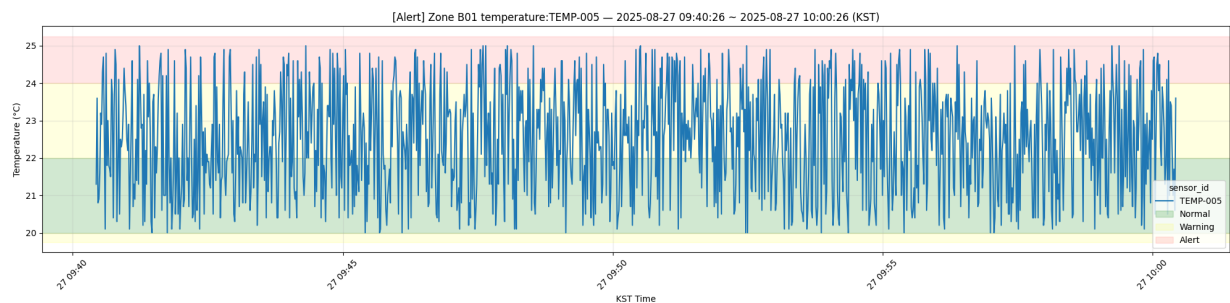


Issue 2 - temperature Exceeded

Occurrence Time: 2025-08-27 09:50:31

Sensor ID: TEMP-005

Measured Value: 25.0°C

Graph

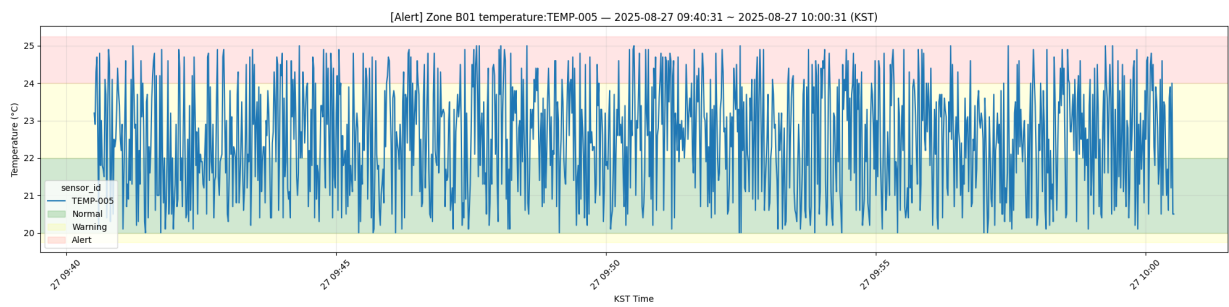


Issue 3 - temperature Exceeded

Occurrence Time: 2025-08-27 09:50:47

Sensor ID: TEMP-005

Measured Value: 24.9°C

Graph

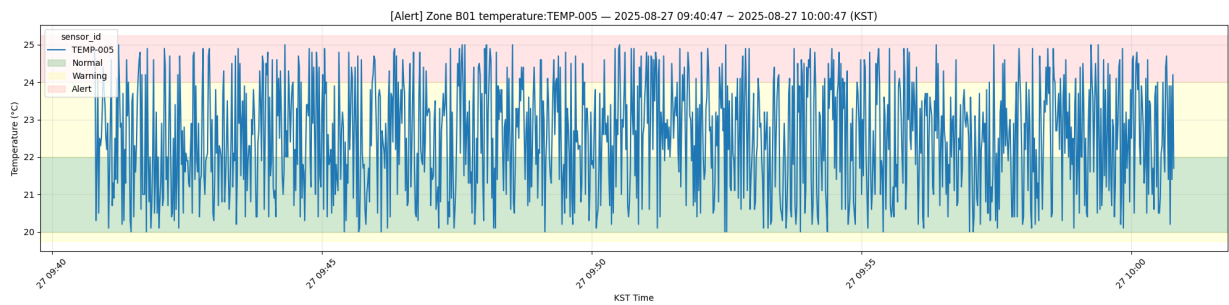


Issue 4 - temperature Exceeded

Occurrence Time: 2025-08-27 09:51:38

Sensor ID: TEMP-005

Measured Value: 24.9°C

Graph

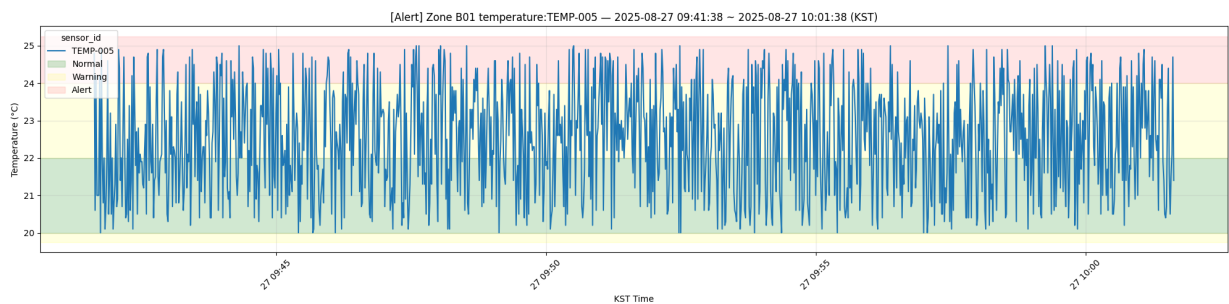


Issue 5 - temperature Exceeded

Occurrence Time: 2025-08-27 09:52:09

Sensor ID: TEMP-005

Measured Value: 24.9°C

Graph

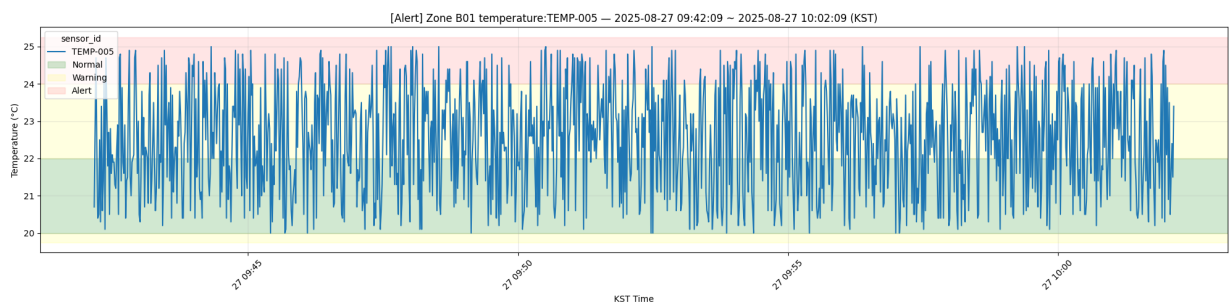


Issue 6 - temperature Exceeded

Occurrence Time: 2025-08-27 09:52:29

Sensor ID: TEMP-005

Measured Value: 25.0°C

Graph

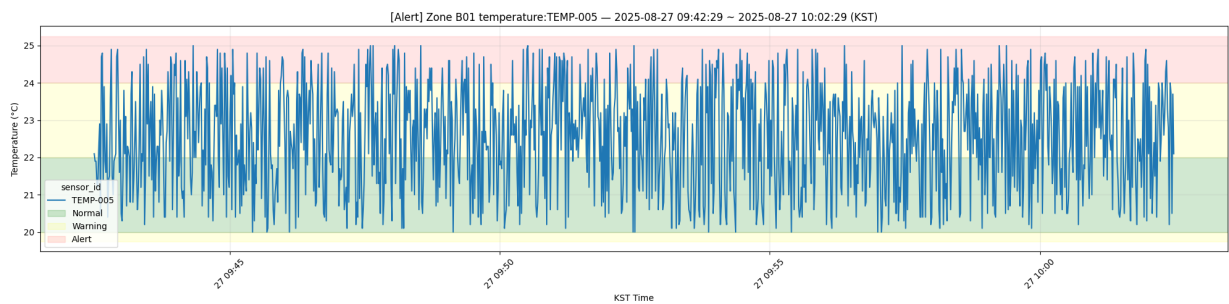


Issue 7 - temperature Exceeded

Occurrence Time: 2025-08-27 09:52:51

Sensor ID: TEMP-005

Measured Value: 24.9°C


Graph

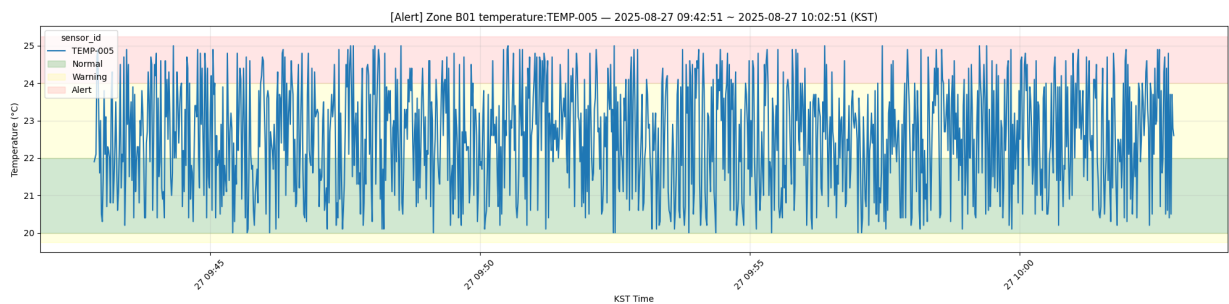

Issue 8 - temperature Exceeded

Occurrence Time: 2025-08-27 09:52:55

Sensor ID: TEMP-005
Measured Value: 24.9°C
Graph

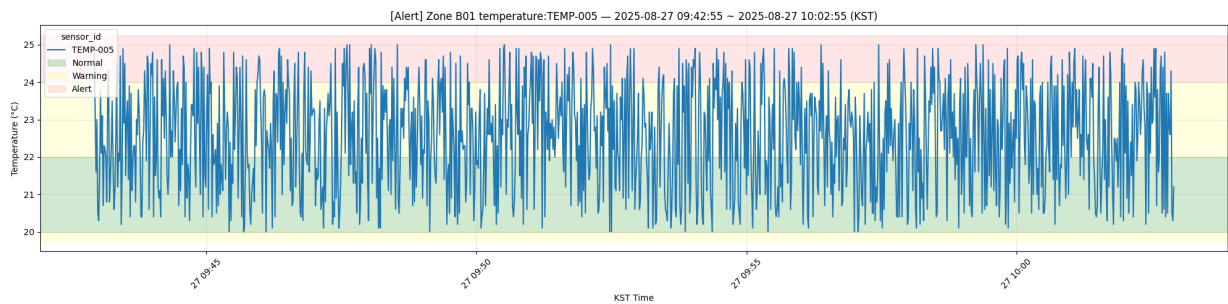

3. Notes

- This report is generated based on authorized data limited to Zone b.
- Abnormalities are automatically determined based on pre-set thresholds, and graphs display ± 10 minutes around the event time.
- For further analysis or detailed logs, please contact the administrator.