Figure 2 | Joint classifier × representation ablation

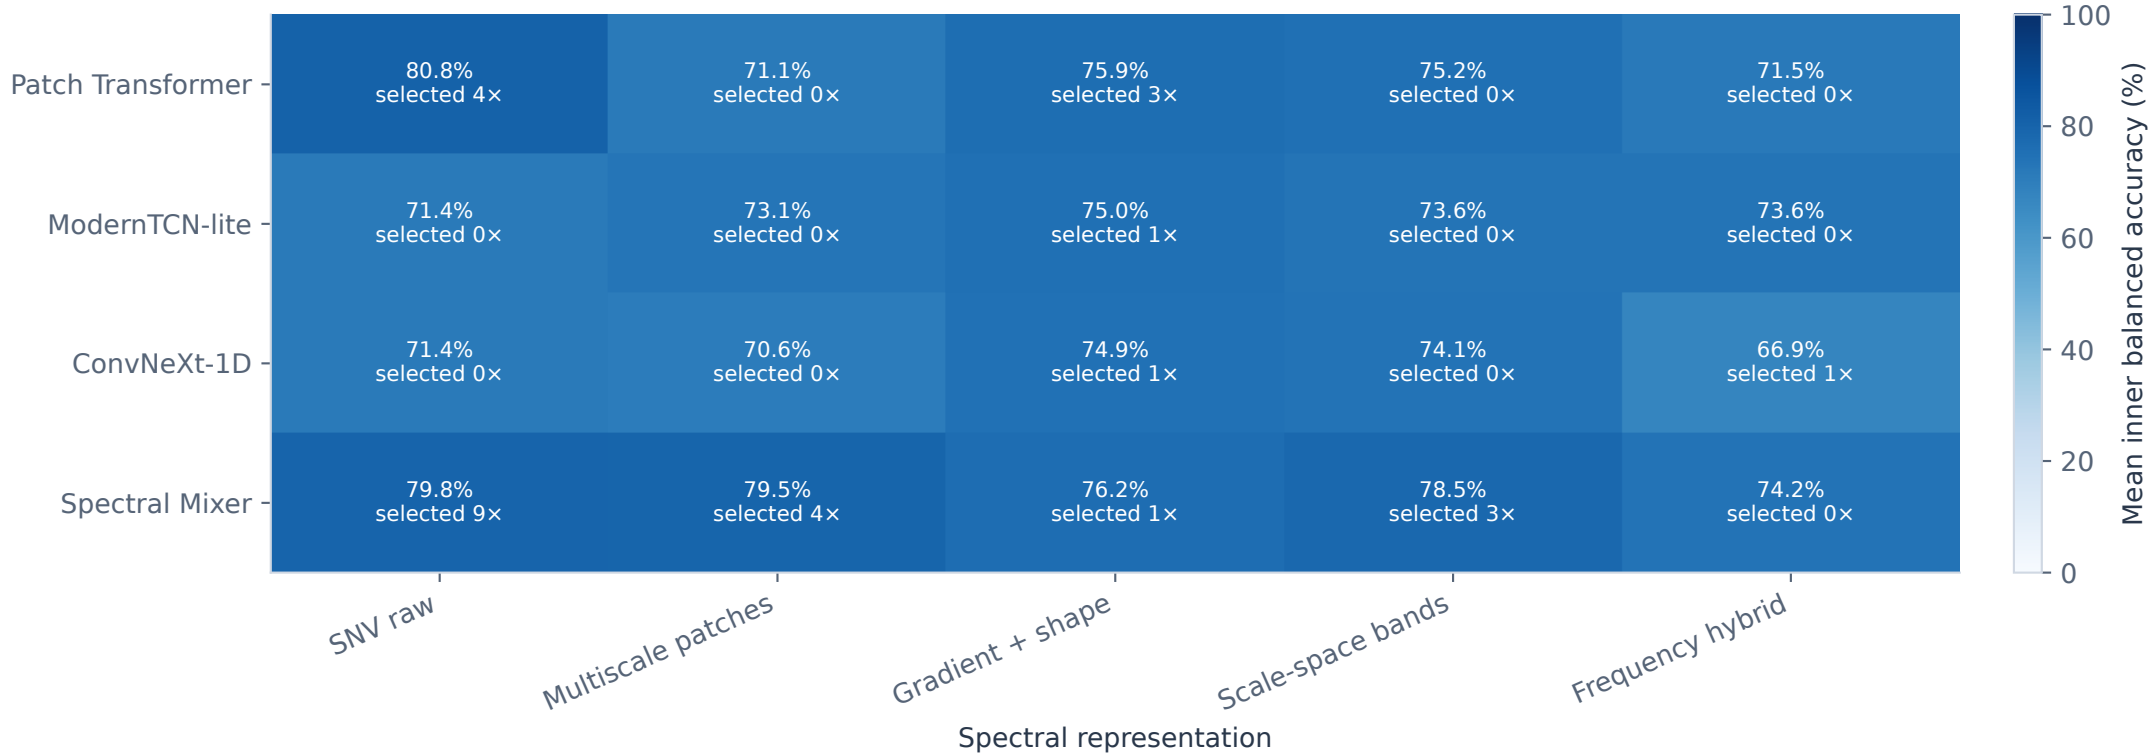

Each cell is inner-CV balanced accuracy with the generator chosen in Stage 1. “Selected” is the number of outer folds choosing that pair; it is NOT a test accuracy.