
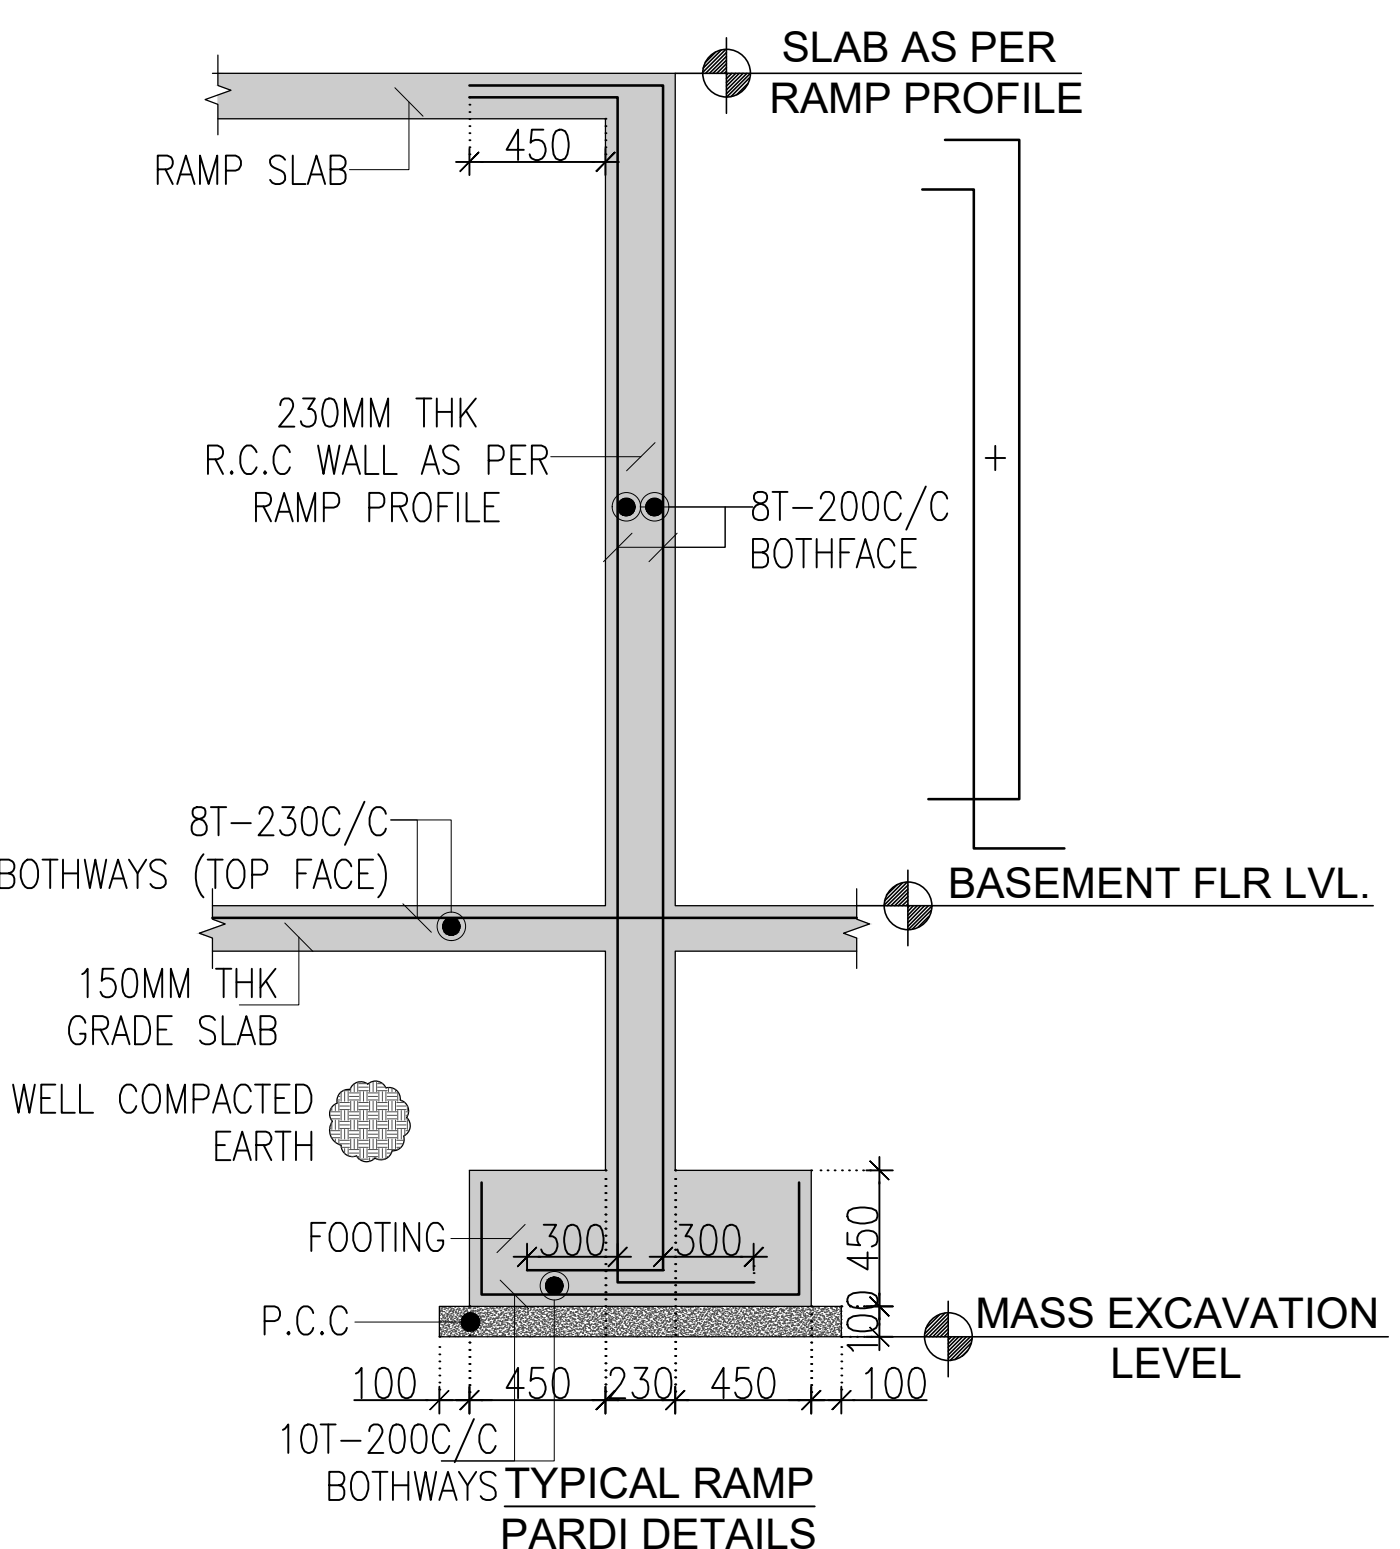
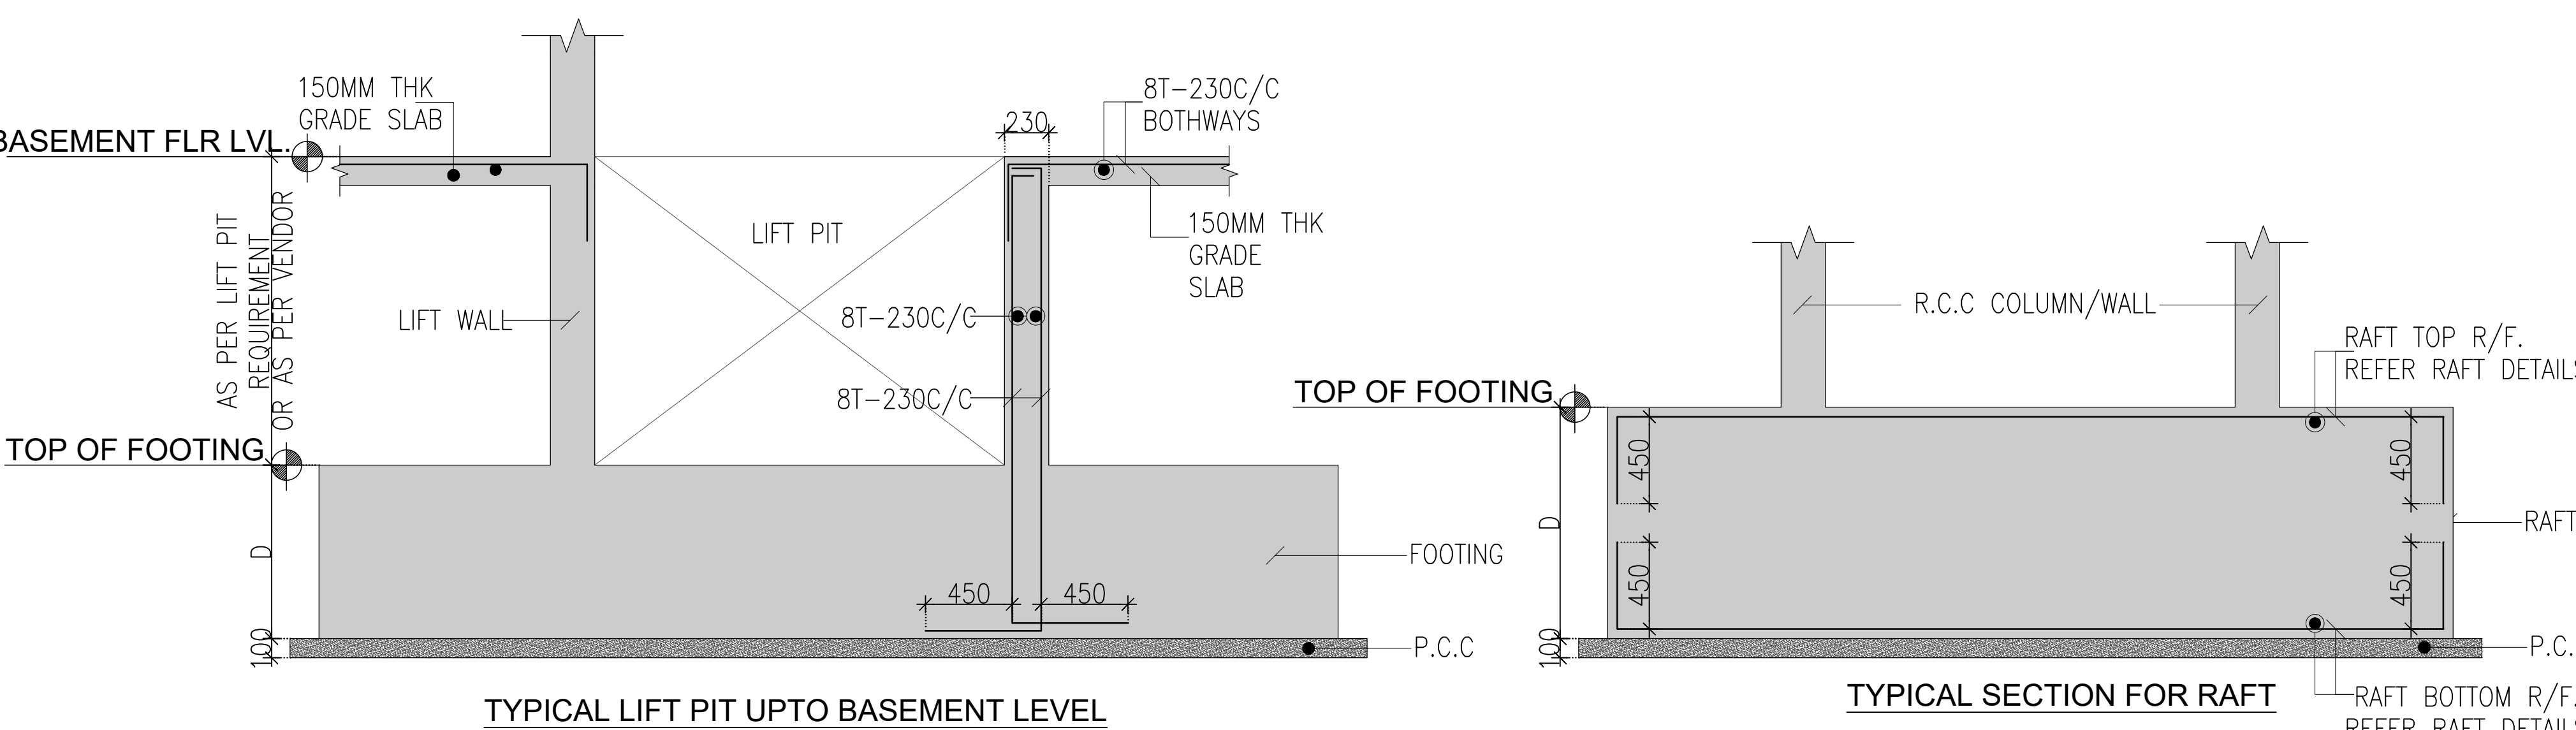
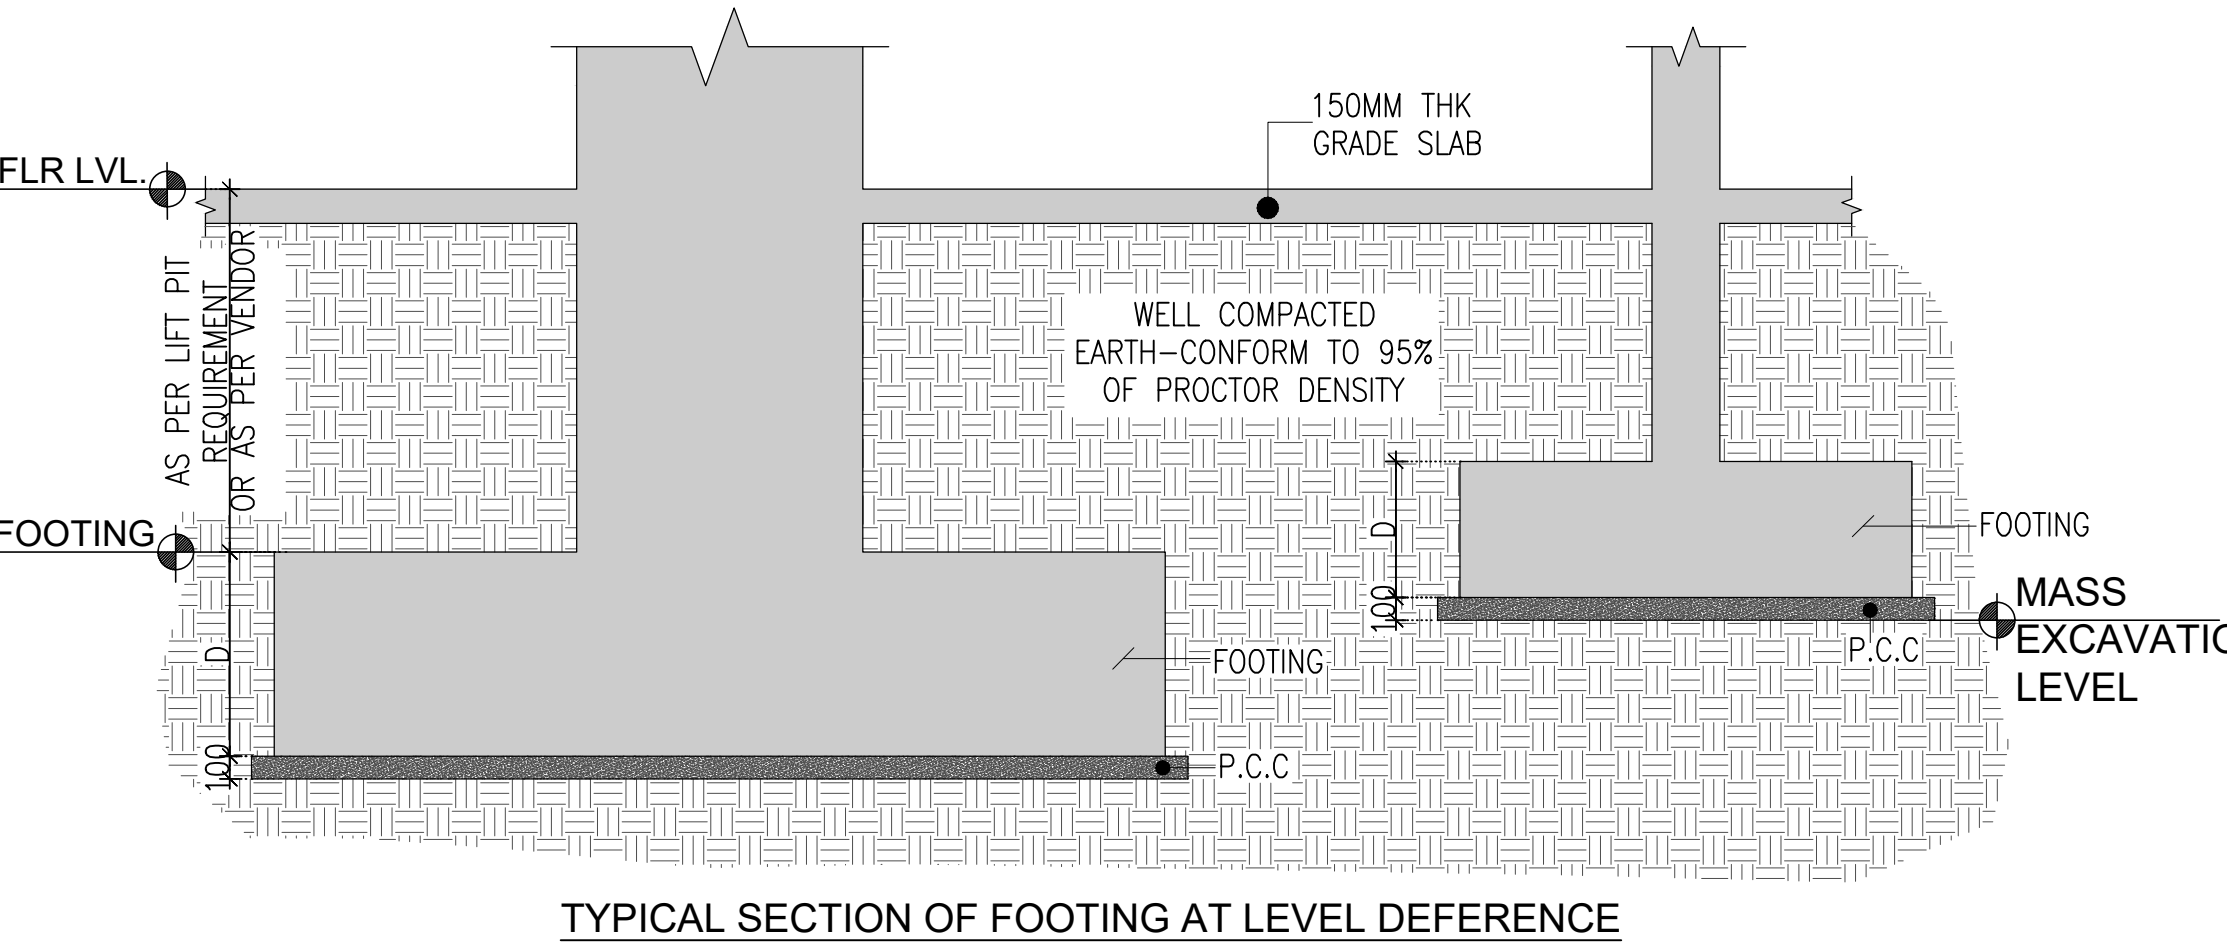
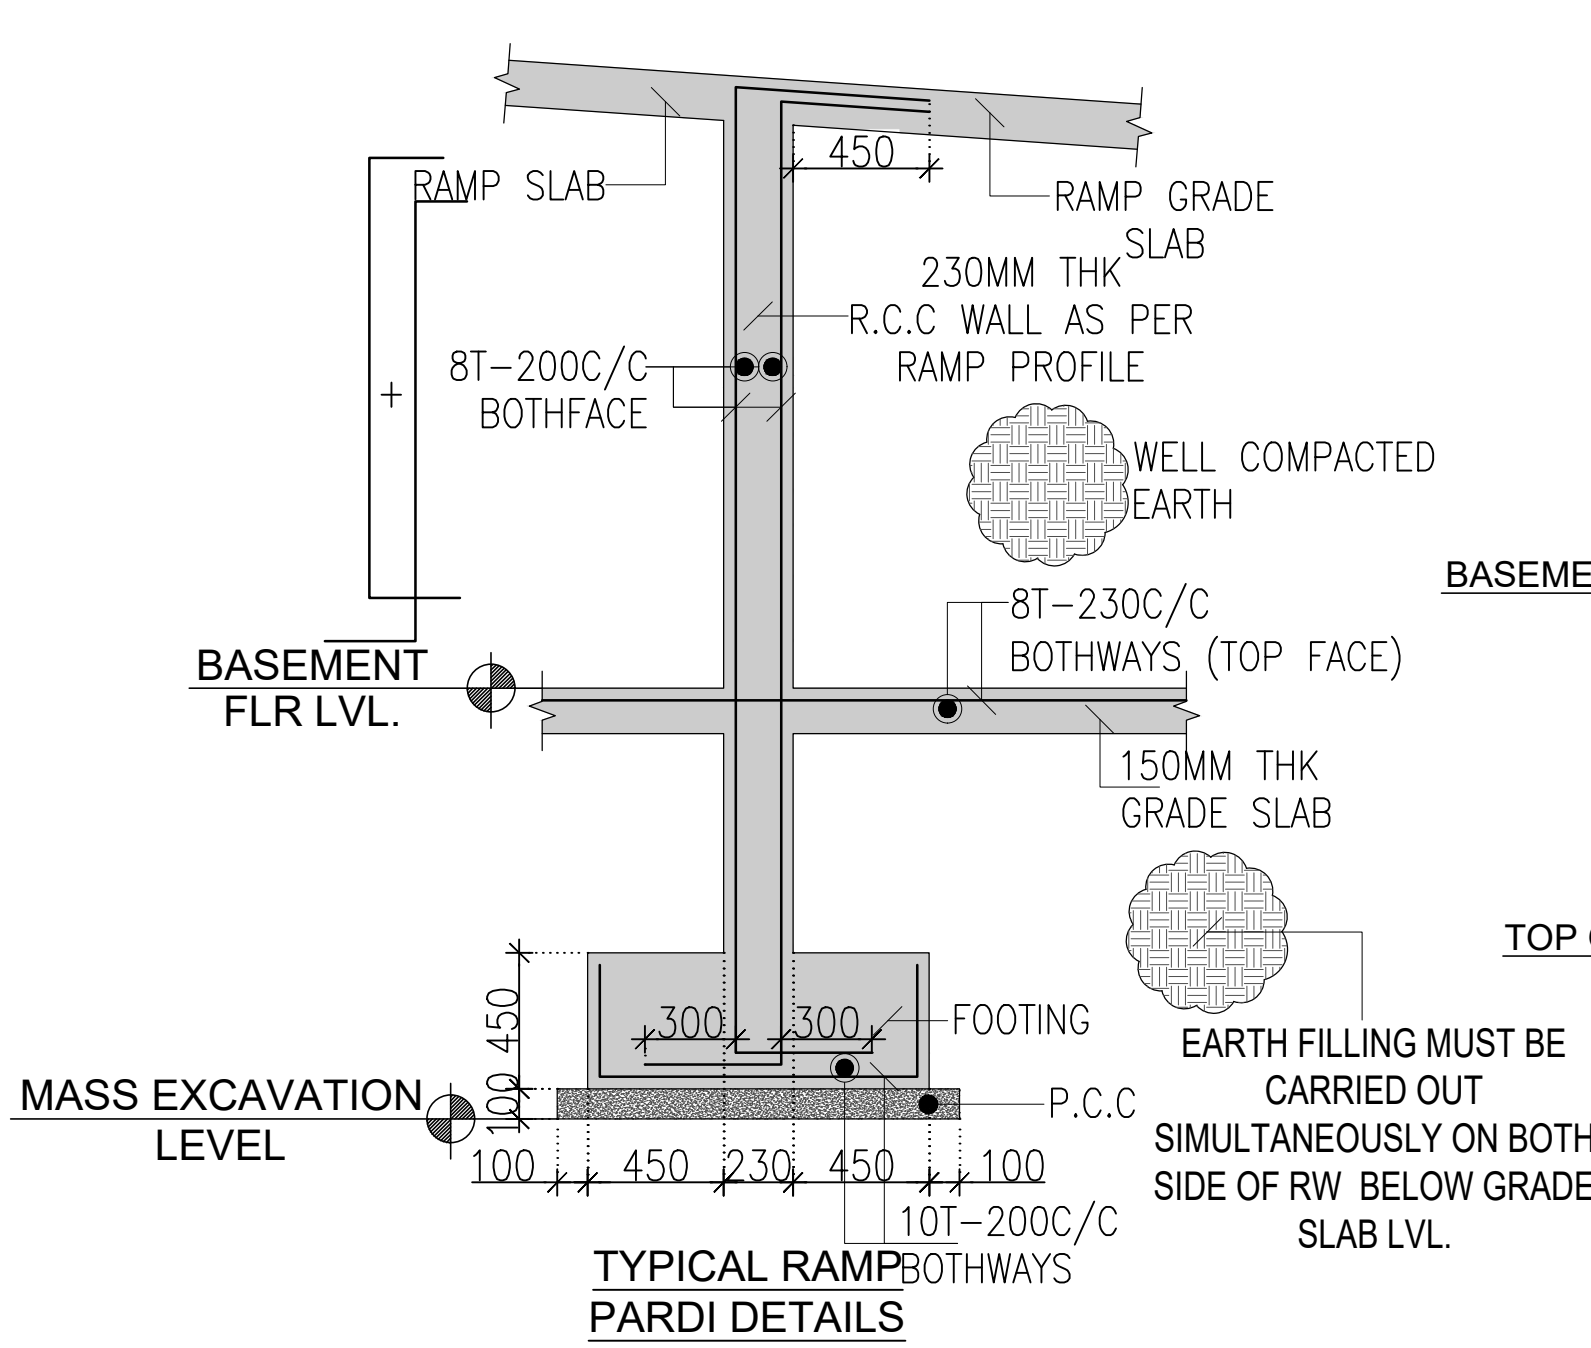


FOOTING SCHEDULE															
	F1	F2	F3	F4	F5	F6	F7	F8	F9	F10	F11	F12	F13	F14	CFT-1
B' x L' (PCC)	3500 X 4400	2900 X 3800	3700 X 8250	3550 X 4450	3300 X 4200	3500 X 4400	2050 X 2300	3450 X 4450	3150 X 4050	2850 X 3750	3300 X 3800	3450 X 4350	3500 X 4400	2900 X 3800	REFER PLAN
B x L	3300 X 4200	2700 X 3600	3500 X 8050	3350 X 4250	3100 X 4000	3300 X 4200	1850 X 2100	3250 X 4250	2950 X 3850	2650 X 3550	3100 X 3600	3250 X 4150	3300 X 4200	2700 X 3600	
D	1100	1000	1100	1200	1200	1075	650	1075	1175	900	900	1350	900	1250	
t	450	450	–	450	450	450	–	450	450	450	–	450	–	–	–
STEEL //- B (SHORT SIDE) (BOTTOM FACE)	12T-100C/C	12T-125C/C	12T-100C/C	12T-100C/C	12T-100C/C	12T-125C/C	10T-125C/C	12T-125C/C	12T-100C/C	12T-150C/C	12T-150C/C	12T-100C/C	12T-150C/C	12T-100C/C	10T-100C/C
STEEL //- L (LONG SIDE) (BOTTOM FACE)	12T-100C/C	12T-125C/C	12T-100C/C	12T-100C/C	12T-100C/C	12T-125C/C	10T-125C/C	12T-125C/C	12T-100C/C	12T-150C/C	12T-150C/C	12T-100C/C	12T-150C/C	12T-100C/C	10T-100C/C
STEEL //- B (SHORT SIDE) (TOP FACE)	–	–	12T-100C/C	–	–	–	–	–	–	–	–	–	–	–	10T-100C/C
STEEL //- L (LONG SIDE) (TOP FACE)	–	–	12T-100C/C	–	–	–	–	–	–	–	–	–	–	–	10T-100C/C
REMARK	SLOPE FOOTING	SLOPE FOOTING	PAD FOOTING	SLOPE FOOTING	SLOPE FOOTING	SLOPE FOOTING	PAD FOOTING	SLOPE FOOTING	SLOPE FOOTING	SLOPE FOOTING	PAD FOOTING	SLOPE FOOTING	PAD FOOTING	PAD FOOTING	PAD FOOTING

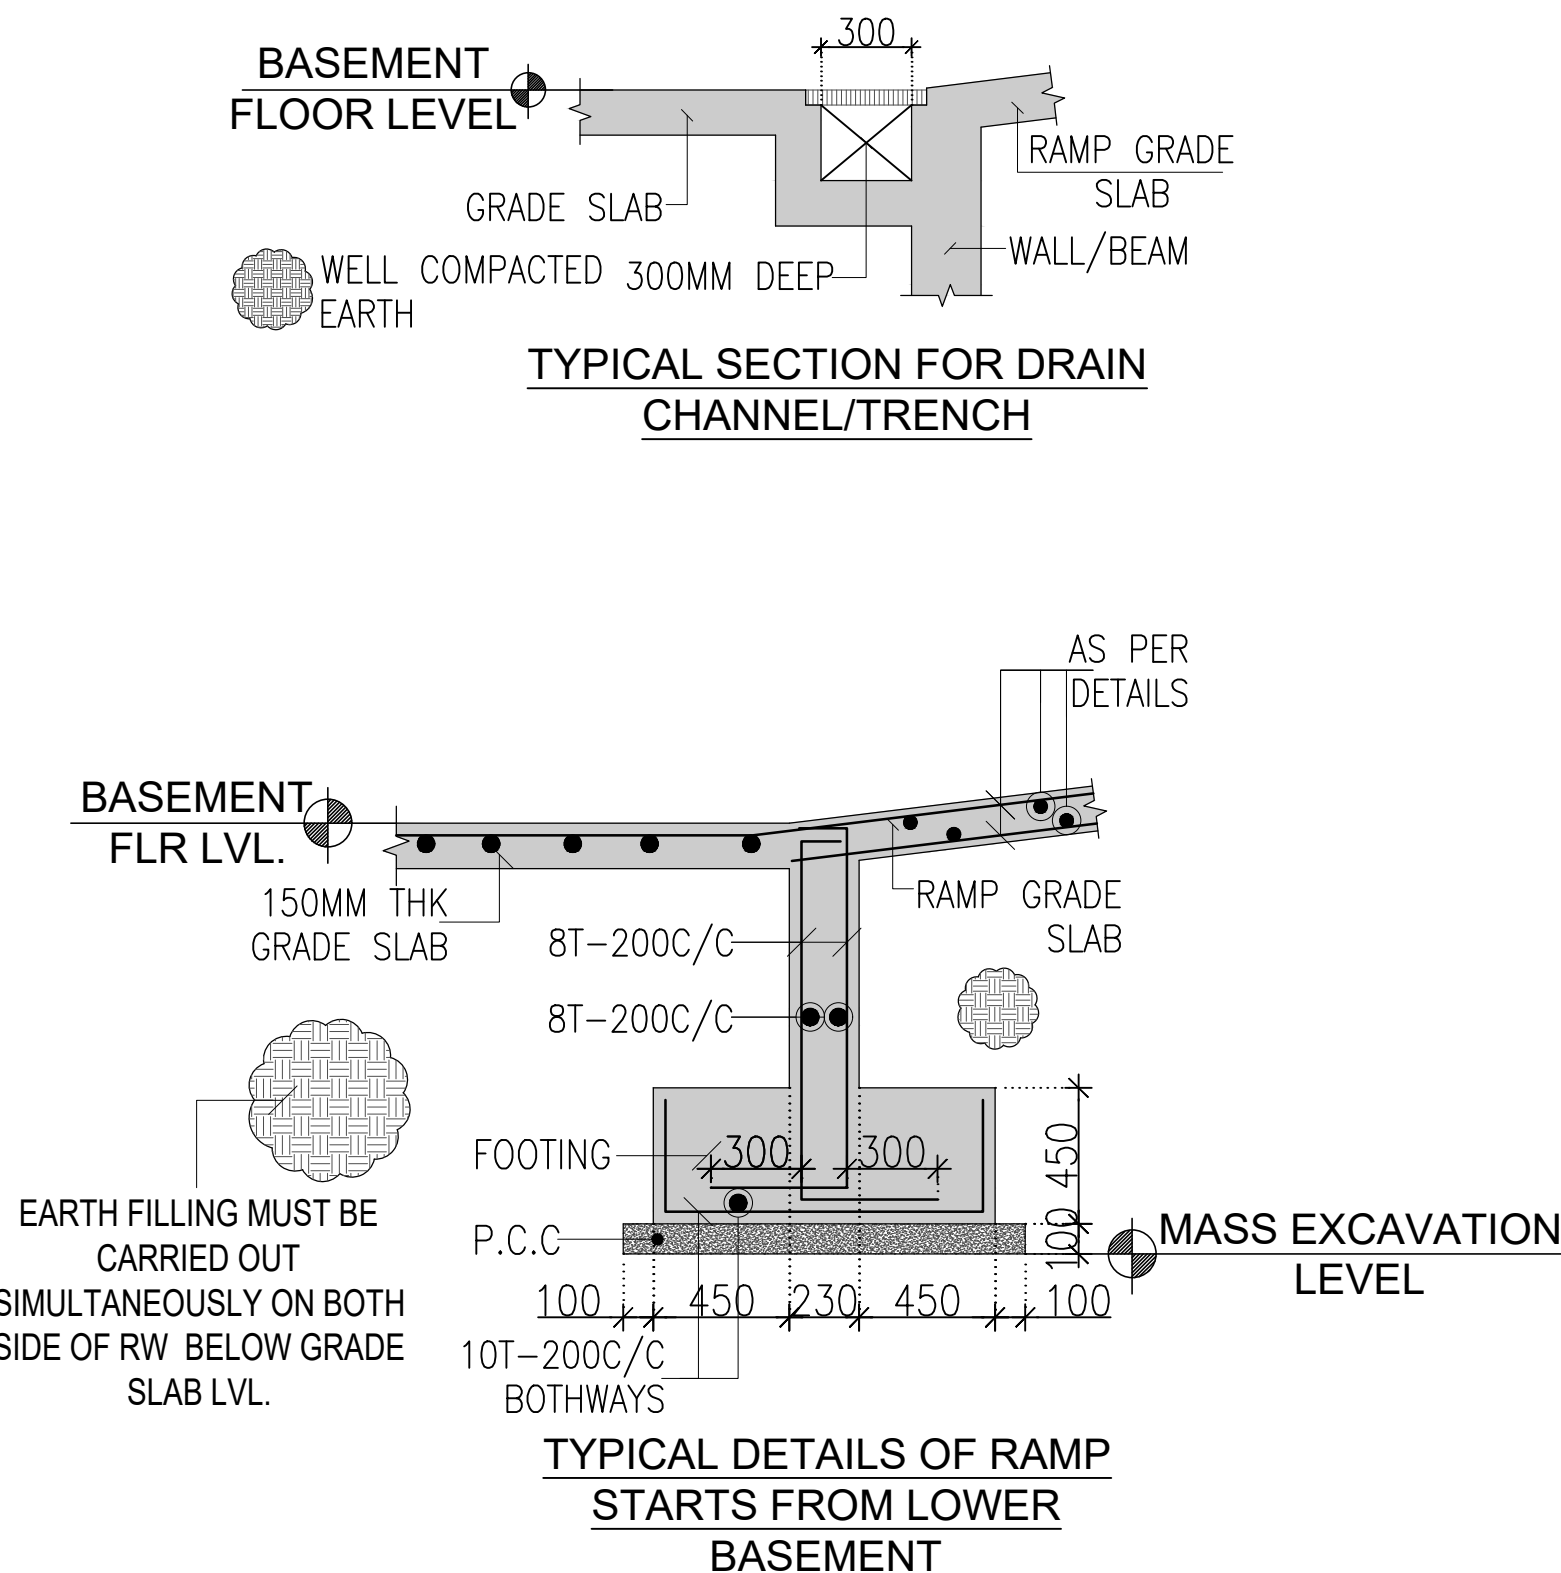

- GENERAL NOTES :-**
1. ALL DIMENSIONS ARE IN MM.
 2. FOR ALL NOTES, REFER OUR DRG NO: S0-01 TO S0-09.
 3. CEMENT SHALL BE OPC 43 GRADE OR HIGHER / AS PER TENDER SPECIFICATIONS & PORTABLE WATER SHOULD BE USE.
 4. SUPERVISION SHALL NOT BE OUR RESPONSIBILITY.
 5. TO TAKE OUT THE CUBE AND MATERIAL TESTING SHALL BE CONTRACTOR/ BUILDER/CLIENTS RESPONSIBILITY.
 6. LOAD TESTING OF STRUCTURE SHALL NOT BE OUR RESPONSIBILITY.
 7. ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED
 8. T OR # INDICATE STEEL FE 500D GRADE TMT BARS.
 9. ALL CONC.MIX. M:30 UNLESS OTHERWISE SPECIFIED.
 - 10.LD = DEVELOPMENT LENGTH : 50 X ϕ ; WHERE, ϕ = DIA. OF BAR.
 - 11.ALL BRICK WORK SHALL BE IN C.M. (1:6)
 - 12.STRUCTURAL LAY OUT SHOULD BE REFER ONLY FOR STRUCTURAL DETAILING.
 - 13.PLEASE REFER ARCHITECTURAL DWG FOR LVLS. & SETTINGS OUT CENTERLINE DIMENSIONS. THE CENTERLINE PUT IN THIS STRUCTURAL FOUNDATION LAYOUT IS SIMPLY INDICATIVE OF LOCATION AND AS APPROVED BY ARCHITECT.
 - 14.PLEASE REFER ARCH. DWG. FOR FINAL LAY OUT.
 - 15.CONTRACTOR SHOULD INFORM ARCHITECT/STRUCTURAL CONSULTANT IN CASE OF ANY CHANGE IN EXISTING CONDITION FOUND, IMMEDIATELY
 - 16.THIS DRG. SHOULD BE READ ALONG WITH ARCHITECTURAL DRGS.AND ANY CHANGES/DEVIATION FOUND SHOULD BE IMMEDIATELY BROUGHT TO NOTICE OF ARCHITECT & STR. ENGINEER
 - 17.THIS DWG.SHOULD BE READ ALONG WITH RELEVANT DETAILS
 - 18.MIX DESIGN SHOULD BE GOT APPROVED PRIOR TO EXECUTION OF WORK
 - 19.ALL STEEL (TOP/BOTTOM) OF DIFFERENT ZONE SHALL BE LAPPED IN ADDITION WHERE THE ZONE TERMINATES; BY LENGTH EQUAL TO THE DEVELOPMENT LENGTH OF HIGHER DIA BAR.

KEY PLAN

GRADE OF CONCRETE	
ALL STRUCTURAL ELEMENTS	M30

CONCRETE COVER	
FOOTINGS /RAFT	50MM
COLUMNS/SW	40MM
BEAMS	30MM
SLABS	25MM
PARDI WALLS	30MM

Blue Skyz Engineers

GFC

2 10-12-21 **GOOD FOR CONSTRUCTION**

1 08-12-21 **FOR REVIEW ONLY**

NO.	DATE	REVISION / REMARK	BY	DR	CH
-----	------	-------------------	----	----	----

JOB TITLE / DEVELOPER

TURQUOISE-GRANDEUR
RATANA DEVELOPERS

DRAWING TITLE

STRUCTURAL LAYOUT AT FOUNDATION LEVEL

JOB NO	DATE	DRG. NO.	REVISION
2111	16/04/2021	S1-FDN-04	R0

SCALE	SHEET SIZE	DRAWN	DESIGN	CHECKED
1: 100	A1/A2/A3	BP	KUNJ	BHAVIK PATEL

ARCHITECTS

HM ARCHITECTS
e:contact@hmarchitects.in

STRUCTURAL CONSULTANT

Blue Skyz Engineers
email:blueskyzengineers@gmail.com