


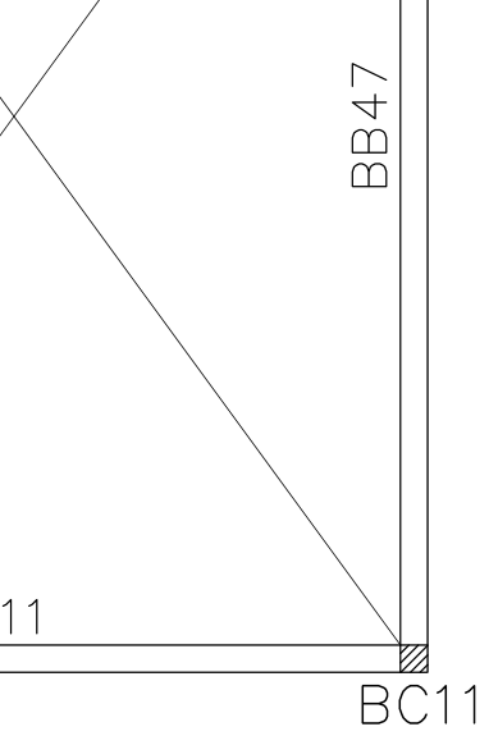

AB71,72,73	200 x 600	3 – T16	3 – T16	2 – T12	3 – T16	3 – T16	T10@100C/C	T10@125C/C	– – –
AB74	200 x 600	2 – T16	---	2 – T16	---	---	T8@100 C/C	T8@100 C/C	– – –
AB78,79,81	200 x 600	2 – T12	---	2 – T10	---	---	T8@150 C/C	T8@150 C/C	– – –
HB	200 x SLAB THK.	2 – T12	---	2 – T12	---	---	T8@150C/C	T8@150C/C	HIDDEN BEAM

SCHEDULE OF BEAMS AT 1ST FLOOR LEVEL :- BEAM BB3,4,5,14,15,16,18,22,23,25,29,30,32,36,42,60,62A,63,64,65,66,67,68,84,85,86,93,94,95

BEAM MARKED	SIZE (B x D	REINFORCEMENT						STIRRUPS		REMARKS
		BOTTOM (STRAIGHT)	BOTTOM (CURTAIL)	TOP (STRAIGHT)	(EXTRA LEFT	TOP OVER SUPPORT) RIGHT		UPTO L/4	REST	
BB2,43	200 x 600	3 – T16	2 – T12	2 – T12	3 – T16	3 – T16		T8@100 C/C	T8@200 C/C	– – –
BB3,4,8,9,40,41,44,45	200 x 600	2 – T16	---	2 – T12	2 – T16	2 – T16		T8@200 C/C	T8@200 C/C	– – –
BB6	200 x 600	2 – T12	---	2 – T16	---	---		T10@100 C/C	T10@100 C/C	CANTILEVER
BB7	200 x 600	2 – T16	2 – T16	2 – T16	3 – T16	3 – T16		T8@100 C/C	T8@150 C/C	TOP & BOT.BARS TO BE TAKEN FROM CANTILEVER
BB10,37,50,51,61,62	200 x 600	2 – T16	---	2 – T12	---	---		T8@150C/C	T8@200C/C	– – –
BB12,34	200 x 600	2 – T16	2 – T16	2 – T16	2 – T16	2 – T16		T8@100 C/C	T8@150C/C	– – –
BB13,35	200 x 600	2 – T16	---	2 – T16	2 – T16	2 – T16		T8@100C/C	T8@100C/C	– – –
BB20,27	200 x 600	3 – T16	2 – T16	2 – T16	---	---		T8@200 C/C	T8@200 C/C	– – –
BB17,24,31	200 x 600	2 – T16	---	2 – T16	---	2 – T16		T8@100 C/C	T8@100 C/C	– – –
BB19,26	200 x 600	3 – T16	3– T16	2 – T16	2 – T12	3– T16		T10@100 C/C	T10@150 C/C	– – –
BB21,28	200 x 600	3– T16	---	2 – T16	---	---		T8@200C/C	T8@200C/C	– – –
BB38	200 x 600	2 – T16	---	2 – T16	---	---		T10@100C/C	T10@100C/C	CANTILEVER
BB39	200 x 600	3– T16	2 – T12	2 – T16	---	2 – T16		T8@100C/C	T8@100C/C	TOP & BOT.BARS TO BE TAKEN FROM CANTILEVER
BB47,48,49	200 x 600	3 – T16	2 – T16	2 – T16	3– T16	3– T16		T10@100C/C	T10@150C/C	– – –
BB52,59,99,100	200 x 600	3 – T16	2 – T12	2 – T16	2 – T16	2 – T16		T10@150C/C	T10@200C/C	– – –
BB69,75	200 x 400	3 – T16	2 – T16	2 – T16	2 – T16	2 – T16		T10@100C/C	T10@150C/C	– – –
BB53,54,55,56,57,58,87,88,89,90,91,92	200 x 600	2 – T16	---	2 – T16	---	---		T8@100C/C	T8@200C/C	– – –
BB62A,84,85,86	200 x 350	2 – T12	---	2 – T12	---	---		T8@150C/C	T8@150C/C	BEAM TOP @250 SUNK LVL
BB67	200 x 600	2 – T12	---	2 – T12	---	---		T8@150 C/C	T8@150 C/C	
BB69A,75A	200 x 375	2 – T16	---	2 – T16	---	---		T8@100C/C	T8@100C/C	– – –
BB70	200 x 600	2 – T16	---	2 – T16	---	---		T8@100C/C	T8@100C/C	CANTILEVER
BB71,72,73	200 x 600	3 – T16	3– T16	2 – T16	3 – T16	3 – T16		T10@100C/C	T10@125C/C	– – –
BB74	200 x 600	2 – T16	---	2 – T16	---	---		T8@100 C/C	T8@100 C/C	– – –
BB78,79,81	200 x 600	2 – T12	---	2 – T10	---	---		T8@150 C/C	T8@150 C/C	– – –
HB	200 x SLAB THK.	2 – T12	---	2 – T12	---	---		T8@150C/C	T8@150C/C	HIDDEN BEAM

SCHEDULE OF SLABS AT 1ST FLOOR LEVEL:- SLAB S1 ARE DELETED

SLAB MARKED	THICK.	TYPE	REINFORCEMENT		REMARKS
			SHORT BAR	LONG BAR	
S2	175	TWO WAY	T10@100C/C (ALT. BENT UP)	T10@200C/C (ALT. BENT UP)	–
S3	125	TWO WAY	T8@150C/C (ALT. BENT UP)	T8@200C/C (ALT. BENT UP)	–
S4	125	ONE WAY	T8@100C/C (ALT. BENT UP)	T8@200C/C (ALT. BENT UP)	250MM SUNK SLAB
S5	115	ONE WAY	T8@150C/C (ALT. BENT UP)	T8@200C/C (ALT. BENT UP)	–
S6	115	ONE WAY	T8@150C/C (ALL STRAIGHT)	T8@200C/C (DIST.)	–
S7	175	TWO WAY	T10@150C/C (ALT. BENT UP)	T10@200C/C (ALT. BENT UP)	–
ST	225	ONE WAY	T12@100C/C (MAIN)	T12@200C/C (DIST.)	STAIRCASE SLAB

- at any given section.
9. All buildings shall have tie
10. At any level where column beams/plinth beams are esse
11. For cantilevers, top bars to support for –1.5 X span of c
12. Fire rating considered:– 2

- Use of this drawing for construct following conditions by Owner / E
1. Our responsibility shall ren as transmitted by this drawi
- a) Safety of old struct
- b) Safety of any adjoin building/persons and prop
- c) Safety of constructi construction
- d) Correctness/safety centering erected at site o any accidents.
- e) Accidents occurring substandard construction n procedure.
- f) Any accident occur designed by us.
2. Supervision if specifically verification of reinforcement o
3. All structural concrete sh mechanically vibrated.
4. Any discrepancy between brought to our notice before
5. Drawing shall not be scal
6. This drawing to be read c

R9	REVISED AS MARKED
R8	REVISED AS MARKED
R7	REVISED AS PER COMMENTS &
R6	REVISED AS PER COMMENTS &
R5	REVISED AS PER COMMENTS &
R4	REVISED AS PER COMMENTS &
R3	REVISED AS PER COMMENTS &
R2	REVISED AS PER COMMENT
R1	REVISED AS PER COMMENT
REV.	DESCRIPTION

GRADE OF CONCRETE :-	
GRADE OF STEEL :-	
ENVIRONMENTAL EXPOSURE CONDITION :-	
DESIGN LIVE LOAD :- (UNLESS SPECIFIED)	
S.B.C. :-	

--	--

PROJECT : PROPOSED RES (GUEST BLOCK -	
--	--

CLIENT :	MELLORA
ARCHITECT :	STUDIO H
DRAWING TITLE :	RCC DETAIL

SCALE	DWN.BY	CHK.B
N.T.S.	NandkumaR	SIDDH

Associated
Engineers

607, Opal Square, Opp. Rail Wagale Est
Thane (w)– 4
Phone: +91–22–2081208
Email: info@asc.org.in, Wa