COLUMN	TA-C1, TA-C4	TA-C2, TA-C3	TA-C34, TA-C35	TA-C33, TA-C36	TA-C29	TA-C5	TA-C23
COLUMN FROM THIRTEENTH FLOOR LVL. TO TOP FLOOR LVL. CONCRETE MIX – M30	● 16–10T ⊗ 8–8T 1200 230	● 14–12T ⊗ 12–10T 230 1000 530 230	● 28–12T 1410 230	● 16–10T ⊗ 8–8T 1200 230	● 24–12T 1200 230	● 20–12T 1000 230	● 16–12T ⊗ 16–10T 1600
	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM TWELVETH FLOOR LVL. TO THIRTEENTH FLOOR LVL. CONCRETE MIX – M30	● 16–10T ⊗ 8–8T 1200 230	● 14–12T ⊗ 12–10T 230 1000 530 230	● 28–12T 1410 230	● 16–10T ⊗ 8–8T 1200 230	● 24–12T 1200 230	● 20–12T 1000 230	● 16–12T ⊗ 16–10T 1600
	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM ELEVENTH FLOOR LVL. TO TWELVETH FLOOR LVL. CONCRETE MIX – M30	● 16–10T ⊗ 8–8T 1200 230	● 14–12T ⊗ 12–10T 230 1000 530 230	● 28–12T 1410 230	● 16–10T ⊗ 8–8T 1200 230	● 24–12T 1200 230	● 20–12T 1000 230	● 16–12T ⊗ 16–10T 1600
	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM TENTH FLOOR LVL. TO ELEVENTH FLOOR LVL. CONCRETE MIX – M30	● 24–10T 1200 230	● 14–12T ⊗ 12–10T 230 1000 530 230	● 28–12T 1410 230	● 24–10T 1200 230	● 24–12T 1200 230	● 20–12T 1000 230	● 16–12T ⊗ 16–10T 1600
	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM NINETH FLOOR LVL. TO TENTH FLOOR LVL. CONCRETE MIX – M30	● 16–12T ⊗ 8–10T 1200 230	● 14–12T ⊗ 12–10T 230 1000 530 230	● 28–12T 1410 230	● 16–12T ⊗ 8–10T 1200 230	● 24–12T 1200 230	● 20–12T 1000 230	● 16–12T ⊗ 16–10T 1600
	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)

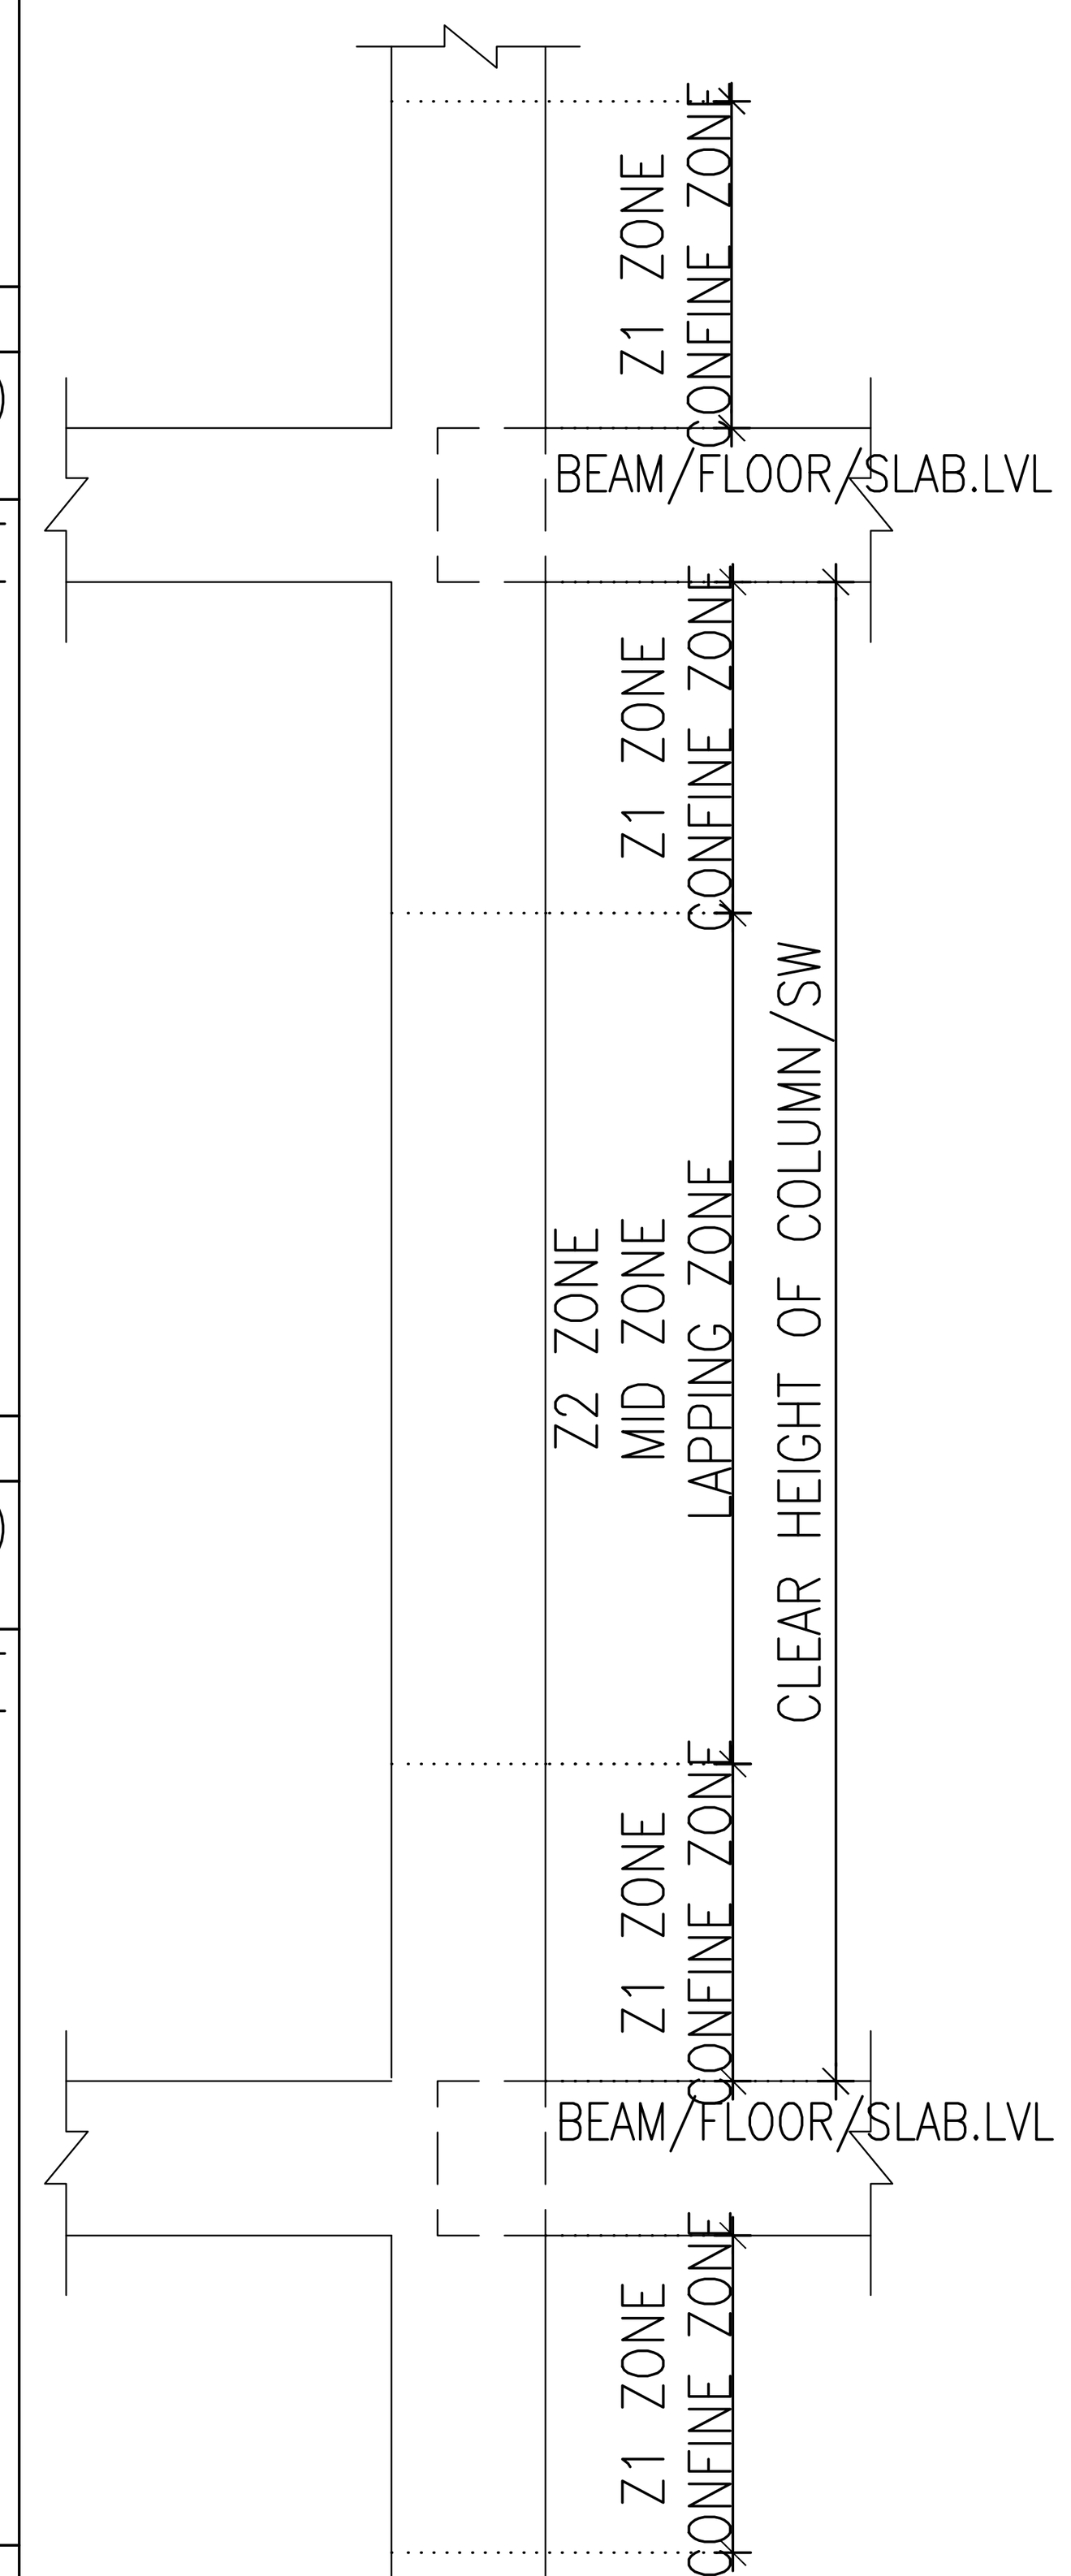

TYPICAL ZONING FOR DUCTILE DETAILS OF COLUMNS / SW

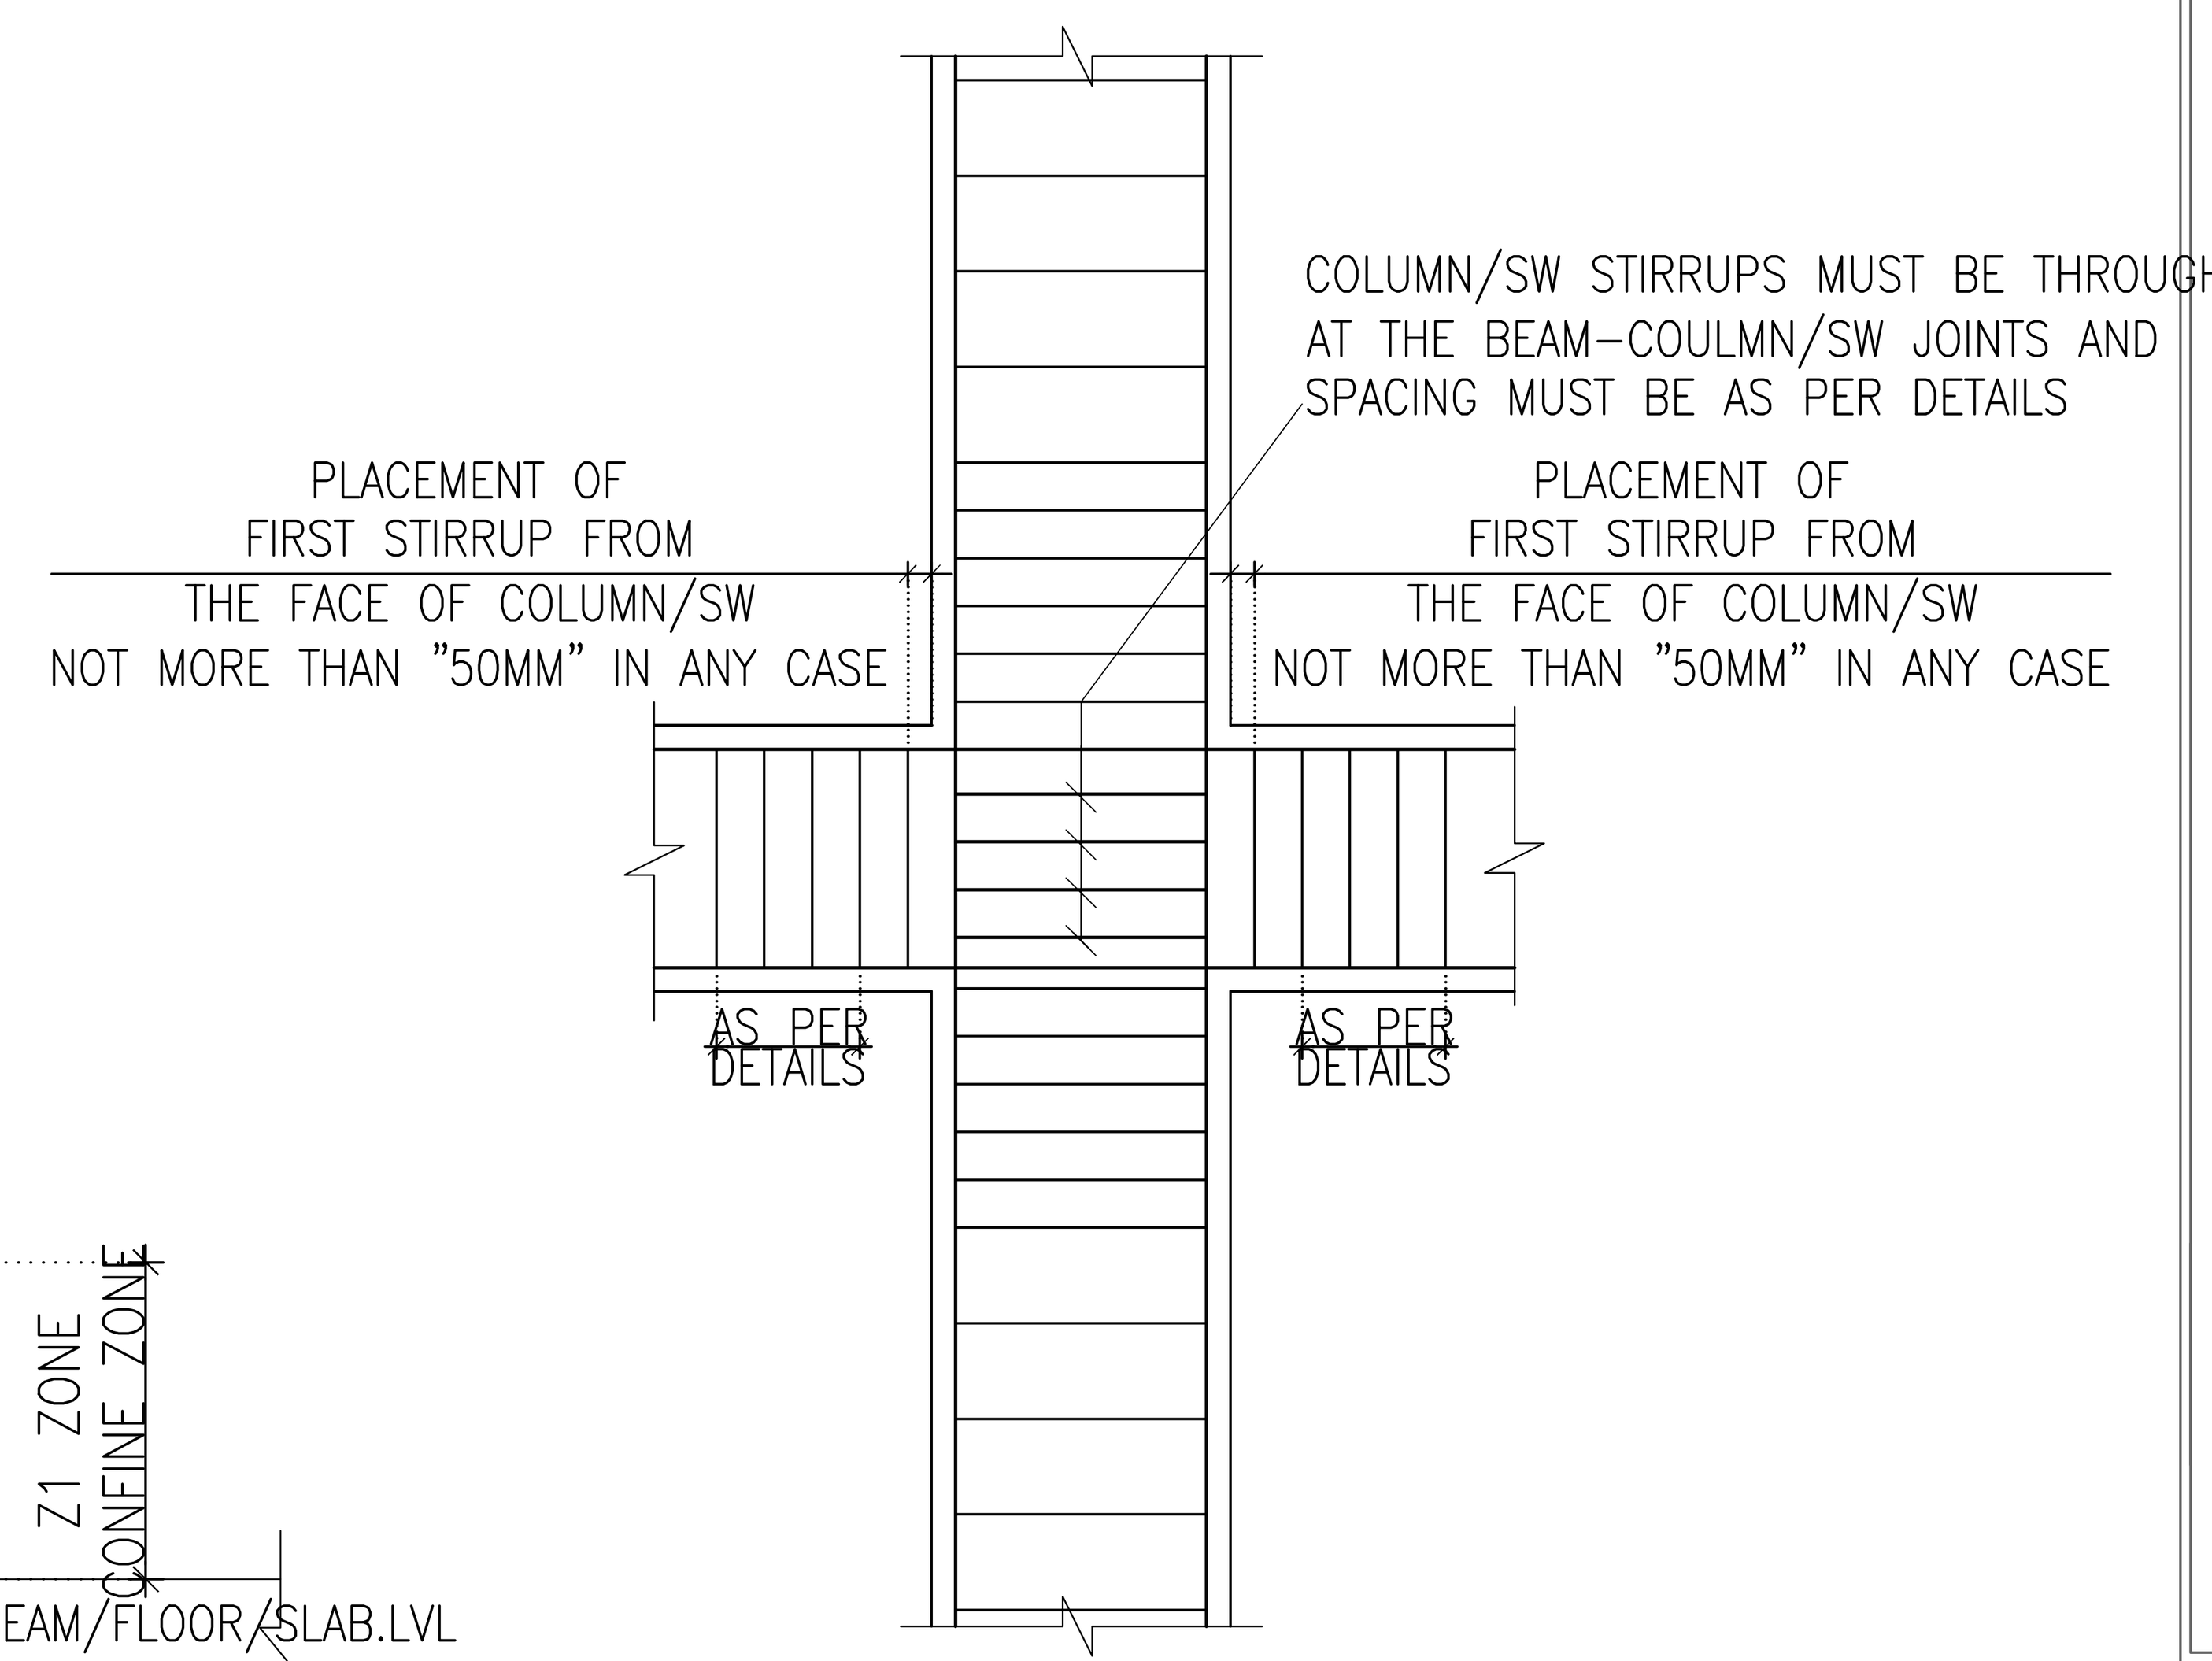

TYPICAL DETAILS FOR STIRRUPS PLACEMENTS FOR BEAMS AND COLUMNS

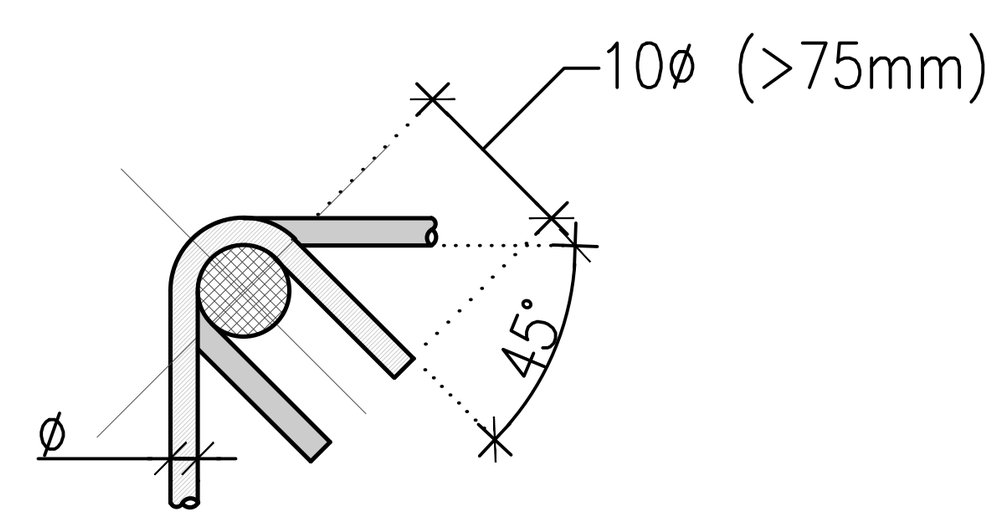

FOR 135° HOOK



FOR 180° HOOK

TYPICAL DETAIL OF HOOKS

GENERAL NOTES :-

1. ALL DIMENSIONS ARE IN MM.
2. FOR ALL NOTES, REFER OUR DRG NO: SO–01 TO SO–08.
3. CEMENT SHALL BE OPC 43 GRADE OR HIGHER / AS PER TENDER SPECIFICATIONS & PORTABLE WATER SHOULD BE USE.
4. SUPERVISION SHALL NOT BE OUR RESPONSIBILITY.
5. TO TAKE OUT THE CUBE AND MATERIAL TESTING SHALL BE CONTRACTOR/ BUILDER/CLIENTS RESPONSIBILITY.
6. LOAD TESTING OF STRUCTURE SHALL NOT BE OUR RESPONSIBILITY.
7. ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED
8. T OR # INDICATE STEEL FE 500D GRADE TMT BARS.
9. ALL CONC.MIX. M:30 UNLESS OTHERWISE SPECIFIED.
10. LD = DEVELOPMENT LENGTH : 50 X ϕ; WHERE, ϕ = DIA. OF BAR.
11. ALL BRICK WORK SHALL BE IN C.M. (1:6)
12. STRUCTURAL LAY OUT SHOULD BE REFER ONLY FOR STRUCTURAL DETAILING.
13. PLEASE REFER ARCHITECTURAL DWG FOR LVLS. & SETTINGS OUT CENTERLINE DIMENSIONS. THE CENTERLINE PUT IN THIS STRUCTURAL FOUNDATION LAYOUT IS SIMPLY INDICATIVE OF LOCATION AND AS APPROVED BY ARCHITECT.
14. PLEASE REFER ARCH. DWG. FOR FINAL LAY OUT.
15. CONTRACTOR SHOULD INFORM ARCHITECT/STRUCTURAL CONSULTANT IN CASE OF ANY CHANGE IN EXISTING CONDITION FOUND, IMMEDIATELY
16. THIS DRG. SHOULD BE READ ALONG WITH ARCHITECTURAL DRGS.AND ANY CHANGES/DEVIATION FOUND SHOULD BE IMMEDIATELY BROUGHT TO NOTICE OF ARCHITECT & STR. ENGINEER
17. THIS DWG.SHOULD BE READ ALONG WITH RELEVANT DETAILS
18. MIX DESIGN SHOULD BE GOT APPROVED PRIOR TO EXECUTION OF WORK
19. ALL STEEL (TOP/BOTTOM) OF DIFFERENT ZONE SHALL BE LAPPED IN ADDITION WHERE THE ZONE TERMINATES; BY LENGTH EQUAL TO THE DEVELOPMENT LENGTH OF HIGHER DIA BAR.

KEY PLAN

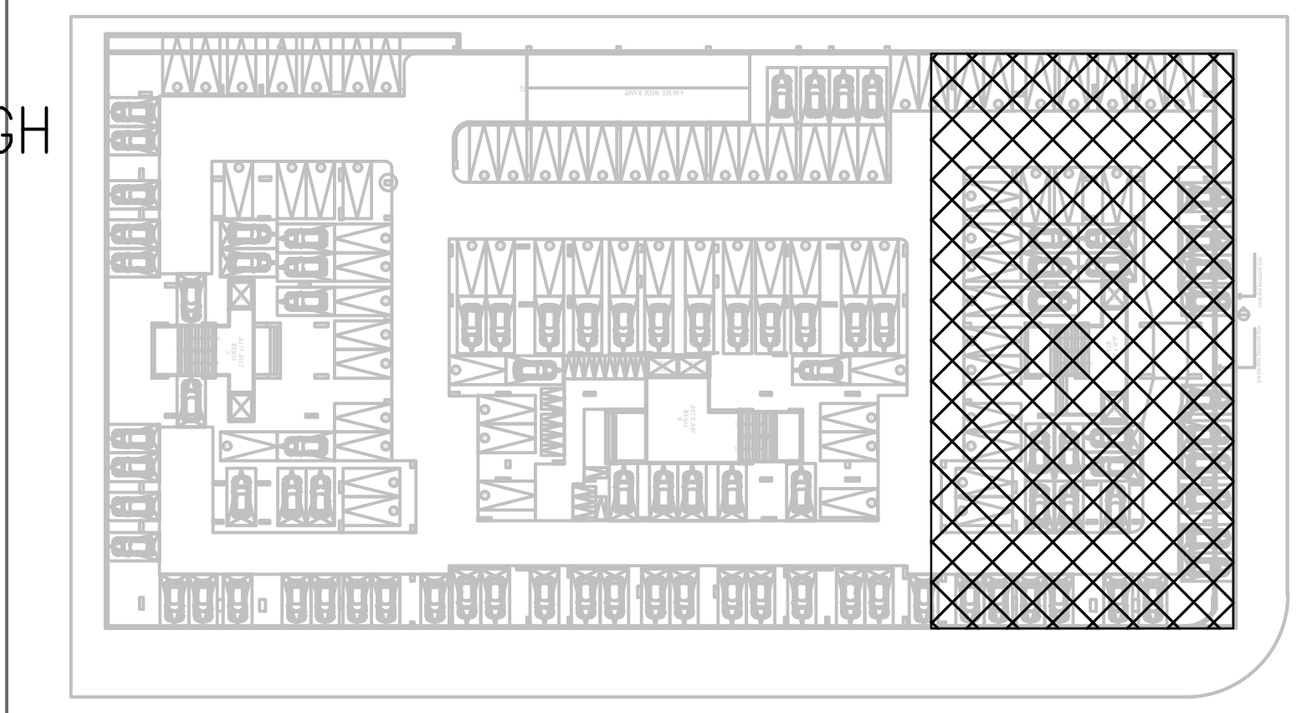

GRADE OF CONCRETE	
ALL STRUCTURAL ELEMENTS	M30

CONCRETE COVER	
FOOTINGS /RAFT	50MM
COLUMNS/SW	40MM
BEAMS	30MM
SLABS	25MM
PARDI WALLS	30MM



NO.	DATE	REVISION / REMARK	BY	DR	CH
1	29-12-21	GOOD FOR CONSTRUCTION			

JOB TITLE / DEVELOPER

TURQUOISE-GRANDEUR
RATANA DEVELOPERS

DRAWING TITLE

COLUMN SCHEDULE DETAIL - TOWER-A

JOB NO	DATE	DRG. NO.	REVISION
2111	16/04/2021	S5-TA-03	R0

SCALE	SHEET SIZE	DRAWN	DESIGN	CHECKED
1 : 100	A1/A2/A3	AKSHAY	KUNJ	BHAVIK PATEL

ARCHITECTS

HM ARCHITECTS
e:contact@hmarchitects.in

STRUCTURAL CONSULTANT

Blue Skyz Engineers
email:blueskyzengineers@gmail.com