


ROOF FLOOR	M25					
FIRST FLOOR	M25					
GROUND FLOOR	M25					
COLUMN MARKED		AC1,2,48,49	AC3,5,6,9,10,42,43,44,46,47	AC4,8,41,45	AC7,40	AC11,19,27,35
		AC1,2,48,49	BC3,5,6,9,10,42,43,44,46,47	BC4,8,41,45	BC7,40	BC11,19,27,35

ROOF FLOOR	M25					
FIRST FLOOR	M25					
GROUND FLOOR	M25					
COLUMN MARKED		AC12,14,17,22,25,30,33,38	AC13,37	AC15,18,23,26,31,34,39	AC16,20,24,28,32,36	AC21,29
		BC12,14,17,22,25,30,33,38	BC13,37	BC15,18,23,26,31,34,39	BC16,20,24,28,32,36	BC21,29

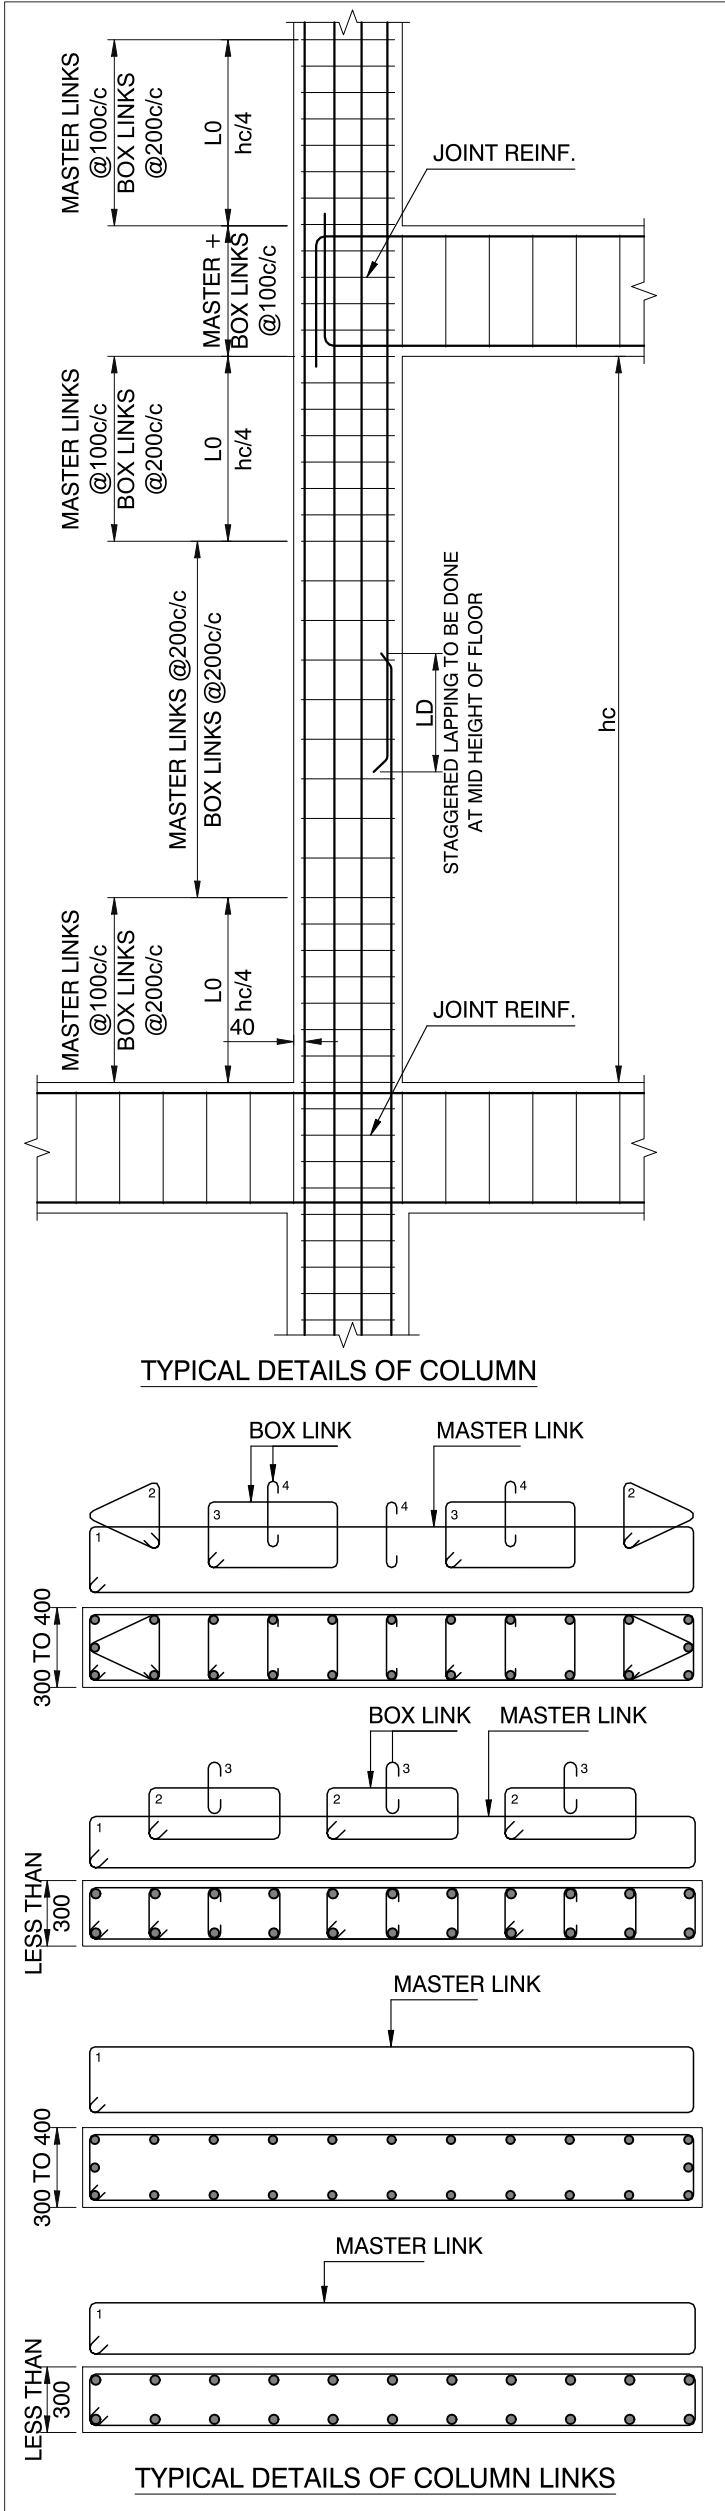

This drawing is the property of Associated Structural Engineers LLP, and shall not be reproduced or used without written permission.

DRAWING NOS. - ASC - 03

PROJECT STAGE :

☐ - SUB. ☐ - TENDER ☐ - ADVANCE ☒ - EXECUTION

SPECIAL NOTES :-
ALL EXTERNAL WALLS SHALL BE 150 thk. LIGHT WEIGHT BLOCKS.
ALL INTERNAL WALLS SHALL BE 150 thk. LIGHT WEIGHT BLOCKS.

- NOTES :
- Basic reference code:- IS 456: 2000, IS 1893, IS 13920
 - Due care shall be taken to ascertain that requisite strength of concrete is gained before commencement of deshuttering. It shall comply with provisions of Clause No. 11.3 of IS 456: 2000.
 - Earthquake zone considered is zone III for MUMBAI region.
 - Clear covers

a) Footings / Raft (Bottom / Top)	75/50
b) Columns & walls >200mm width	40
c) Columns & walls having width of 200mm & below	25
d) Slabs	20
e) Beams	25
f) Girder Beams	40
g) Pile cap	75
 - Beams having depth more than 750mm, provide side-face reinforcement. Substratum shall be approved from our office before laying P.C.C.
 - Minimum clear spacing between any two longitudinal bars in beam= 50mm.
 - All laps (Ld) shall be staggered & not more than 50% bars to be lapped at any given section. Ld = 50 X D (where D= dia. of Bar)
 - All buildings shall have tie beams/plinth beams at ground/plinth level.
 - At any level where column size gets reduced in either dimension tie beams/plinth beams are essential.
 - For cantilevers, top bars to be anchored behind from external face of support for -1.5 X span of cantilever.
 - Fire rating considered:- 2 Hour Max.

- Use of this drawing for construction shall explicitly confirm acceptance of following conditions by Owner / Builder / Contractor
- Our responsibility shall remain limited to safe and sound structural design as transmitted by this drawing and we shall not remain responsible for
 - Safety of old structure during demolition.
 - Safety of any adjoining building /persons staying in adjoining building/persons and properties on adjoining roads.
 - Safety of construction worker/any personnel at work site during construction
 - Correctness/safety of any temporary structure, scaffolding, shuttering, centering erected at site and any injury to any personnel arising out of any accidents.
 - Accidents occurring due to premature deshuttering, faulty / substandard construction material or workmanship / faulty construction procedure.
 - Any accident occurring due to construction of elements of buildings not designed by us.
 - Supervision if specifically asked for will be provided to the extent of verification of reinforcement on site
 - All structural concrete should be weigh batched, machine mixed & mechanically vibrated.
 - Any discrepancy between our drawing & Architects' drawing shall be brought to our notice before construction.
 - Drawing shall not be scaled written dimensions are to be followed.
 - This drawing to be read along with other relevant drawings.

R3	1st & ROOF FLOOR LINKS ADDED	27.02.24	NK	SIDDHI
R2	COLUMN AC8A,AC41A,BC8A,BC41A ARE DELETED	13.10.23	NK	SIDDHI
R1	REVISED AS MARKED	10.10.23	NK	SIDDHI
REV.	DESCRIPTION	DATE	DWN.	CHKD.
GRADE OF CONCRETE :-		- M25		
GRADE OF STEEL :-		- Fe500		
ENVIRONMENTAL EXPOSURE CONDITION :-		- MODERATE		
DESIGN LIVE LOAD :- (UNLESS SPECIFIED)		-		
S.B.C. :-				

PROJECT : PROPOSED RESORT @ PALI, RAIGARH (RESIDENTIAL BLOCK - 1A & 1B)

CLIENT : MELLORA INFRASTRUCTURE

ARCHITECT : STUDIO HUMANE

DRAWING TITLE : COLUMN LINKS DETAILS

SCALE	DWN.BY	CHK.BY	DATE	JOB NO.
N.T.S.	Nandkumar	SIDDHI	15.09.2023	ASC-2544