


COLUMN FROM EIGHTH FLOOR LVL. TO NINTH FLOOR LVL.	CONCRETE MIX – M30	● 16–12T ⊗ 8–10T	● 14–12T ⊗ 12–10T	● 28–12T	● 16–12T ⊗ 8–10T	● 24–12T	● 20–12T	● 16–12T ⊗ 16–10T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
		● 24–12T	● 14–12T ⊗ 12–10T	● 28–12T	● 24–12T	● 12–16T ⊗ 12–12T	● 12–16T ⊗ 8–12T	● 16–12T ⊗ 16–10T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM SEVENTH FLOOR LVL. TO EIGHTH FLOOR LVL.	CONCRETE MIX – M30	● 24–12T	● 14–12T ⊗ 12–10T	● 28–12T	● 24–12T	● 12–16T ⊗ 12–12T	● 12–16T ⊗ 8–12T	● 16–12T ⊗ 16–10T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
		● 20–16T ⊗ 4–12T	● 26–12T	● 28–12T	● 4–16T ⊗ 20–12T	● 8–20T ⊗ 16–16T	● 8–20T ⊗ 12–16T	● 16–12T ⊗ 16–10T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM SIXTH FLOOR LVL. TO SEVENTH FLOOR LVL.	CONCRETE MIX – M30	● 20–16T ⊗ 4–12T	● 26–12T	● 28–12T	● 4–16T ⊗ 20–12T	● 8–20T ⊗ 16–16T	● 8–20T ⊗ 12–16T	● 16–12T ⊗ 16–10T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
		● 20–16T ⊗ 4–12T	● 26–12T	● 28–12T	● 4–16T ⊗ 20–12T	● 8–20T ⊗ 16–16T	● 8–20T ⊗ 12–16T	● 32–12T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM FIFTH FLOOR LVL. TO SIXTH FLOOR LVL.	CONCRETE MIX – M30	● 20–16T ⊗ 4–12T	● 26–12T	● 28–12T	● 4–16T ⊗ 20–12T	● 8–20T ⊗ 16–16T	● 8–20T ⊗ 12–16T	● 32–12T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
		● 24–16T	● 26–12T	● 28–16T	● 4–16T ⊗ 20–12T	● 24–20T	● 8–20T ⊗ 12–16T	● 32–12T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM FOURTH FLOOR LVL. TO FIFTH FLOOR LVL.	CONCRETE MIX – M30	● 24–16T	● 26–12T	● 28–16T	● 4–16T ⊗ 20–12T	● 24–20T	● 8–20T ⊗ 12–16T	● 32–12T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
		● 24–16T	● 26–12T	● 28–16T	● 4–16T ⊗ 20–12T	● 24–20T	● 8–20T ⊗ 12–16T	● 32–12T	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	COL. RING/LINK 8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN		TA–C1, TA–C4	TA–C2, TA–C3	TA–C34, TA–C35	TA–C33, TA–C36	TA–C29	TA–C5	TA–C23							

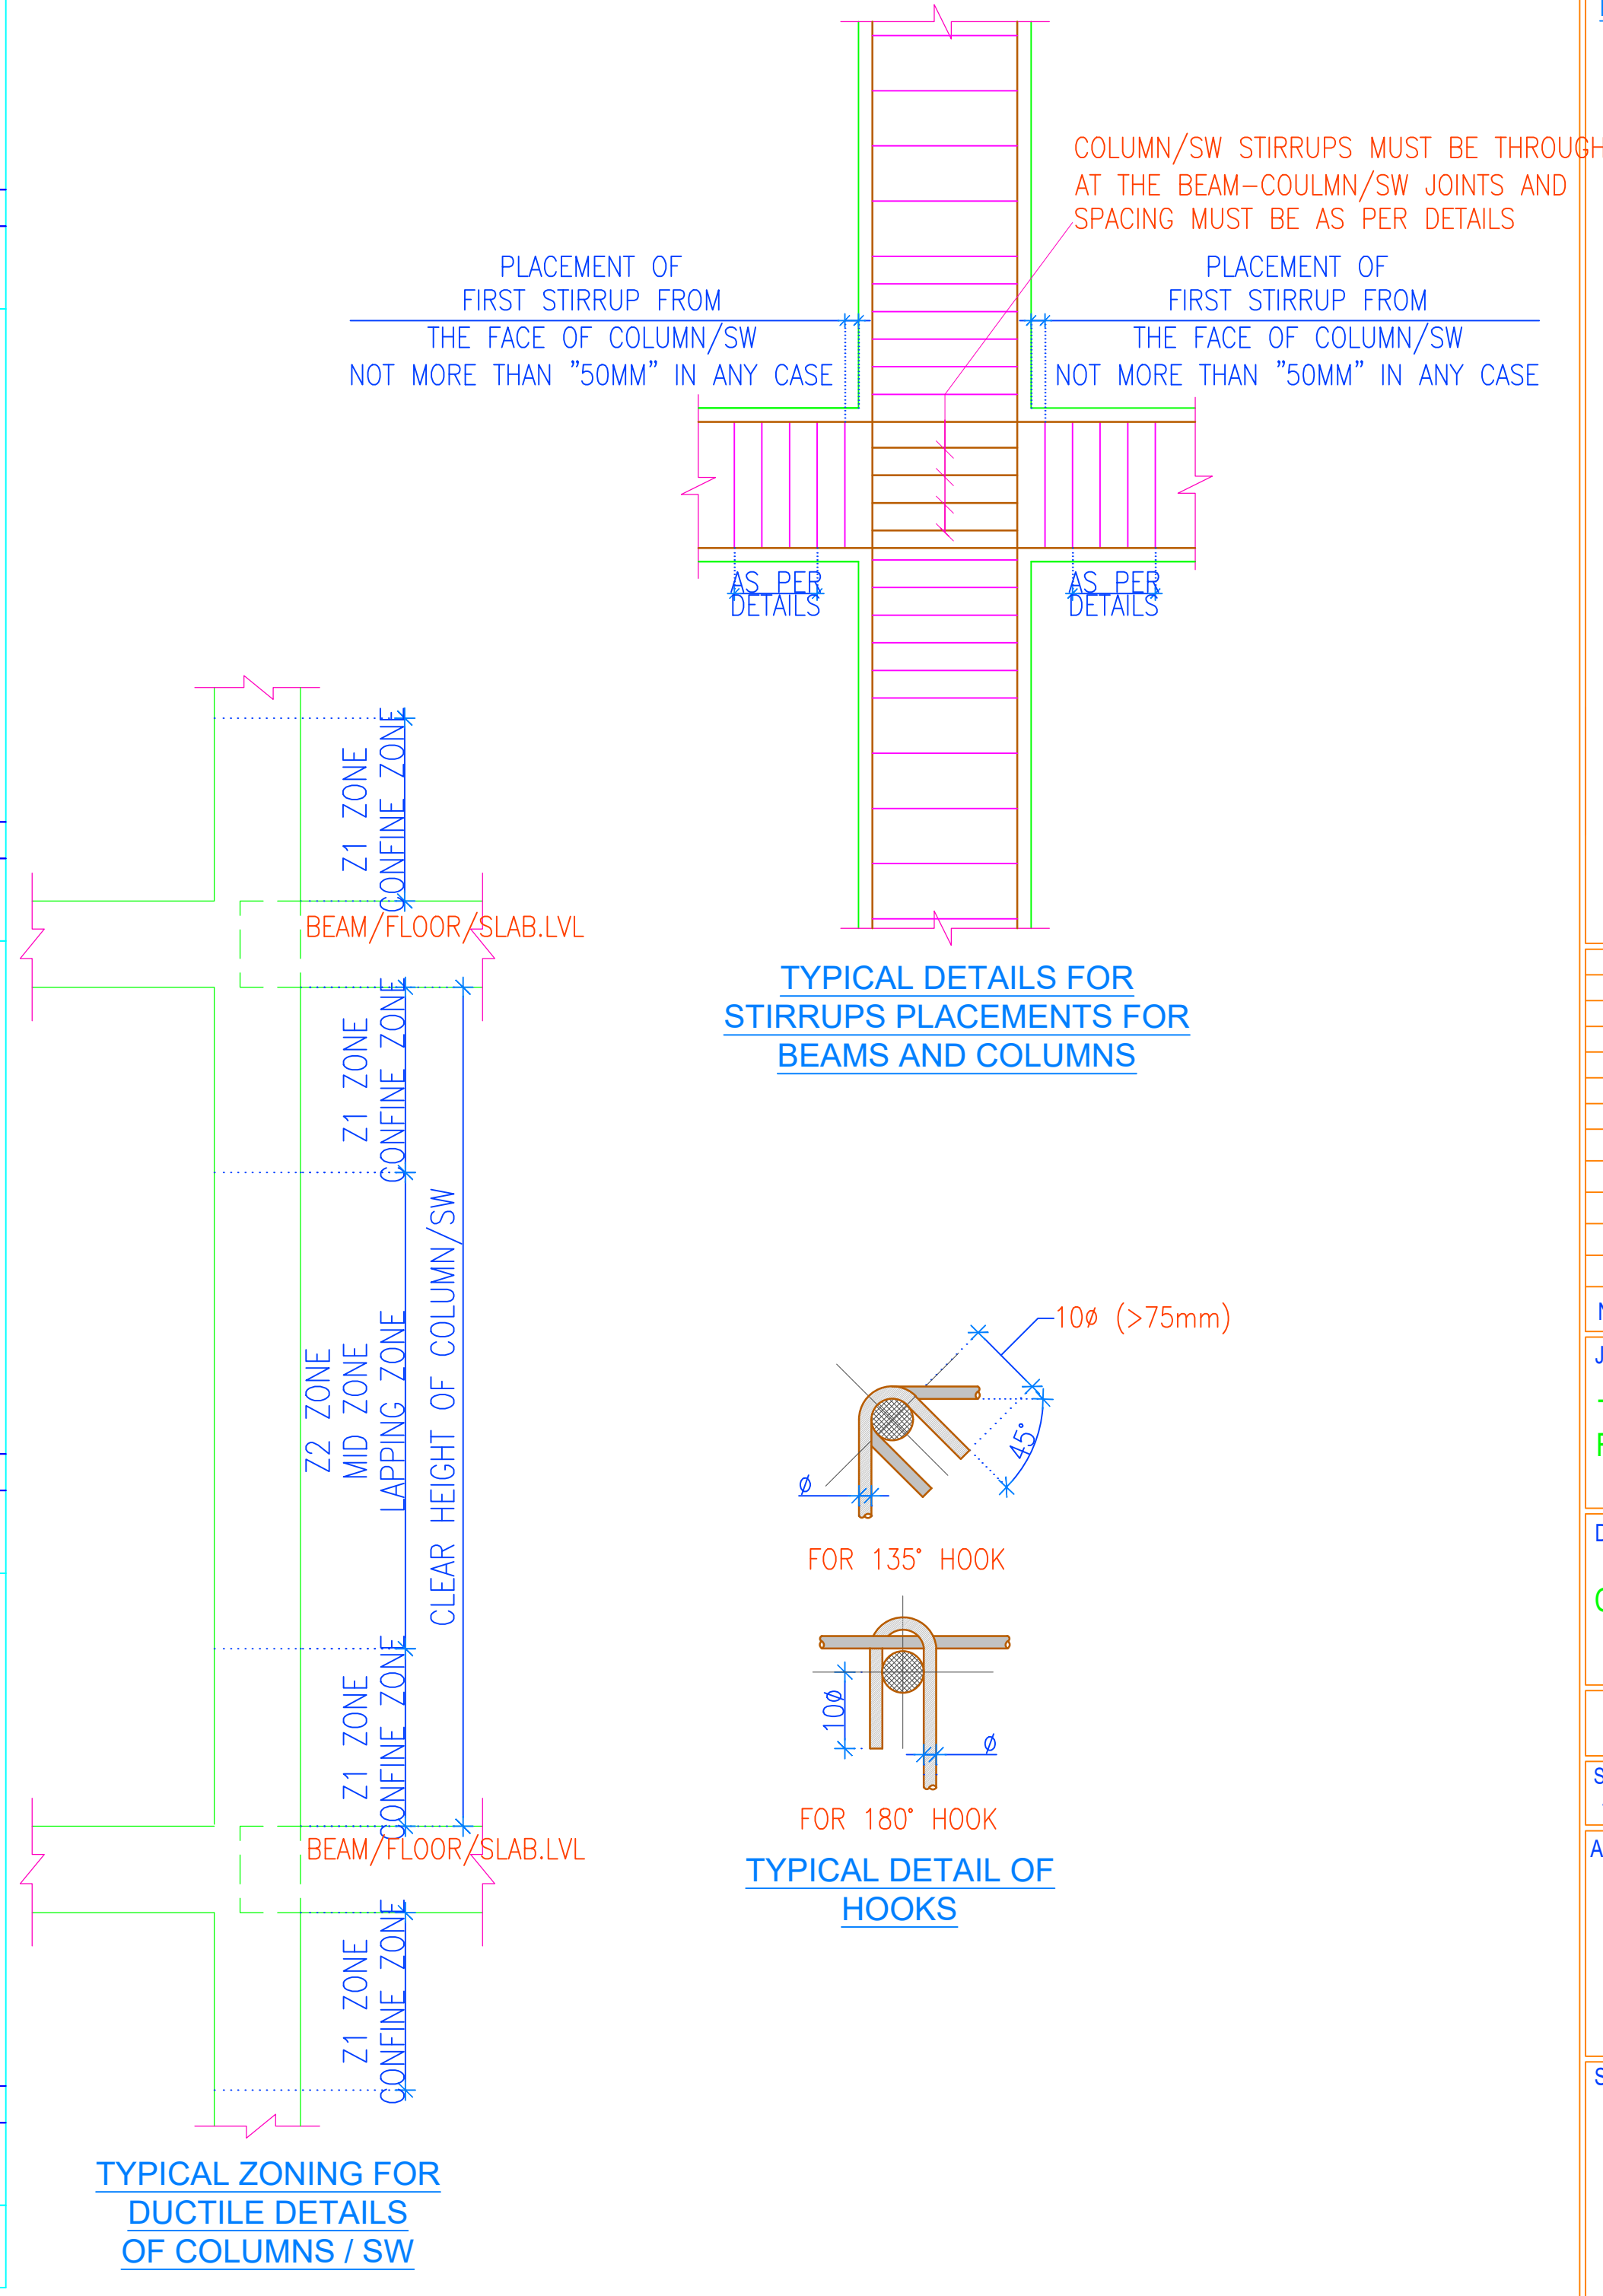

GENERAL NOTES :-

1. ALL DIMENSIONS ARE IN MM.

2. FOR ALL NOTES, REFER OUR DRG NO: S0-01 TO S0-08.

3. CEMENT SHALL BE OPC 43 GRADE OR HIGHER / AS PER TENDER SPECIFICATIONS & PORTABLE WATER SHOULD BE USE.

4. SUPERVISION SHALL NOT BE OUR RESPONSIBILITY.

5. TO TAKE OUT THE CUBE AND MATERIAL TESTING SHALL BE CONTRACTOR/ BUILDER/CLIENTS RESPONSIBILITY.

6. LOAD TESTING OF STRUCTURE SHALL NOT BE OUR RESPONSIBILITY.

7. ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED

8. T OR # INDICATE STEEL FE 500D GRADE TMT BARS.

9. ALL CONC.MIX. M:30 UNLESS OTHERWISE SPECIFIED.

10.LD = DEVELOPMENT LENGTH : 50 X ϕ ; WHERE, ϕ = DIA. OF BAR.

11.ALL BRICK WORK SHALL BE IN C.M. (1:6)

12.STRUCTURAL LAY OUT SHOULD BE REFER ONLY FOR STRUCTURAL DETAILING.

13.PLEASE REFER ARCHITECTURAL DWG FOR LVLS. & SETTINGS OUT CENTERLINE DIMENSIONS. THE CENTERLINE PUT IN THIS STRUCTURAL FOUNDATION LAYOUT IS SIMPLY INDICATIVE OF LOCATION AND AS APPROVED BY ARCHITECT.

14.PLEASE REFER ARCH. DWG. FOR FINAL LAY OUT.

15.CONTRACTOR SHOULD INFORM ARCHITECT/STRUCTURAL CONSULTANT IN CASE OF ANY CHANGE IN EXISTING CONDITION FOUND, IMMEDIATELY

16.THIS DRG. SHOULD BE READ ALONG WITH ARCHITECTURAL DRGS.AND ANY CHANGES/DEVIATION FOUND SHOULD BE IMMEDIATELY BROUGHT TO NOTICE OF ARCHITECT & STR. ENGINEER

17.THIS DWG.SHOULD BE READ ALONG WITH RELEVANT DETAILS

18.MIX DESIGN SHOULD BE GOT APPROVED PRIOR TO EXECUTION OF WORK

19.ALL STEEL (TOP/BOTTOM) OF DIFFERENT ZONE SHALL BE LAPPED IN ADDITION WHERE THE ZONE TERMINATES; BY LENGTH EQUAL TO THE DEVELOPMENT LENGTH OF HIGHER DIA BAR.

KEY PLAN

GRADE OF CONCRETE

ALL STRUCTURAL ELEMENTS	M30
-------------------------	-----

CONCRETE COVER

FOOTINGS /RAFT	50MM
COLUMNS/SW	40MM
BEAMS	30MM
SLABS	25MM
PARDI WALLS	30MM

1

29-12-21

GOOD FOR CONSTRUCTION

NO.	DATE	REVISION / REMARK	BY	DR	CH

JOB TITLE / DEVELOPER

TURQUOISE-GRANDEUR
RATANA DEVELOPERS

DRAWING TITLE

COLUMN SCHEDULE DETAIL - TOWER-A

JOB NO	DATE	DRG. NO.	REVISION
2111	16/04/2021	S5-TA-02	R0

SCALE	SHEET SIZE	DRAWN	DESIGN	CHECKED
1: 100	A1/A2/A3	AKSHAY	KUNJ	BHAVIK PATEL

ARCHITECTS

HM ARCHITECTS
e:contact@hmarchitects.in

STRUCTURAL CONSULTANT

Blue Skyz
Engineers
email:blueskyzengineers@gmail.com