



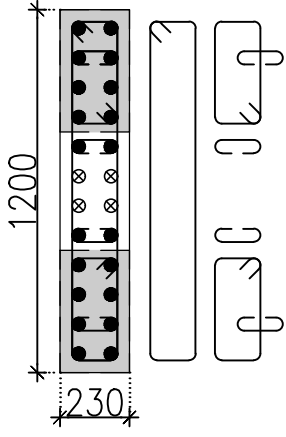


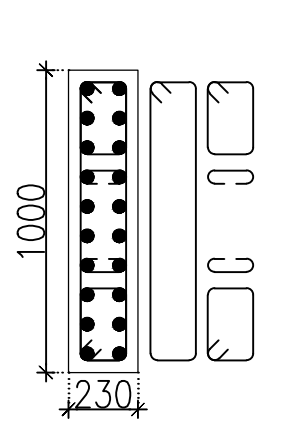



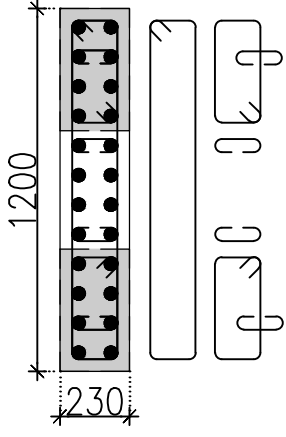


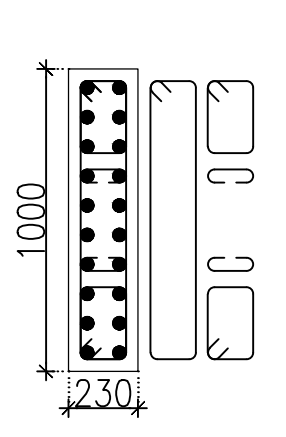



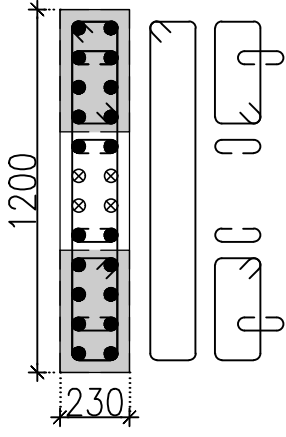


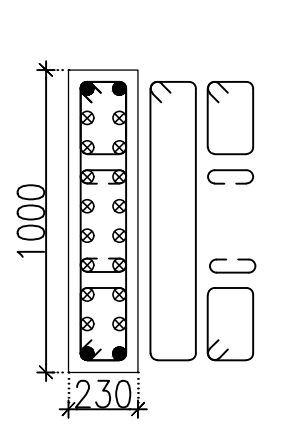



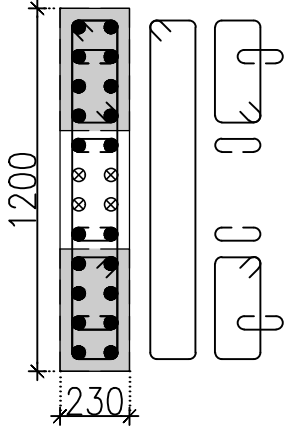


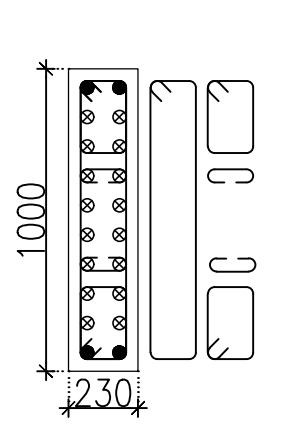

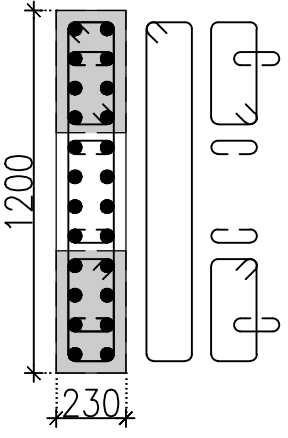
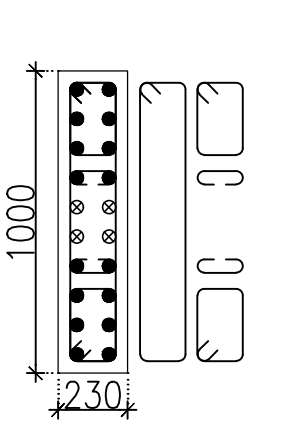
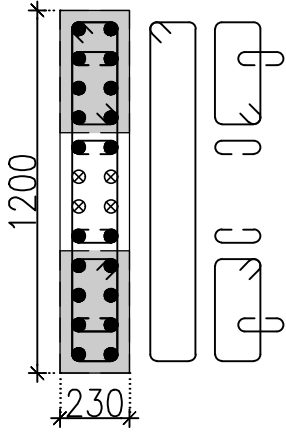
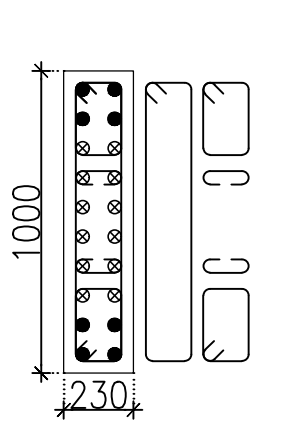
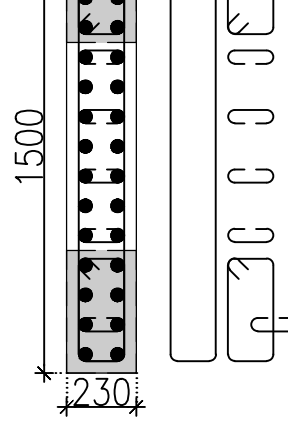
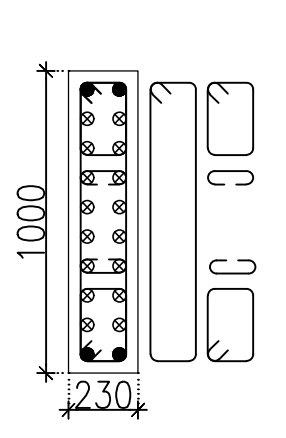
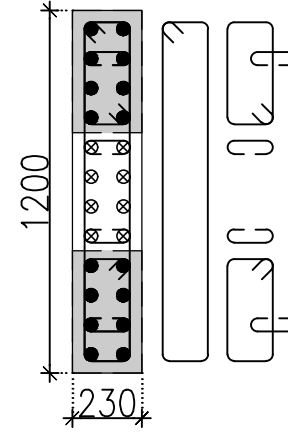


COLUMN FROM EIGHTH FLOOR LVL. TO NINTH FLOOR LVL.	CONCRETE MIX – M30	● 20–16T ⊗ 4–12T 	● 16–16T ⊗ 4–12T 	● 20–16T ⊗ 4–12T 	● 4–16T ⊗ 16–12T 	● 16–12T ⊗ 14–10T 	● 20–12T 	● 24–12T 
		COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
		8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM SEVENTH FLOOR LVL. TO EIGHTH FLOOR LVL.	CONCRETE MIX – M30	● 20–16T ⊗ 4–12T 	● 20–16T 	● 24–16T 	● 20–16T 	● 16–12T ⊗ 14–10T 	● 20–12T 	● 16–16T ⊗ 8–12T 
		COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
		8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM SIXTH FLOOR LVL. TO SEVENTH FLOOR LVL.	CONCRETE MIX – M30	● 24–16T 	● 16–20T ⊗ 4–16T 	● 20–20T ⊗ 4–16T 	● 8–20T ⊗ 12–16T 	● 30–12T 	● 4–16T ⊗ 16–12T 	● 8–20T ⊗ 16–16T 
		COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
		8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM FIFTH FLOOR LVL. TO SIXTH FLOOR LVL.	CONCRETE MIX – M30	● 4–20T ⊗ 20–16T 	● 16–20T ⊗ 4–16T 	● 20–20T ⊗ 4–16T 	● 8–20T ⊗ 12–16T 	● 30–12T 	● 4–16T ⊗ 16–12T 	● 8–20T ⊗ 16–16T 
		COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
		8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN FROM FOURTH FLOOR LVL. TO FIFTH FLOOR LVL.	CONCRETE MIX – M30	● 24–20T 	● 16–20T ⊗ 4–16T 	● 20–20T ⊗ 4–16T 	● 8–20T ⊗ 12–16T 	● 30–12T 	● 4–16T ⊗ 16–12T 	● 16–20T ⊗ 8–16T 
		COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK	COL. RING/LINK
		8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)	8T–150 C/C (8 NOS.–Z1) 8T–150 C/C (AT MID–Z2)
COLUMN		TA–C6, TA–C30	TA–C7, TA–C31	TA–C8, TA–C32	TA–C10, TA–C11, TA–C26, TA–C27	TA–C13	TA–C14, TA–C24	TA–C9, TA–C25


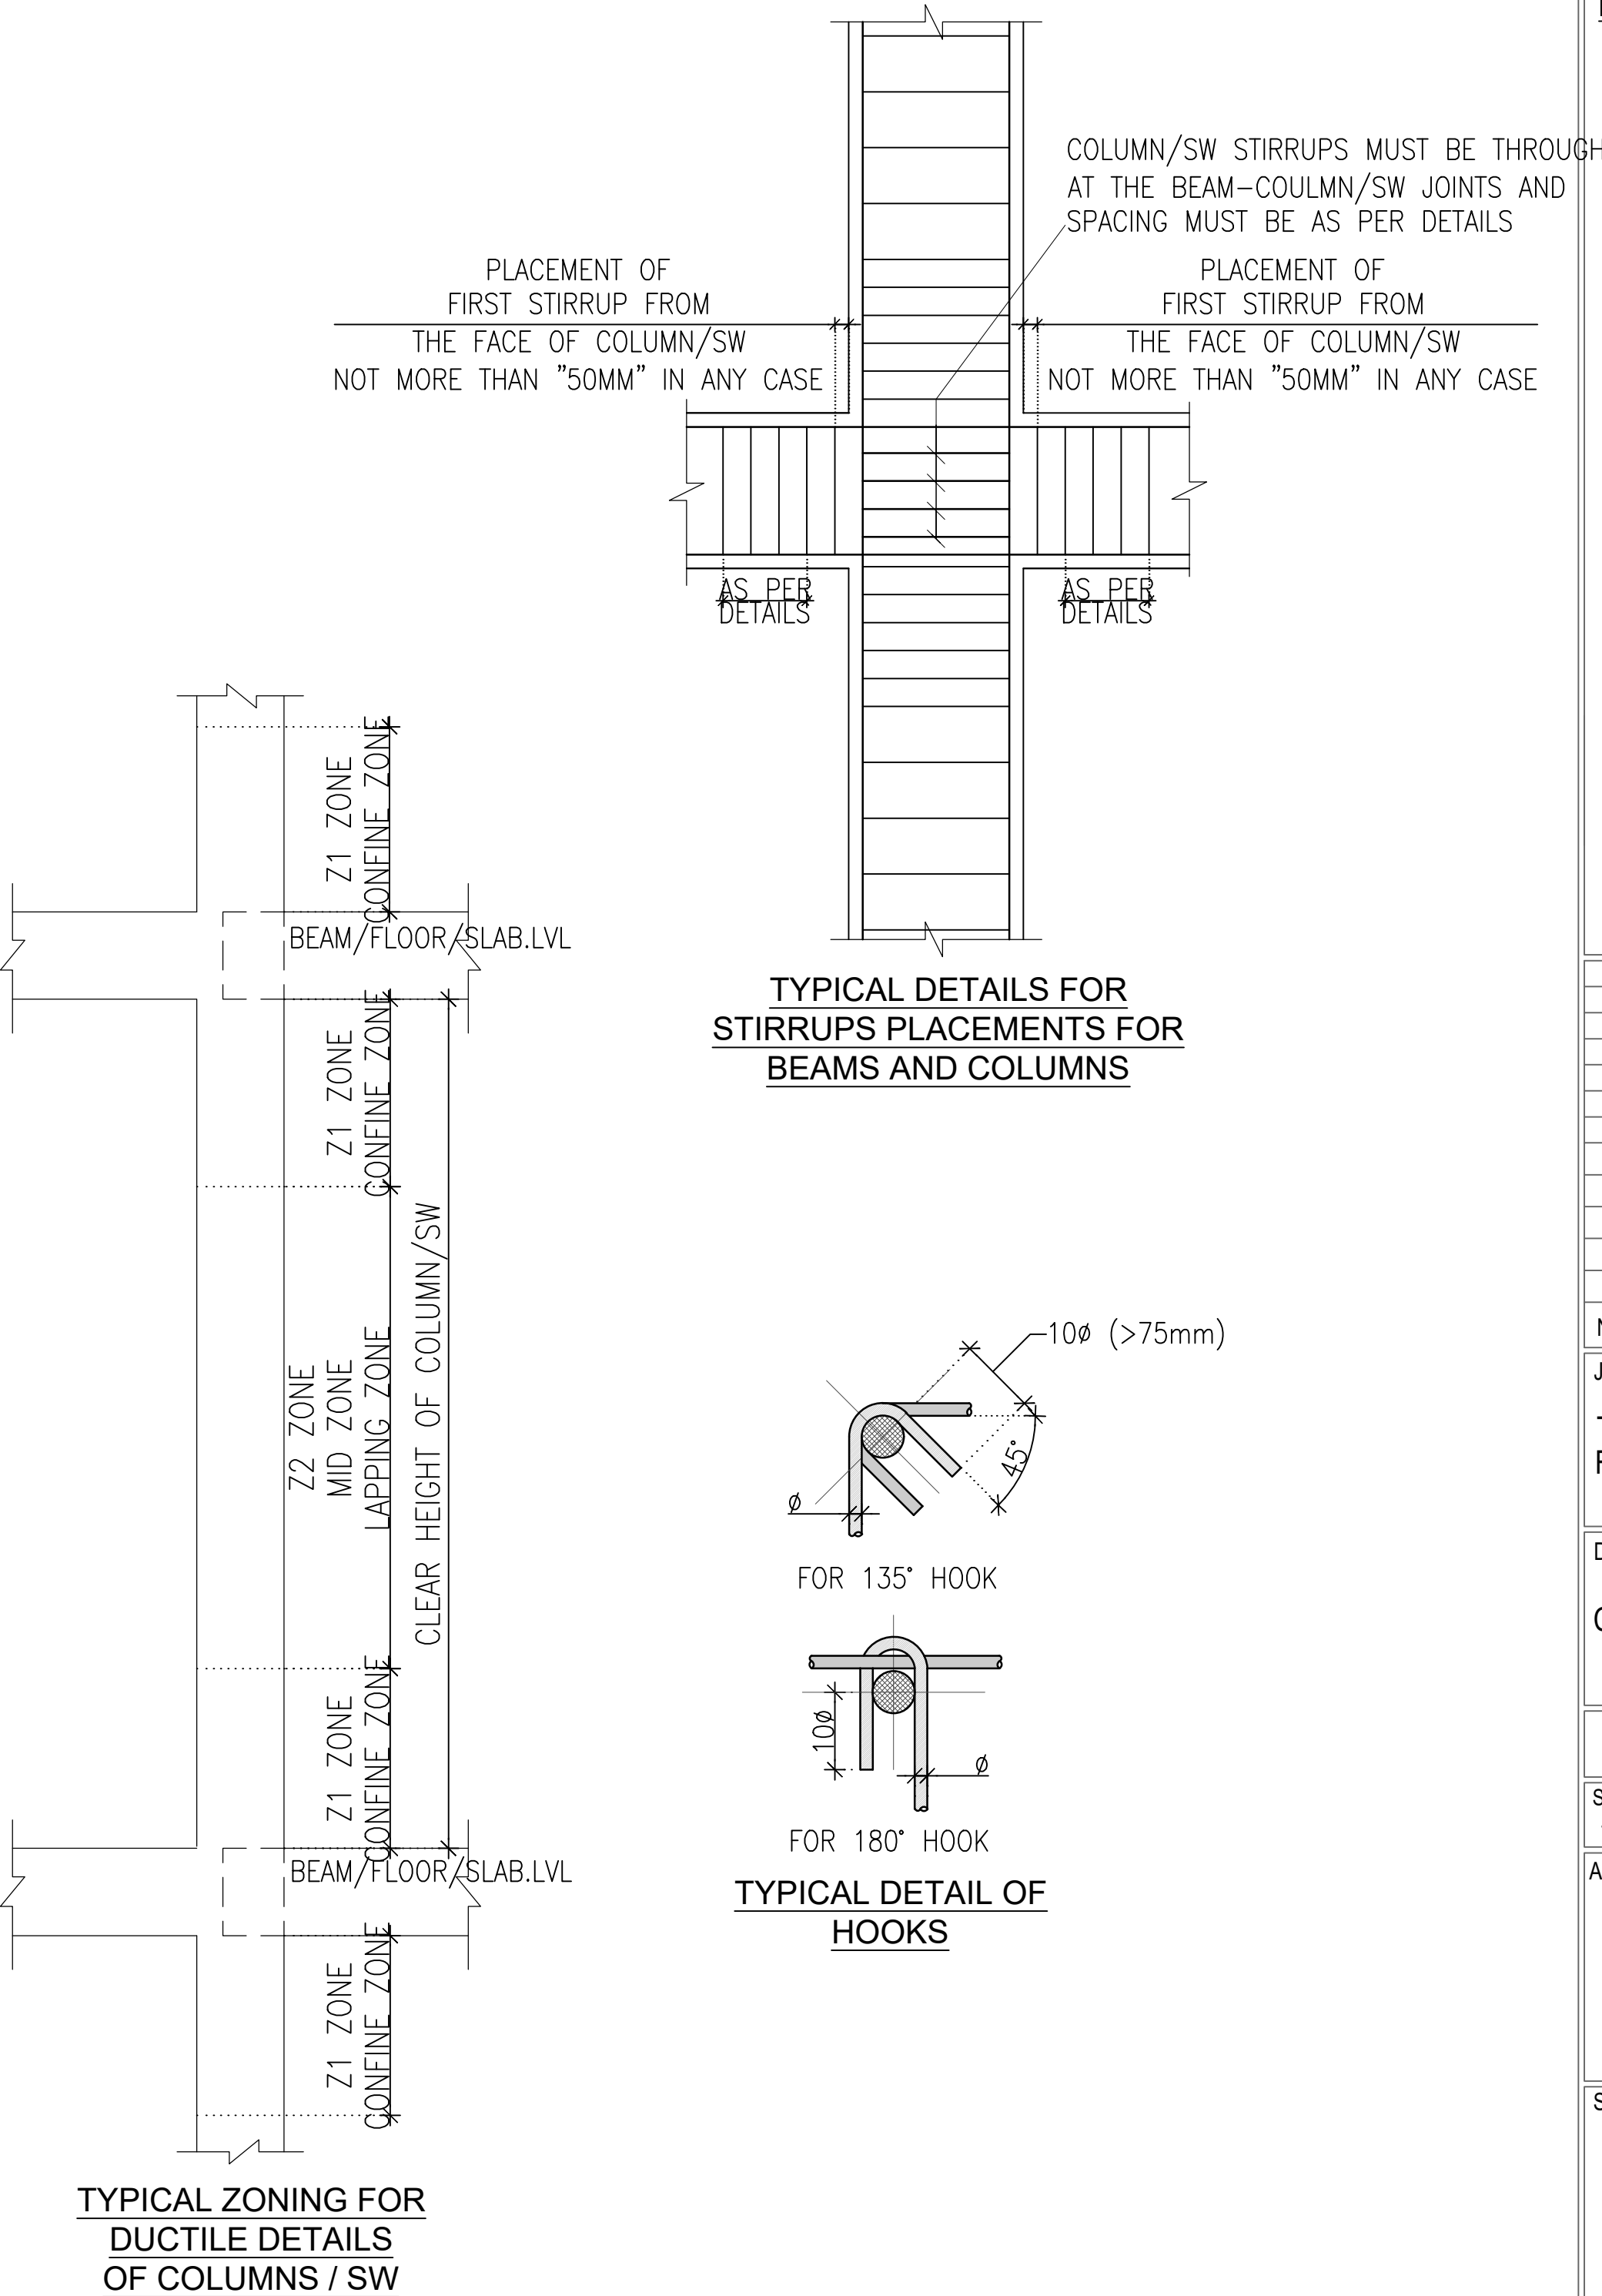


- GENERAL NOTES :-**
- ALL DIMENSIONS ARE IN MM.
 - FOR ALL NOTES, REFER OUR DRG NO: S0–01 TO S0–09.
 - CEMENT SHALL BE OPC 43 GRADE OR HIGHER / AS PER TENDER SPECIFICATIONS & PORTABLE WATER SHOULD BE USE.
 - SUPERVISION SHALL NOT BE OUR RESPONSIBILITY.
 - TO TAKE OUT THE CUBE AND MATERIAL TESTING SHALL BE CONTRACTOR/ BUILDER/CLIENTS RESPONSIBILITY.
 - LOAD TESTING OF STRUCTURE SHALL NOT BE OUR RESPONSIBILITY.
 - ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED
 - T OR # INDICATE STEEL FE 500D GRADE TMT BARS.
 - ALL CONC.MIX. M:30 UNLESS OTHERWISE SPECIFIED.
 - LD = DEVELOPMENT LENGTH : 50 X φ; WHERE, φ = DIA. OF BAR.
 - ALL BRICK WORK SHALL BE IN C.M. (1:6)
 - STRUCTURAL LAY OUT SHOULD BE REFER ONLY FOR STRUCTURAL DETAILING.
 - PLEASE REFER ARCHITECTURAL DWG FOR LVLS. & SETTINGS OUT CENTERLINE DIMENSIONS. THE CENTERLINE PUT IN THIS STRUCTURAL FOUNDATION LAYOUT IS SIMPLY INDICATIVE OF LOCATION AND AS APPROVED BY ARCHITECT.
 - PLEASE REFER ARCH. DWG. FOR FINAL LAY OUT.
 - CONTRACTOR SHOULD INFORM ARCHITECT/STRUCTURAL CONSULTANT IN CASE OF ANY CHANGE IN EXISTING CONDITION FOUND, IMMEDIATELY
 - THIS DRG. SHOULD BE READ ALONG WITH ARCHITECTURAL DRGS.AND ANY CHANGES/DEVIATION FOUND SHOULD BE IMMEDIATELY BROUGHT TO NOTICE OF ARCHITECT & STR. ENGINEER
 - THIS DWG.SHOULD BE READ ALONG WITH RELEVANT DETAILS
 - MIX DESIGN SHOULD BE GOT APPROVED PRIOR TO EXECUTION OF WORK
 - ALL STEEL (TOP/BOTTOM) OF DIFFERENT ZONE SHALL BE LAPPED IN ADDITION WHERE THE ZONE TERMINATES; BY LENGTH EQUAL TO THE DEVELOPMENT LENGTH OF HIGHER DIA BAR.

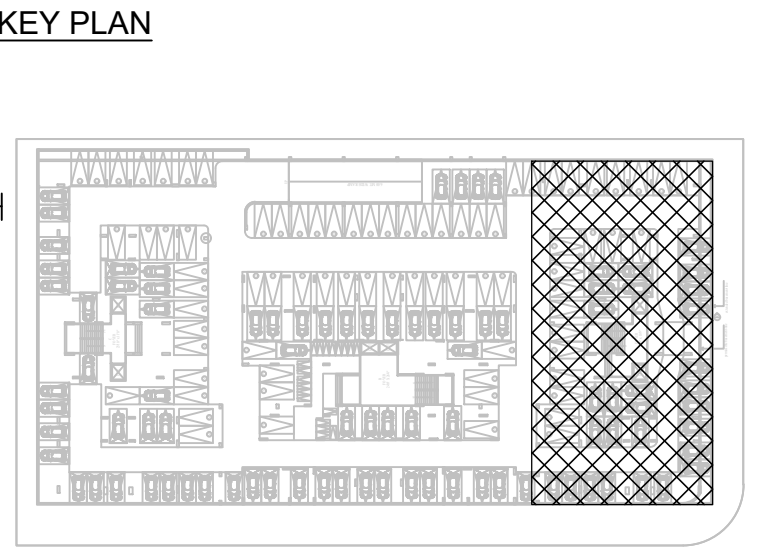

GRADE OF CONCRETE	
ALL STRUCTURAL ELEMENTS	M30

CONCRETE COVER	
FOOTINGS /RAFT	50MM
COLUMNS/SW	40MM
BEAMS	30MM
SLABS	25MM
PARDI WALLS	30MM

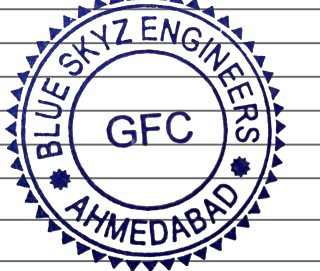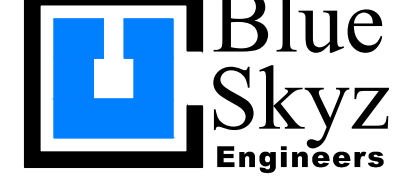			
1	29-12-21	GOOD FOR CONSTRUCTION	
NO.	DATE	REVISION / REMARK	BY DR CH
JOB TITLE / DEVELOPER			
TURQUOISE-GRANDEUR RATANA DEVELOPERS			
DRAWING TITLE			
COLUMN SCHEDULE DETAIL - TOWER-A			
JOB NO 2111	DATE 16/04/2021	DRG. NO. S5-TA-05	REVISION R0
SCALE 1 : 100	SHEET SIZE A1/A2/A3	DRAWN AKSHAY	CHECKED BHAVIK PATEL
ARCHITECTS			
 HM ARCHITECTS e:contact@hmarchitects.in			
STRUCTURAL CONSULTANT			
 email:blueskyzengineers@gmail.com			