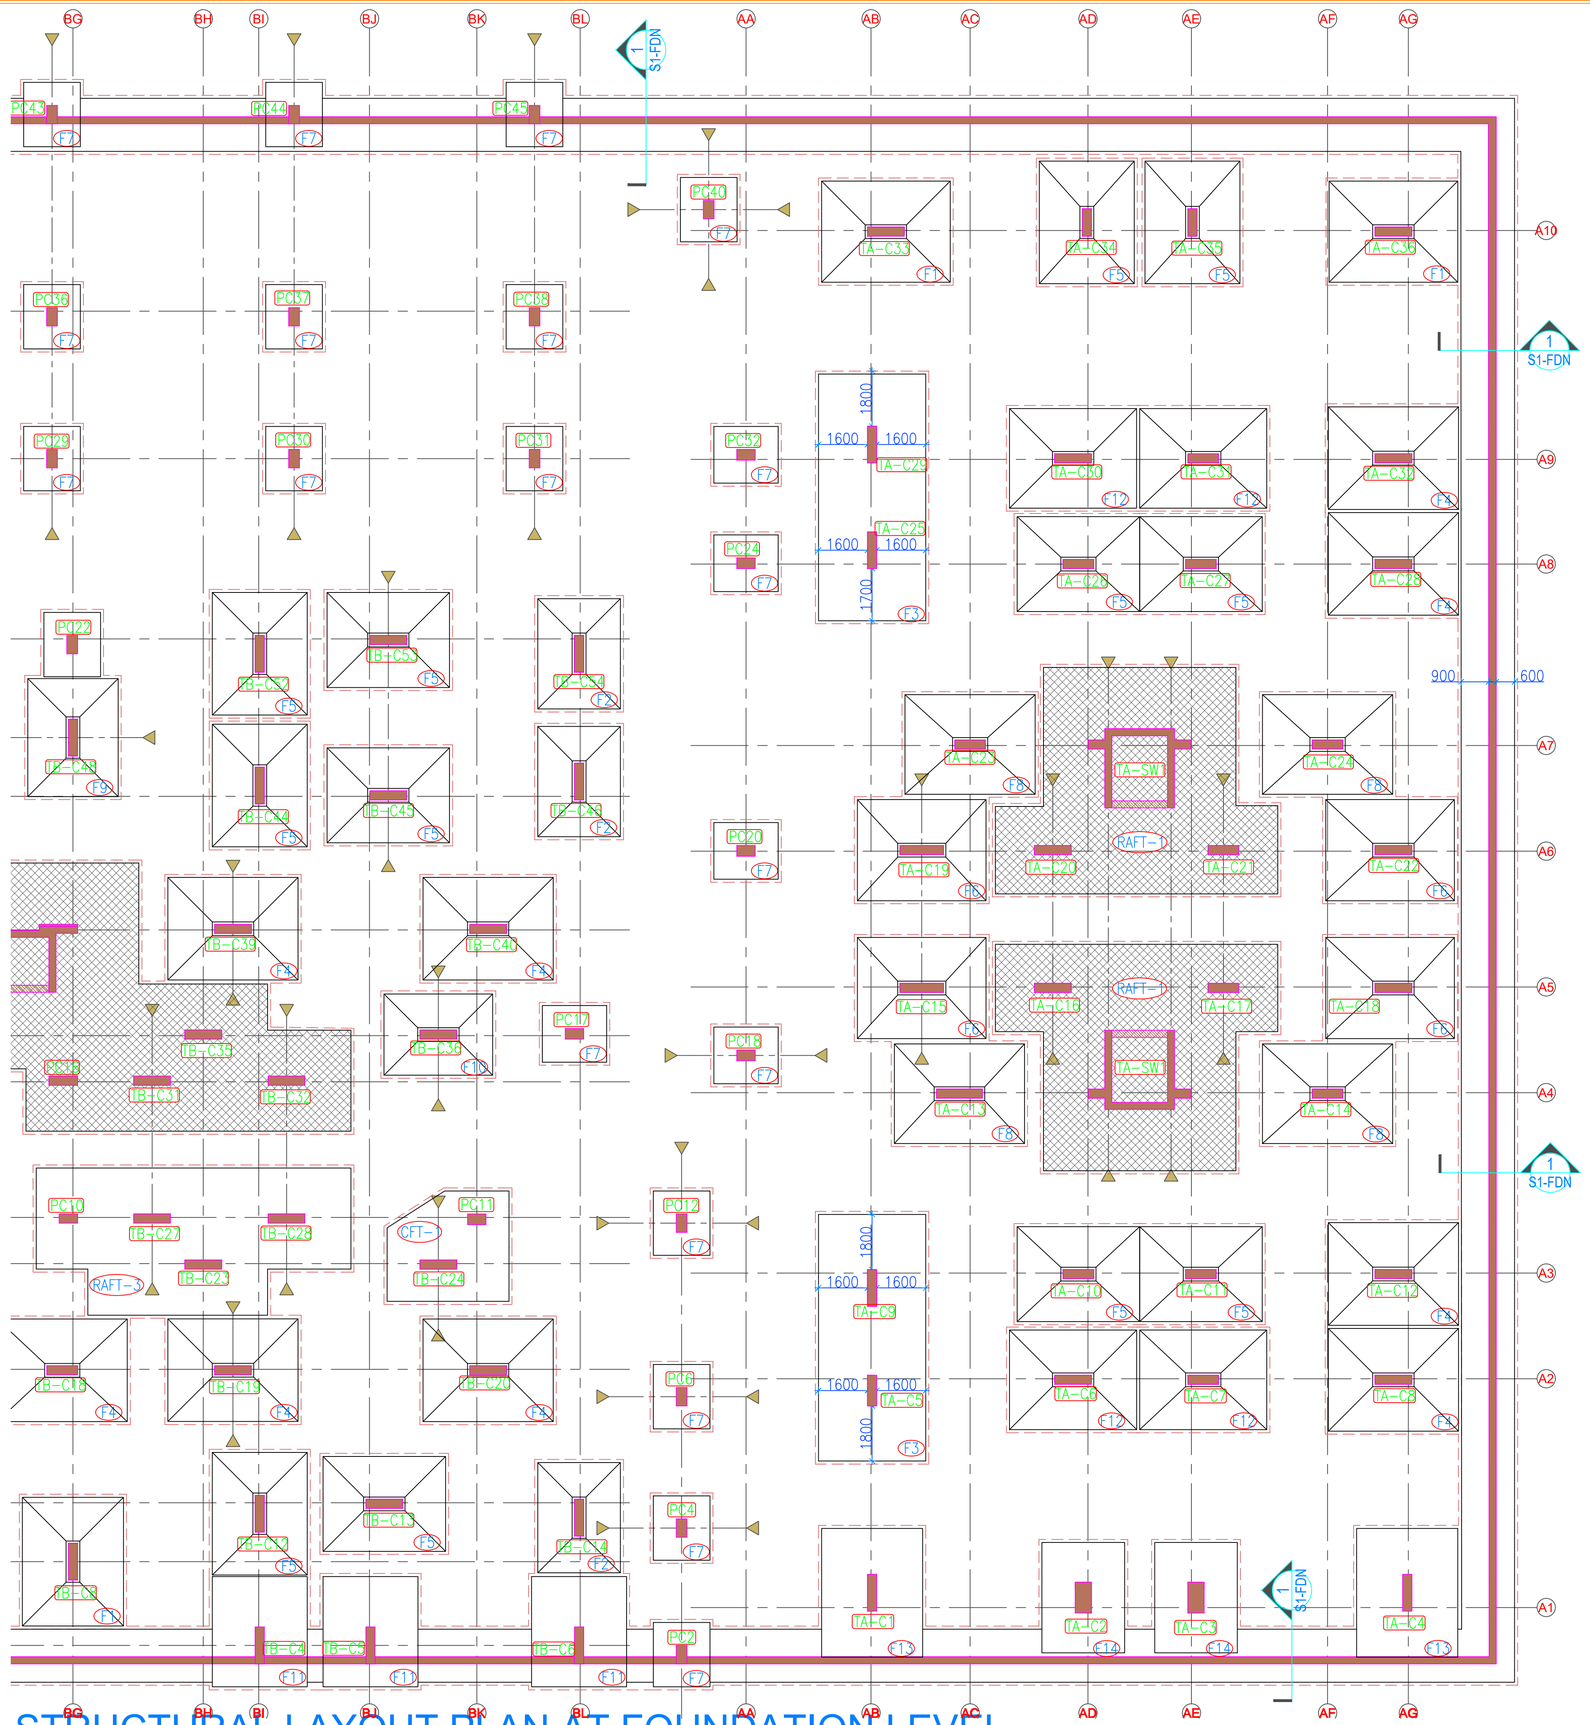


STRUCTURAL LAYOUT PLAN AT FOUNDATION LEVEL

*ALL CENTERLINE & COLUMNS / SW LOCATIONS AS PER ARCHITECTURAL DRAWINGS.

*COLUMNS / SW SIZES & R/F. SHOULD BE AS PER STRUCTURAL DRAWINGS ONLY.

COLUMN SIZES (BLOCK - A)

COLUMN MARK	SIZES
TA-C1, TA-C4, TA-C6, TA-C8, TA-C9, TA-C12, TA-C16, TA-C18, TA-C20, TA-C22, TA-C25, TA-C28, TA-C29, TA-C30, TA-C32, TA-C33, TA-C36	300 X 1200
TA-C5, TA-C7, TA-C10, TA-C11, TA-C14, TA-C17, TA-C21, TA-C23, TA-C24, TA-C26, TA-C27, TA-C31	300 X 1000
TA-C2, TA-C3	530 X 1000
TA-C13	300 X 1500
TA-C15, TA-C19	300 X 1420
TA-C34, TA-C35	300 X 900
TA-SW1	AS PER SHAPE

COLUMN SIZES (NON-TOWER)

COLUMN MARK	SIZES
PC1 TO PC8, PC11 TO PC13, PC17 TO PC45	350 X 600
PC9, PC10, PC15	300 X 600
PC14	350 X 900
PC16	300 X 935

LEGEND

	COLUMN/WALL
	WALL STOPS AS PER PROFILE
	FOOTING AT DEFERENT LEVEL
	FOOTING LINE
	P.C.C LINE

GENERAL NOTES :

1. ALL DIMENSIONS ARE IN MM.
2. ALL DIMENSIONS SHALL BE READ & NOT TO BE MEASURED.
3. ALL CONCRETING WORK SHALL BE CARRIED OUT WITH READY MIX OPC CONCRETE ONLY.
4. **FOR FILLING OF SUNK OR FOR LANDSCAPING ON STRUCTURAL ELEMENTS MUST BE BY LIGHT WEIGHT CINDER FILLING ONLY HAVING THE DENSITY LESS THAN 6kN/M³.**
5. REMOVAL OF FRAMEWORK SHALL BE ONLY AFTER, ONCE CONCRETE GET MATURED ENOUGH.

SBC NOTES :

1. NET SOIL BEARING CAPACITY IS CONSIDERED AS 350 kN/m² FROM SOIL REPORT SUBMITTED BY KBM ENGINNERING CONSULTANCY SERVICES.
2. GROSS SBC IS CONSIDERED AS 440 kN/m² FOR FOUNDATION DESIGN.
3. PARTIAL PERCENTAGE OF BEARING CAPACITY INCREMENT SHALL BE CONSIDERED FOR EARTHQUAKE FORCES.
4. DE-WATERING SHALL BE APPLICABLE IN CASE OF WATER TABLE FOUND AT FOUNDATION LEVEL BEFORE PACING OF CONCRETE.
5. SURFACE OF EXCAVATION SHALL BE LEVELED PROPERLY BEFORE PCC WORK.
6. RUBBLE SOLING IS RECOMMENDED, IF SOIL IS FOUND AS SANDY OR IF WATER TABLE IS PRESENCE.

* MEPF NOTES:

1. **ANY MEPF INPUTS SUCH AS DRAIN CHANNELS, SUMP, MECHANICAL VENTILATION OR ANY KIND OF CUTOUTS OR SLEEVES SHOULD REQUIRE TO FINALIZED THE FRAMING BEFORE EXECUTION GFC DRAWINGS AT SITE TO AVOID ANY MISCELLANEOUS ACTIVITY IN STRUCTURAL ELEMENTS. CUTOUTS IN STRUCTURAL ELEMENTS ARE STRICTLY PROHIBITED WITH OUT PRIOR CONCERN TO THE STRUCTURAL DESIGNER.**
2. **ARCHITECT SHOULD HAVE TO REVIEW AND GIVE APPROVAL PRIOR TO GFC WORKING DRAWINGS. GFC SHALL BE ISSUED CONSIDERING THE FORMAL APPROVAL FROM ARCHITECT ONLY.**

IMPORTANT NOTES FOR JOINERY (RETAINING WALL / D-WALL)

1. BEAMS/SLABS THOSE ARE MEETING TO THE D-WALL/RETAINING WALL DIRECTLY MUST BE REBAR/EMBEDDED TO D-WALL/RETAINING WALL TO ACHIEVE THE PROPER BONDING AND CONNECTIVITY VICE-VERSA.
2. REINFORCEMENTS FROM THE D-WALL/RETAINING WALL SHALL BE BEND & CONNECTED WITHIN THE FLOORS/SLABS TO ACHIEVE PROPER MONOLITHIC JOINT.
3. THE GAP BETWEEN THE D-WALL/RETAINING WALL AND STRUCTURAL COLUMNS/SW IF ANY SHALL BE FILLED UP WITH THE PLUM CONCRETE WHERE EVER REQUIRED.
4. CUTTING, DRILLING, CHIPPING, RUBBING ETC. TO ANY STRUCTURAL MEMBERS/ELEMENTS SHALL BRING IN NOTICE TO STRUCTURAL CONSULTANTS PRIOR TO DO SO.
5. **BACK FILLING OF SOIL MUST NOT BE DONE, BEFORE MONOLITHIC CONNECTION OF RETAINING WALL WITH GROUND FLOOR. REFER THE RETAINING WALL SECTION IN DETAIL.**
6. **REMOVAL OF SHUTTERING SHALL BE DONE ONLY AFTER THE PROPER MATURING OF CONCRETE. PRE-MATURE REMOVAL OF SHUTTERING IS NOT AT ALL PERMITTED. FOR REMOVAL OF SHUTTERING PERIODS, PLEASE REFER OUR GENERAL NOTES.**


PAINT/FINISHING NOTES:

1. IMPERVIOUS FIRE PROTECTED/RESISTANCE PAINT/PLASTER SHALL BE STRONGLY RECOMMENDED FOR THE FINISHING WORKS IN THE BASEMENTS.

GENERAL NOTES :-

1. ALL DIMENSIONS ARE IN MM.
2. FOR ALL NOTES, REFER OUR DRG NO: S0-01 TO S0-09.
3. CEMENT SHALL BE OPC 43 GRADE OR HIGHER / AS PER TENDER SPECIFICATIONS & PORTABLE WATER SHOULD BE USE.
4. SUPERVISION SHALL NOT BE OUR RESPONSIBILITY.
5. TO TAKE OUT THE CUBE AND MATERIAL TESTING SHALL BE CONTRACTOR/ BUILDER/CLIENTS RESPONSIBILITY.
6. LOAD TESTING OF STRUCTURE SHALL NOT BE OUR RESPONSIBILITY.
7. ALL DIMENSIONS ARE TO BE READ AND NOT TO BE MEASURED
8. T OR # INDICATE STEEL FE 500D GRADE TMT BARS.
9. ALL CONC.MIX. M:30 UNLESS OTHERWISE SPECIFIED.
10. LD = DEVELOPMENT LENGTH : 50 X ϕ; WHERE, ϕ = DIA. OF BAR.
11. ALL BRICK WORK SHALL BE IN C.M. (1:6)
12. STRUCTURAL LAY OUT SHOULD BE REFER ONLY FOR STRUCTURAL DETAILING.
13. PLEASE REFER ARCHITECTURAL DWG FOR LVLS. & SETTINGS OUT CENTERLINE DIMENSIONS. THE CENTERLINE PUT IN THIS STRUCTURAL FOUNDATION LAYOUT IS SIMPLY INDICATIVE OF LOCATION AND AS APPROVED BY ARCHITECT.
14. PLEASE REFER ARCH. DWG. FOR FINAL LAY OUT.
15. CONTRACTOR SHOULD INFORM ARCHITECT/STRUCTURAL CONSULTANT IN CASE OF ANY CHANGE IN EXISTING CONDITION FOUND, IMMEDIATELY
16. THIS DRG. SHOULD BE READ ALONG WITH ARCHITECTURAL DRGS.AND ANY CHANGES/DEVIATION FOUND SHOULD BE IMMEDIATELY BROUGHT TO NOTICE OF ARCHITECT & STR. ENGINEER
17. THIS DWG.SHOULD BE READ ALONG WITH RELEVANT DETAILS
18. MIX DESIGN SHOULD BE GOT APPROVED PRIOR TO EXECUTION OF WORK
19. ALL STEEL (TOP/BOTTOM) OF DIFFERENT ZONE SHALL BE LAPPED IN ADDITION WHERE THE ZONE TERMINATES; BY LENGTH EQUAL TO THE DEVELOPMENT LENGTH OF HIGHER DIA BAR.

KEY PLAN



GRADE OF CONCRETE

ALL STRUCTURAL ELEMENTS	M30

CONCRETE COVER

FOOTINGS /RAFT	50MM
COLUMNS/SW	40MM
BEAMS	30MM
SLABS	25MM
PARDI WALLS	30MM

BLUE SKYZ ENGINEERS — GFC — AHMEDABAD

NO.	DATE	REVISION / REMARK	BY	DR	CH
2	10-12-21	GOOD FOR CONSTRUCTION			
1	08-12-21	FOR REVIEW ONLY			

JOB TITLE / DEVELOPER

TURQUOISE-GRANDEUR
RATANA DEVELOPERS

DRAWING TITLE

STRUCTURAL LAYOUT AT FOUNDATION LEVEL

JOB NO	DATE	DRG. NO.	REVISION
2111	16/04/2021	S1-FDN-03	R0

SCALE	SHEET SIZE	DRAWN	DESIGN	CHECKED
1 : 100	A1/A2/A3	BP	KUNJ	BHAVIK PATEL

ARCHITECTS

HM ARCHITECTS
e:contact@hmarchitects.in

STRUCTURAL CONSULTANT

Blue Skyz Engineers
email:blueskyzengineers@gmail.com