

ITEM NO.	RATING	WIDTH (W)	THICKNESS (T)
1	1250 AMP.	63.5	12.7
2	2000 AMP.	63.5	19
3	3150 AMP.	75	25.4

10, HOLES ϕ 13


ELECTRICAL SPECIFICATION

IEC : 60137 : 2017

- 1) Rated Voltage.....1.1kV.
- 2) Dry Power Frequency Withstand Voltage Test (One Minute).....10kV.

OTHER :-

- 1) End Copper Palm Will be Electroplated 12 to 15 Microns.
- 2) Electrolytic Copper With High Electrical Conductivity.
- 3) Colour brick red.

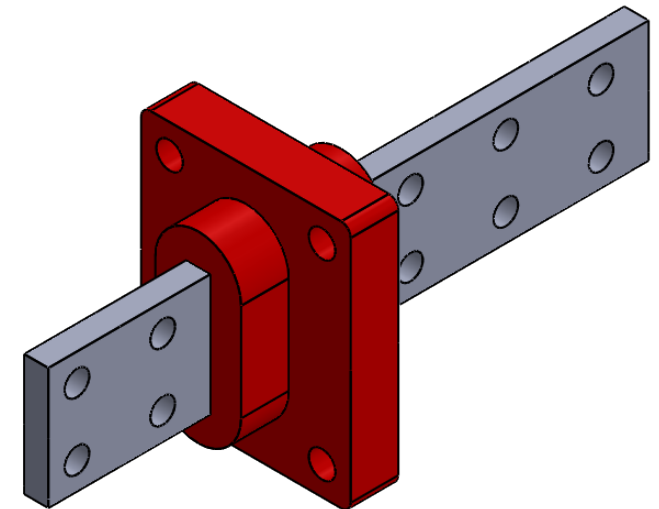

THE COPYRIGHT OF THESE DRAWINGS AND OF ALL ANNEXES WHICH ARE ENTRUSTED TO A PERSON'S CARE ALWAYS REMAIN THE PROPERTY OF OUR FIRM. THEY MUST NOT BE COPIED OR DUPLICATED. NOT SHOWN TO OR PLACED AT THE DISPOSAL OF THIRD PERSONS WITHOUT OUR WRITTEN CONSENT.

REV.	MODIFICATION	DATE	APPD

1.1kV Epoxy Bushing

MANUFACTURER
SUNSHINE ENGINEERING

Email :- sunshineengineering23@gmail.com
Mob. :- +91 7499544230

All dimensions are in mm

SCALE	NTS	REF. H-001,003,004	
DRG	UKN	PROJECTION	
CHD	Pitale		
APPD	Pitale		
DATE	18/08/22		
SE/EB01/001		Drawing No.	Rev.