


M16 x 30mm Deep Min.

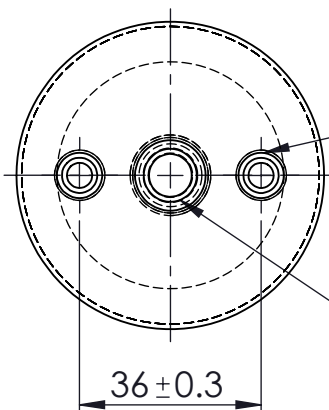

M6 x 10mm Deep Min. (2 Nos)

M10 x 20mm Deep Min.

ELECTRICAL SPECIFICATION

IS:9431-1979

- 1) Rated Voltage.....11 kV.
- 2) Dry Power Frequency Withstand Voltage Test (One Minute).....35 kV.
- 3) Dry Lightning Impulse Withstand Voltage Test75 kVpeak.
- 4) Minimum Creepage Distance.....195 mm.


MECHANICAL SPECIFICATION

IS:9431-1979

- 1) Cantilever Failing Load F.....500 Kgs.
- 2) Compression Failing Load10000 Kgs.
- 3) Tensile Failing Load1000 Kgs

OTHER :-

- 1) Colour brick red.

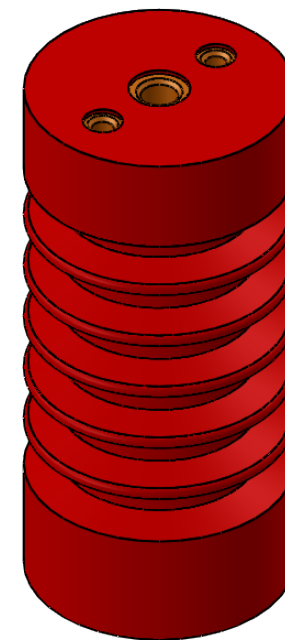

THE COPYRIGHT OF THESE DRAWINGS AND OF ALL ANNEXES WHICH ARE ENTRUSTED TO A PERSON'S CARE ALWAYS REMAIN THE PROPERTY OF OUR FIRM. THEY MUST NOT BE COPIED OR DUPLICATED. NOT SHOWN TO OR PLACED AT THE DISPOSAL OF THIRD PERSONS WITHOUT OUR WRITTEN CONSENT.


REV.	MODIFICATION	DATE	APPD

11kV Epoxy Insulator

MANUFACTURER
SUNSHINE ENGINEERING

Email :- sunshineengineering23@gmail.com
Mob. :- +91 7499544230

All dimensions are in mm

SCALE	NTS	REF. H-0007	
DRG	UKN	PROJECTION	
CHD	Pitale		
APPD	Pitale	Drawing No.	Rev.
DATE	10/04/22	SE/EI11/001	