



RENTAL NOTICE: THE CONTENT OF THIS DOCUMENT IS SENSITIVE INFORMATION MADE AND OWNED BY MICRON CORPORATION AND IS PROTECTED BY COPYRIGHT LAWS AND RELEVANT LAWS/REGULATIONS. NO EMPLOYEES OF MICRON ARE ALLOWED TO ACCESS AND USE THIS SENSITIVE INFORMATION WITHIN THE WORK SCOPE UNDER THEIR BEING, AND RESPECTIVE DUTIES AND OBLIGATIONS REQUIRED BY AGREEMENT, WHICH IS NOT ALLOWED TO COPY, REPRODUCE, DISTRIBUTE, PUBLISH, OR DISCLOSE, WHOLE OR IN PART, TO ANY OTHER PARTY WITHOUT MICRON'S PRIOR AND WRITTEN CONSENT.

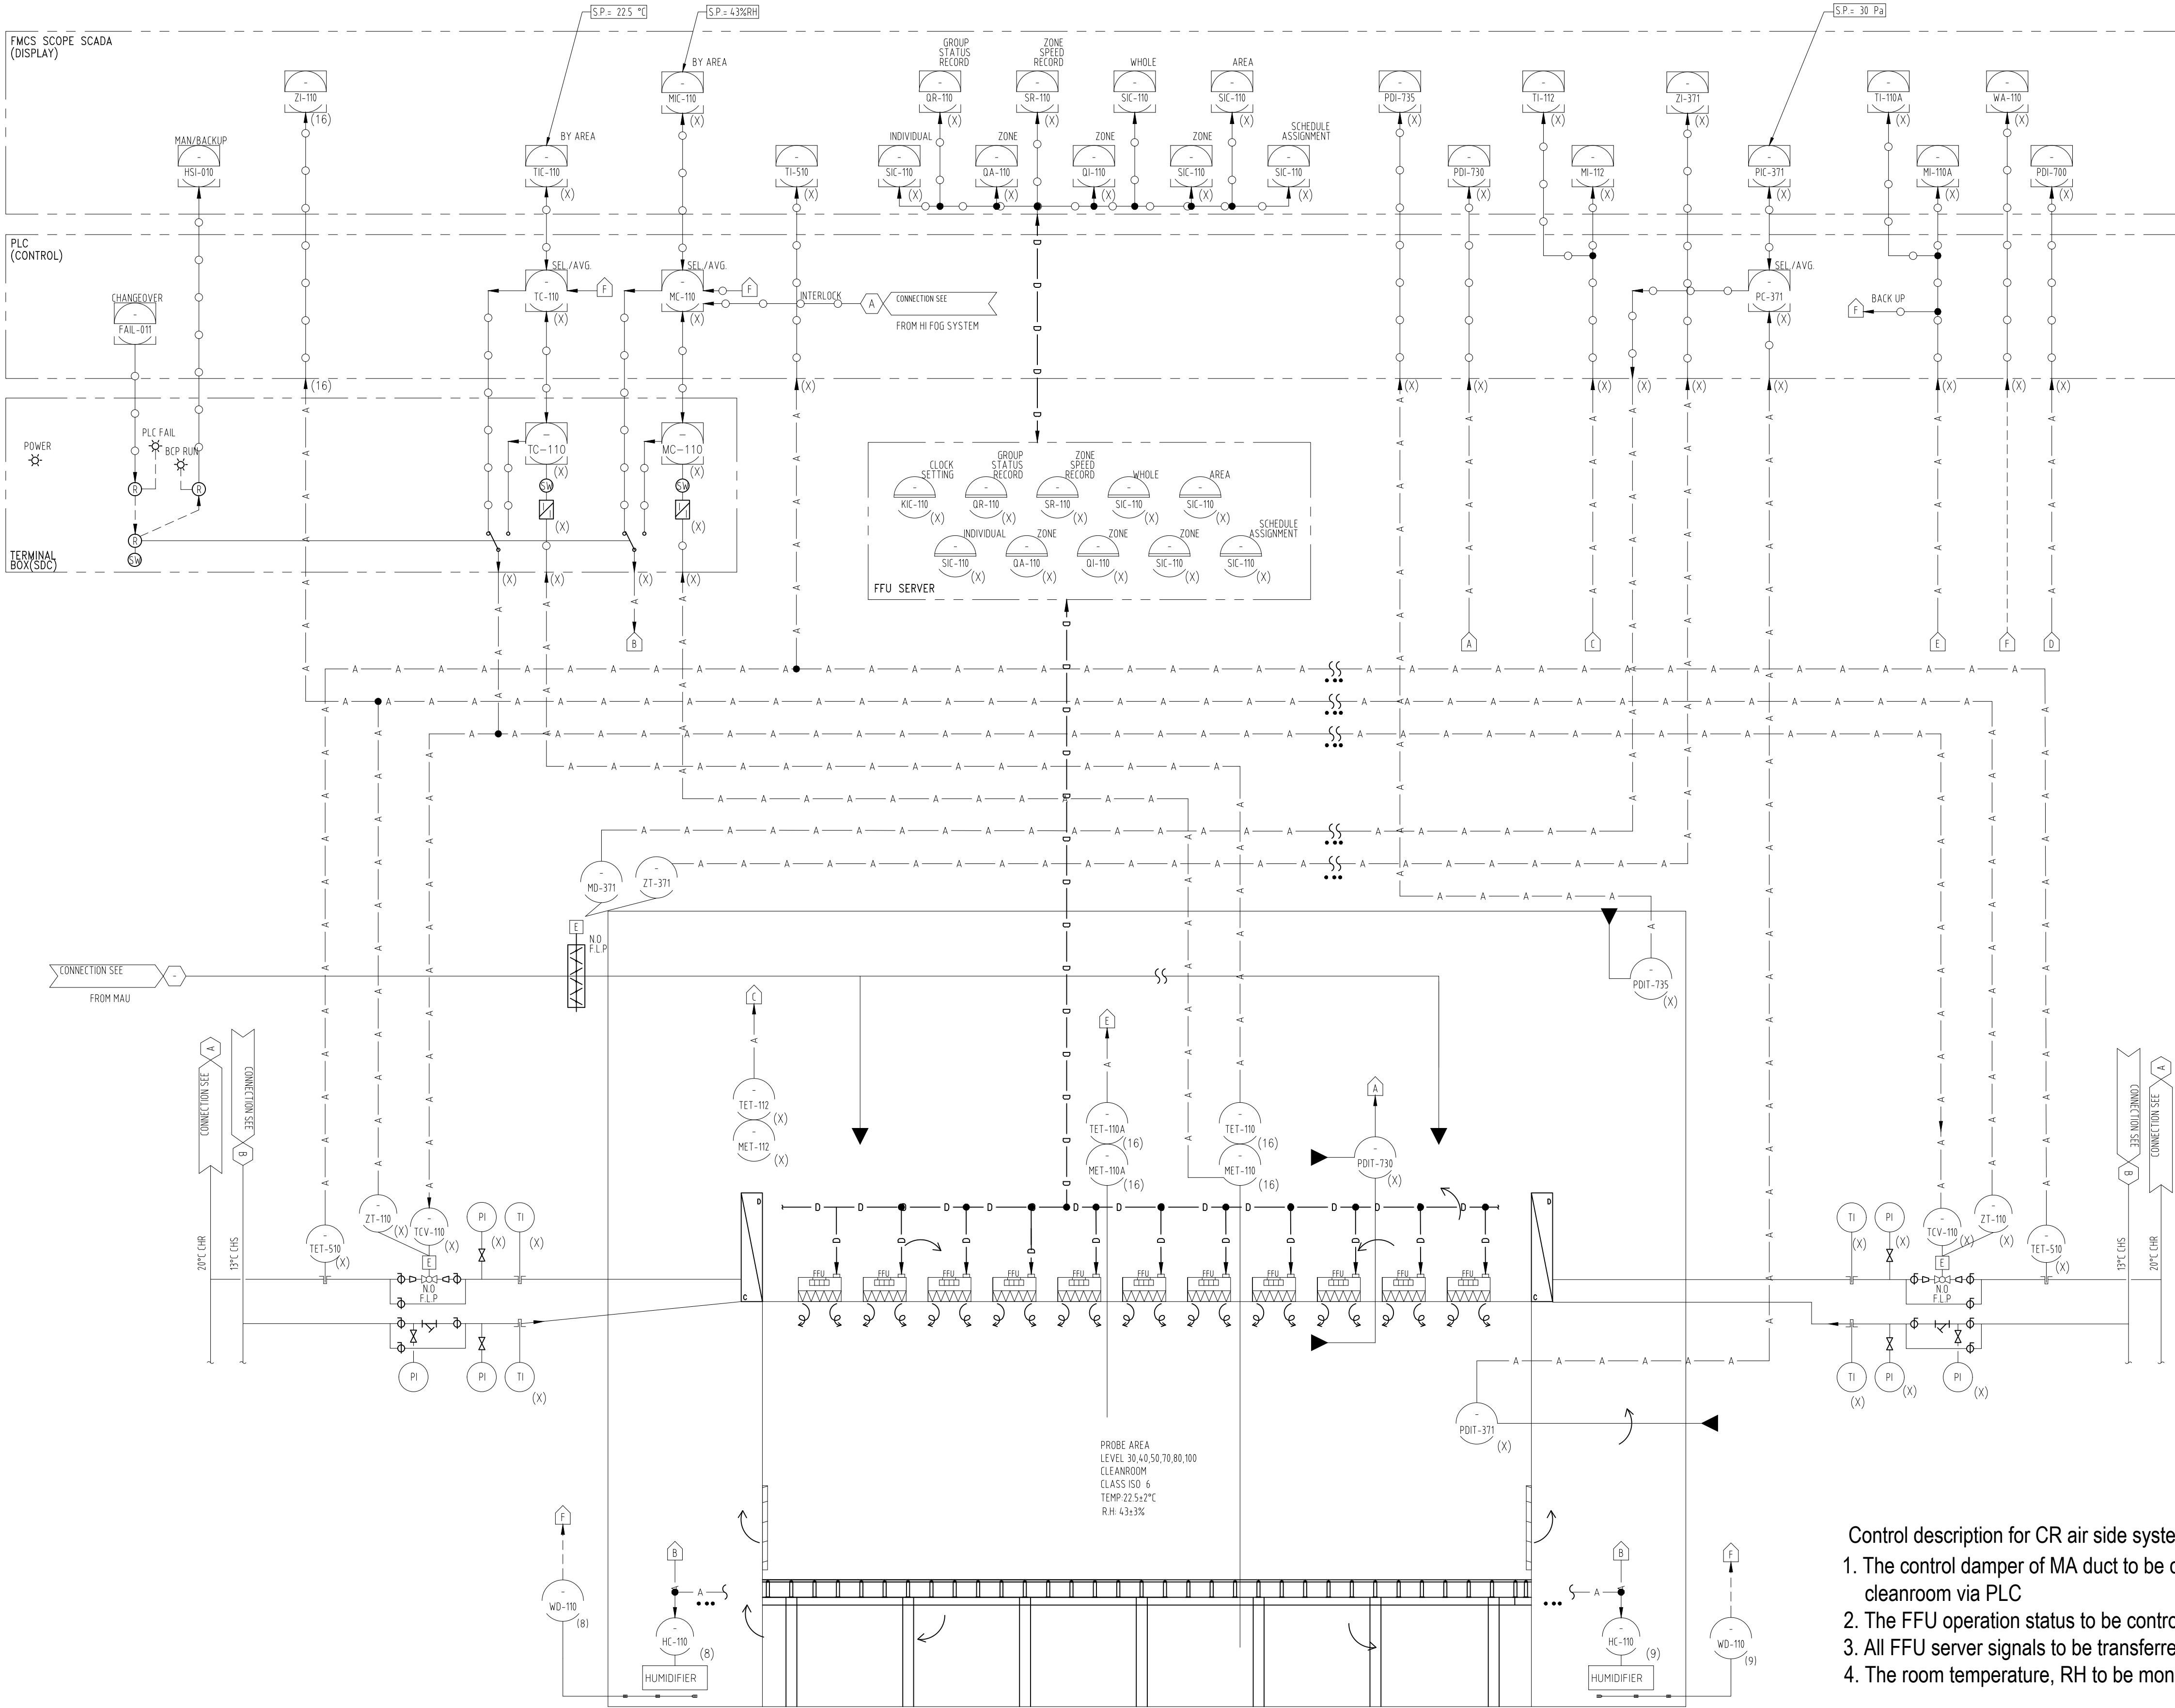

- Control description for CR air side system
1. The control damper of MA duct to be controlled by room pressure to adjacent cleanroom via PLC
 2. The FFU operation status to be controlled and monitoring via FFU server system.
 3. All FFU server signals to be transferred to PLC
 4. The room temperature, RH to be monitoring via PLC

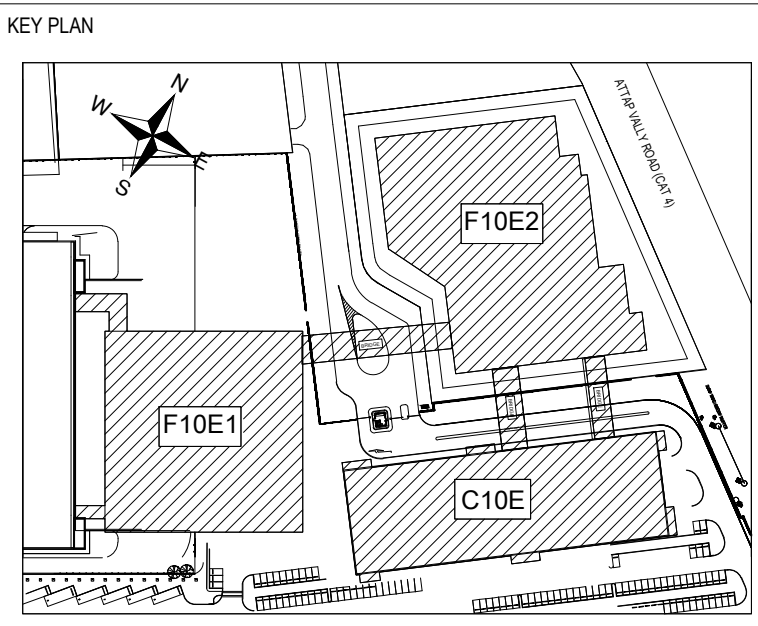

Secret
R3
Level

FOR REVIEW

REV	DATE	DESCRIPTION Revisions	ISSUED BY

PROJECT TITLE
Micron F10E Probe Project

PROJECT PHASE
A&E

DRAWING TITLE
FIOW DIAGRAM
Clean Room Control System P&ID

DESIGNED : 設計者	DRAWN : 作者	CHECKED : 審圖員
DATE : 02/12/20	JOB NO. :	SCALE :
Micron DRAWING NO. : F01-F10E-PFD-S0-00-K-107	REV	
DRAWING NO. :	0A	
Reference Model		
CTCI	SHEET: 1 OF 1	SIZE A1