



EXHIBIT 10-1 NOTICE: THE CONTENT OF THIS DOCUMENT IS SENSITIVE INFORMATION MADE AND OWNED BY MICRON CORPORATION AND IS PROTECTED BY COPYRIGHT LAWS AND RELATED INTELLECTUAL PROPERTY RIGHTS. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF MICRON CORPORATION. ANY VIOLATION OF THIS NOTICE SHALL BE SUBJECT TO LEGAL ACTION. THIS DOCUMENT IS THE PROPERTY OF MICRON CORPORATION AND IS TO BE KEPT IN CONFIDENTIALITY. IT IS TO BE RETURNED TO MICRON CORPORATION UPON REQUEST. IT IS NOT TO BE DISTRIBUTED OUTSIDE OF MICRON CORPORATION. IT IS NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN PERMISSION OF MICRON CORPORATION. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF MICRON CORPORATION. ANY VIOLATION OF THIS NOTICE SHALL BE SUBJECT TO LEGAL ACTION. THIS DOCUMENT IS THE PROPERTY OF MICRON CORPORATION AND IS TO BE KEPT IN CONFIDENTIALITY. IT IS TO BE RETURNED TO MICRON CORPORATION UPON REQUEST. IT IS NOT TO BE DISTRIBUTED OUTSIDE OF MICRON CORPORATION. IT IS NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN PERMISSION OF MICRON CORPORATION.

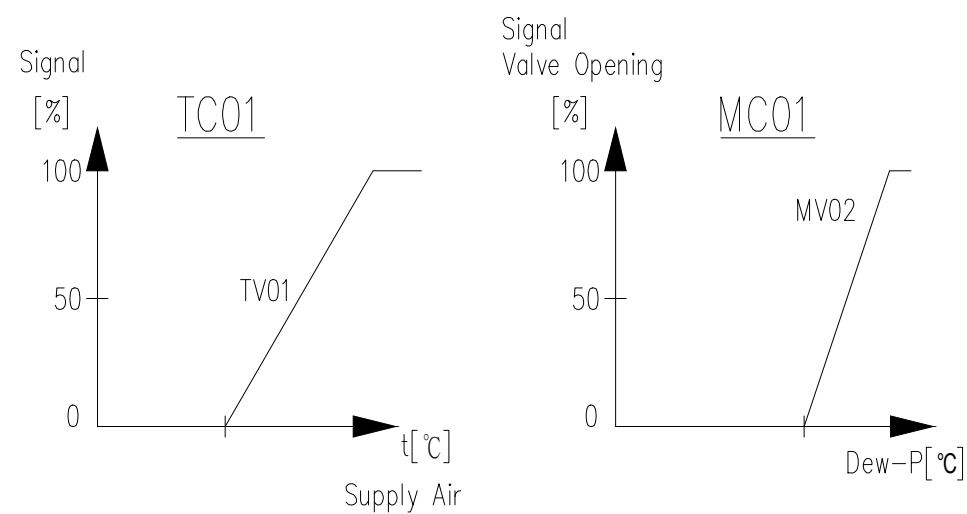


Increasing temperature at supply air sensor control signal increasing to pre-cooler valves (via TV01)

Increasing dewpoint at supply air sensor control signal decreasing to pre-cooler valve (via MV02) and increasing to re-cooler valves (via MV02)

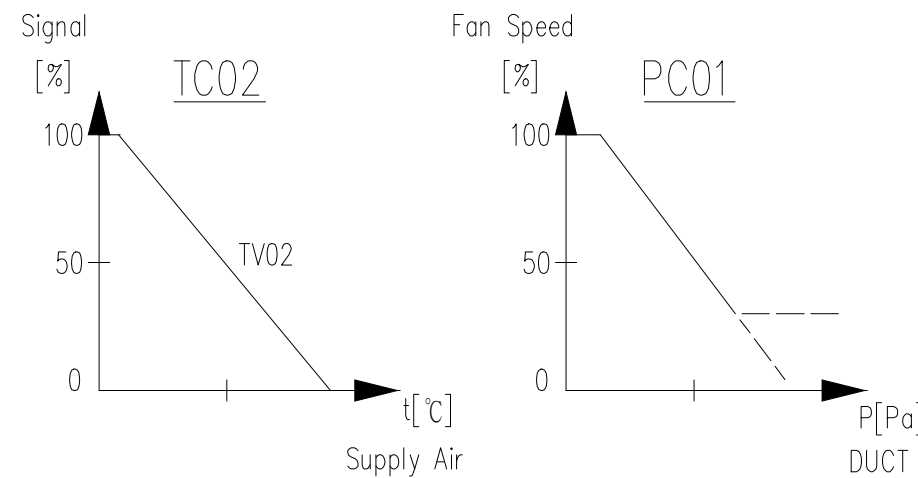


Increasing temperature at supply air sensor control signal decreasing to re-heater valves (via TV02)

Increasing Main Duct pressure decreasing to VFD to reduce fan speed.

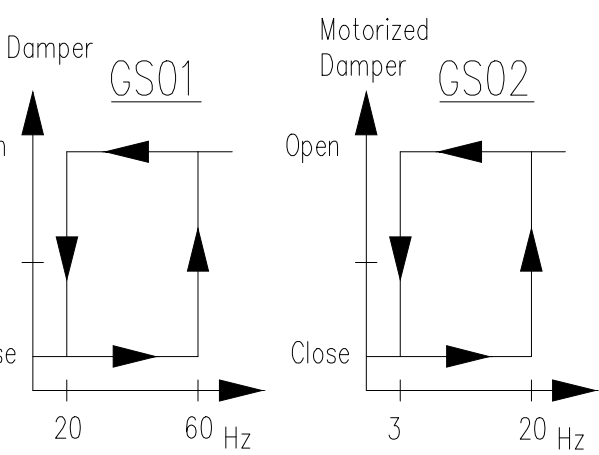

SA damper Inter-lock with fan running when till 20 Hz and SA Temp. / Humi. closely with room condition will open SA damper, shut down fan uder 20 Hz will close SA damper.

Motorized damper will auto -matic open when MAU fan runing till SA damper open will automatic close Motorized damper.

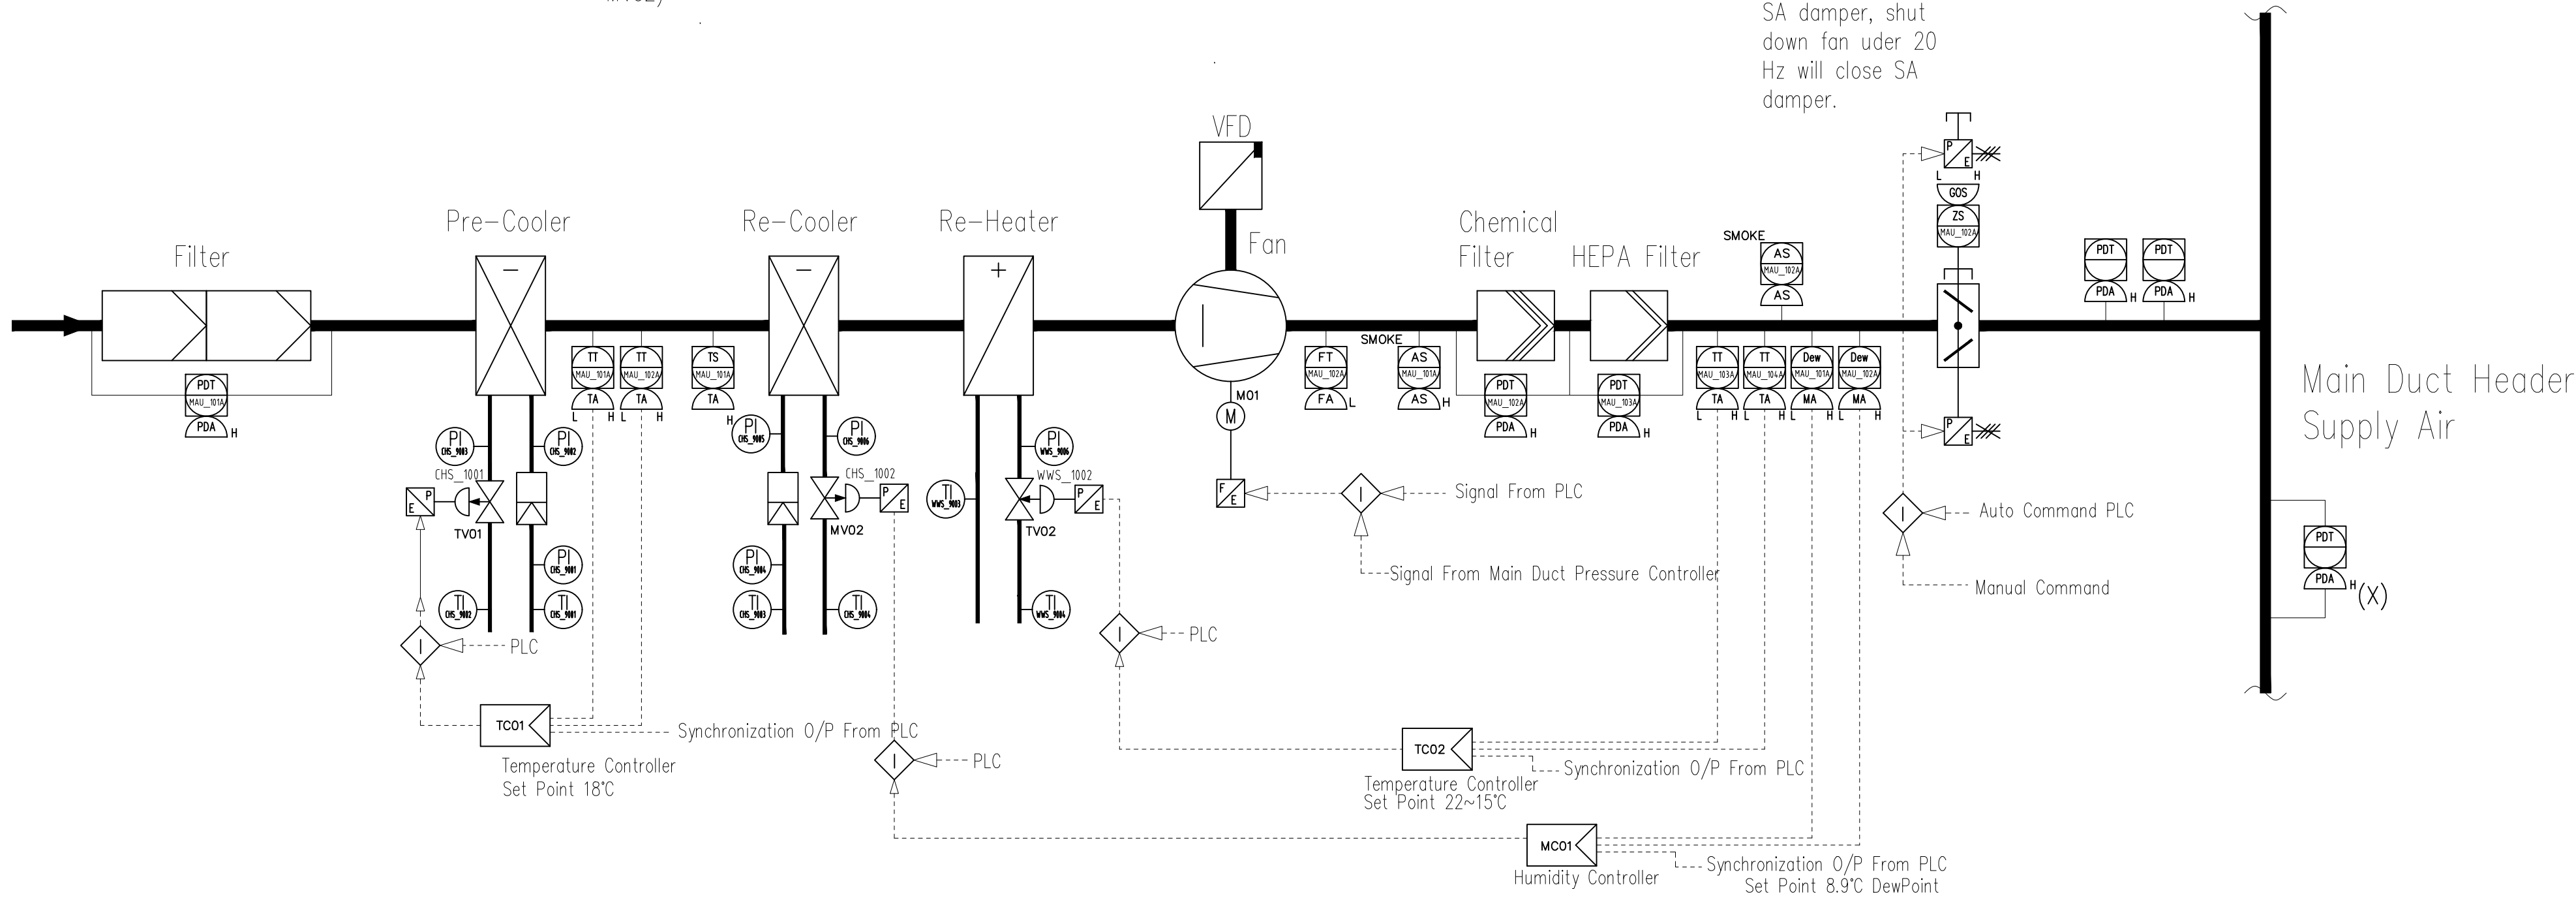

Legend

- Pump
- Fan with VFD
- Control Valve Pneumatic Modulating Type
- Control Valve Pneumatic Open/Close Type
- Motorized Control Damper
- Controller
- Ramp Function
- Back Draught Damper
- STRAINER
- Dew Point Temperature Sensor
- Level Transmitter
- Pressure Switch
- Differential Pressure Switch
- Temperature Switch
- Temperature Transmitter
- Position Switch
- Smoke Detector
- Conductivity Sensor
- Flow Transmitter

Line Description

- Air Duct
- Water Pipe
- Electrical Function Line
- Mechanical Function Line

Note:

- All bypass line of control valve to be shown on MAU Process Flow Diagram (PFD)
- Motorized damper air will be return back to air chamber via pressure relief damper on the wall.

OWNER / DEVELOPER

ARCHITECTURAL CONSULTANT

CIVIL & STRUCTURAL CONSULTANT

MECHANICAL & ELECTRICAL CONSULTANT

DESIGN MANAGER

CTCI Singapore Pte. Ltd.

PROJECT ADDRESS
North Coast Drive, Singapore

KEY PLAN

Secret
R3
Level

FOR REVIEW

REV	DATE	DESCRIPTION	ISSUED BY
		Revisions	

PROJECT TITLE

Micron F10E Probe Project

PROJECT PHASE

A&E

DRAWING TITLE

FIOW DIAGRAM
MAU Control System P&ID

DESIGNED : 設計者

DRAWN : 作者

CHECKED : 審圖員

DATE : 02/22/25

JOB NO. :

SCALE :

Micron
DRAWING NO. F01-F10E-PFD-S0-00-K-108

REV

CTCI
DRAWING NO.

A

Reference Model

CTCI

SHEET: 1 OF 1

SIZE A1