
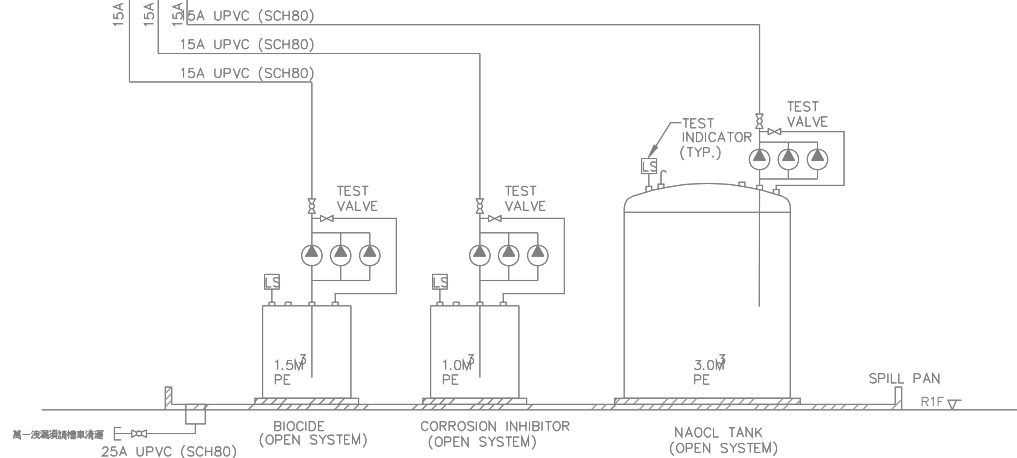
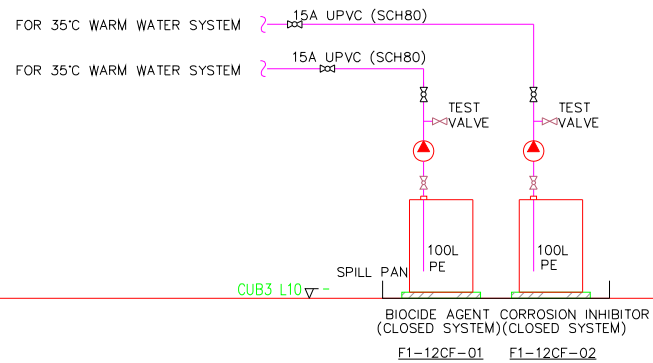
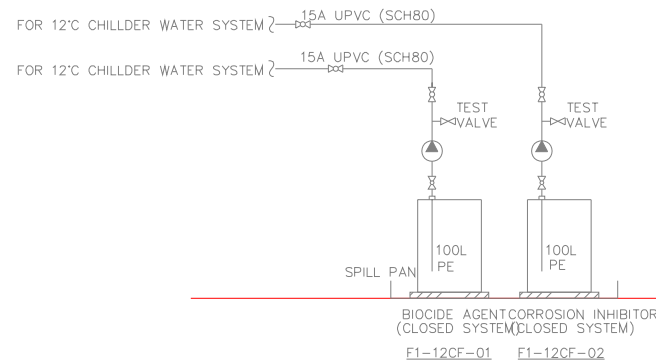
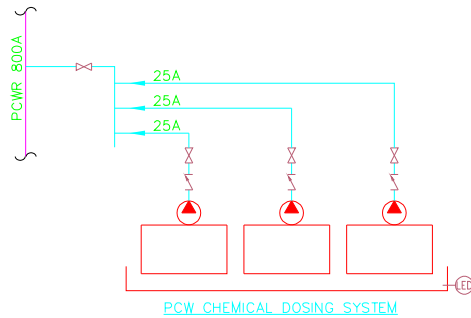

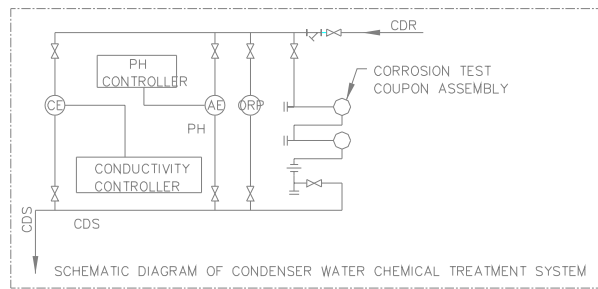


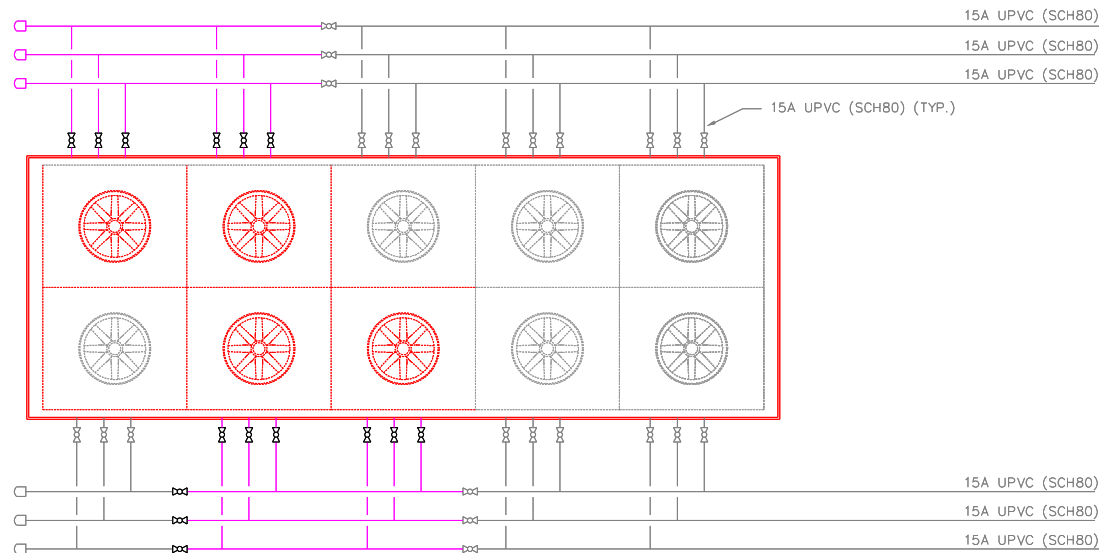

- NOTE:
- 12°C 冰水系統加藥桶在CUB L10 須施作防溢堤, 排水, 拖布盆, 清洗水龍頭及照明
 - 12°C 冷卻水系統加藥桶在COOLING TOWER 下方 須施作防溢堤, 排水, 拖布盆, 清洗水龍頭及照明
 - 每一個冷卻水塔水池均必須有每一加藥管進入
 - 35°C 熱水系統加藥桶在CUB L10 須施作防溢堤, 排水, 拖布盆, 清洗水龍頭及照明

OWNER / DEVELOPER

micron™

ARCHITECTURAL CONSULTANT

QUO 陳昆豐建築師事務所

CIVIL & STRUCTURAL CONSULTANT

森 禾森工程顧問有限公司

MECHANICAL & ELECTRICAL CONSULTANT & CONTRACTOR

YKE 洋基工程股份有限公司
YANKEY Engineering Co.,Ltd

SUB-CONTRACTOR

PROJECT ADDRESS

KEY PLAN

REV	DATE	DESCRIPTION	ISSUED BY
		Revisions	

PROJECT TITLE

美光台南廠188K增建工程

PROJECT PHASE

MECH

Concept Design

DRAWING TITLE

DE_MMTN_F2_B002_M_CHWT_1004

MEP加藥系統流程圖+PCW+35度C

FLOW DIAGRAM-HVAC DOSING UNIT+PCW +35°C

DESIGNED :	DRAWN :	CHECKED :
DATE : 2025/08/11	JOB NO. :	SCALE :

DRAWING NO.

DE_MMTN_F2_B002_M_CHWT_1004

[SHEET PURPOSE]

SHEET:

SIZE