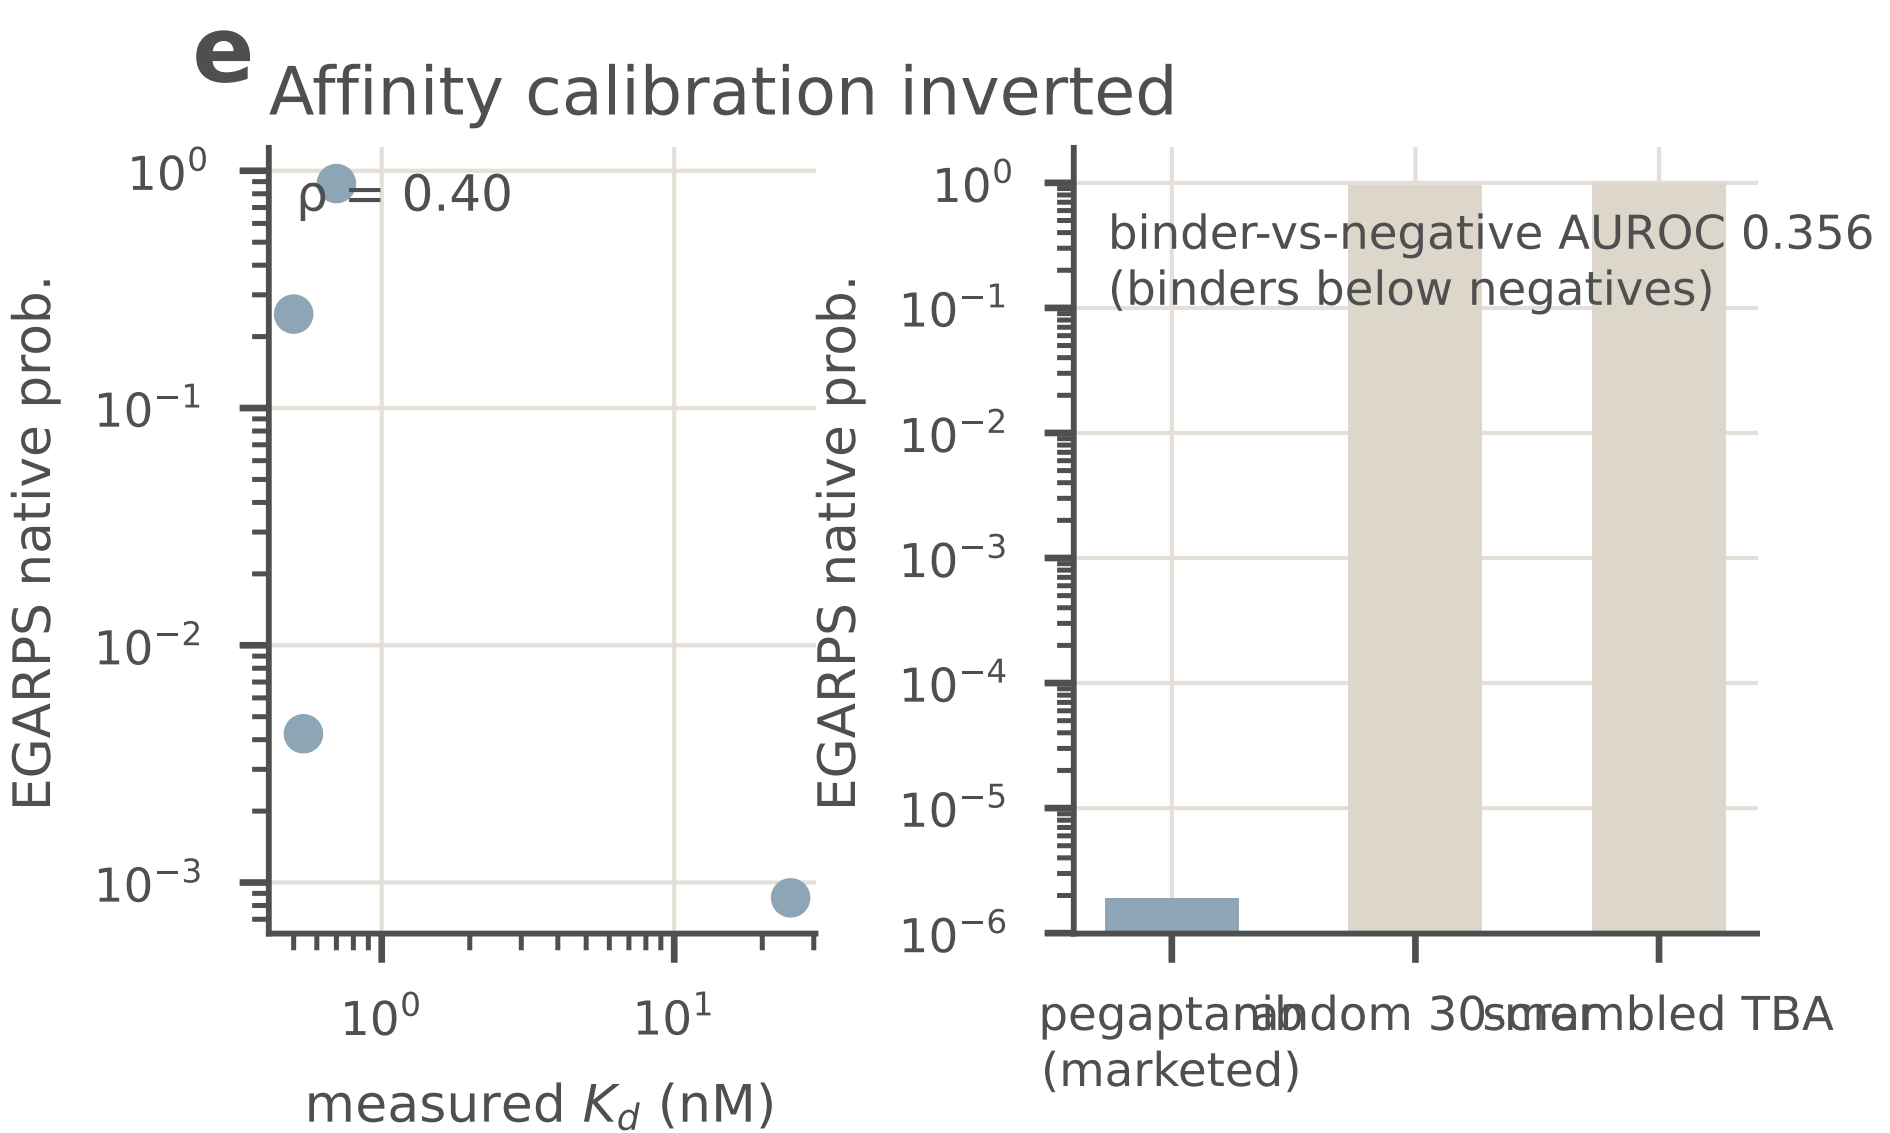
e
Affinity calibration inverted
ρ = 0.40
EGARPS native prob.
measured K_d (nM)
binder-vs-negative AUROC 0.356
(binders below negatives)
pegaptanib
(marketed)
random 30-mer
scrambled TBA