


Afternoon Data Distribution in Measurement Difference: Temperature

Testo400 - MLX90614



Testo 400 - SCD30

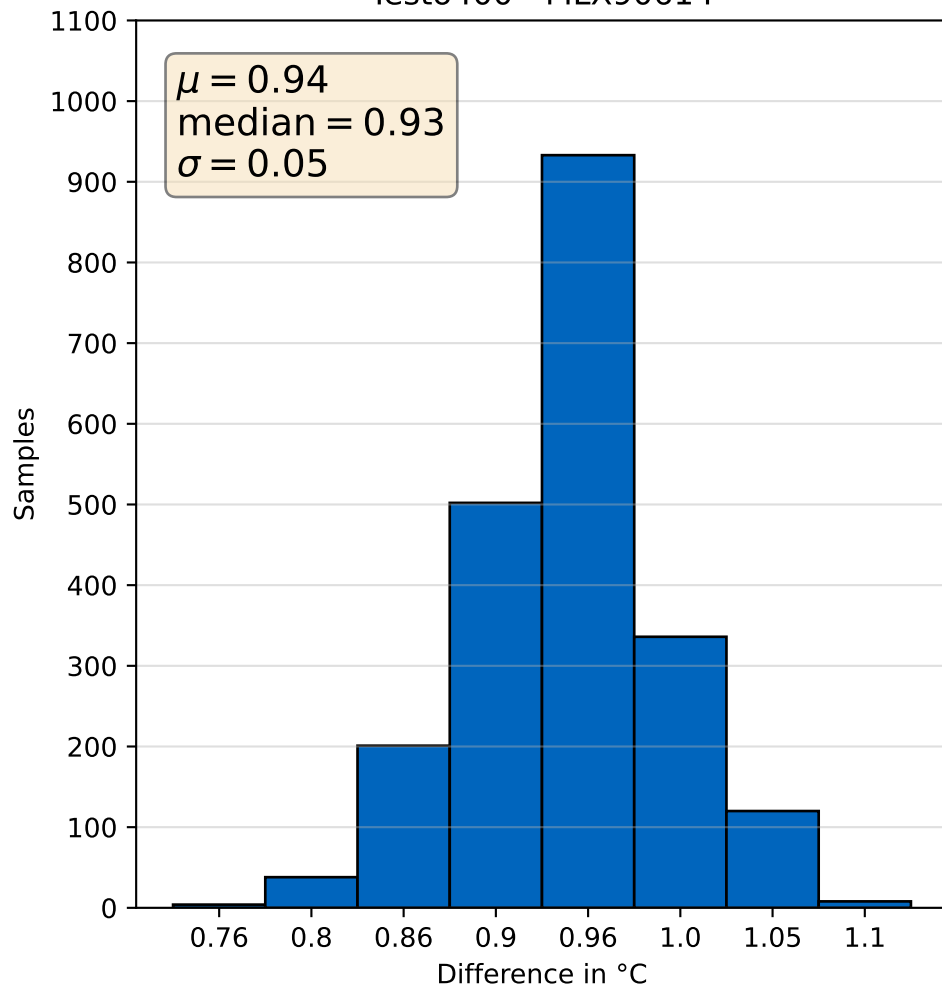