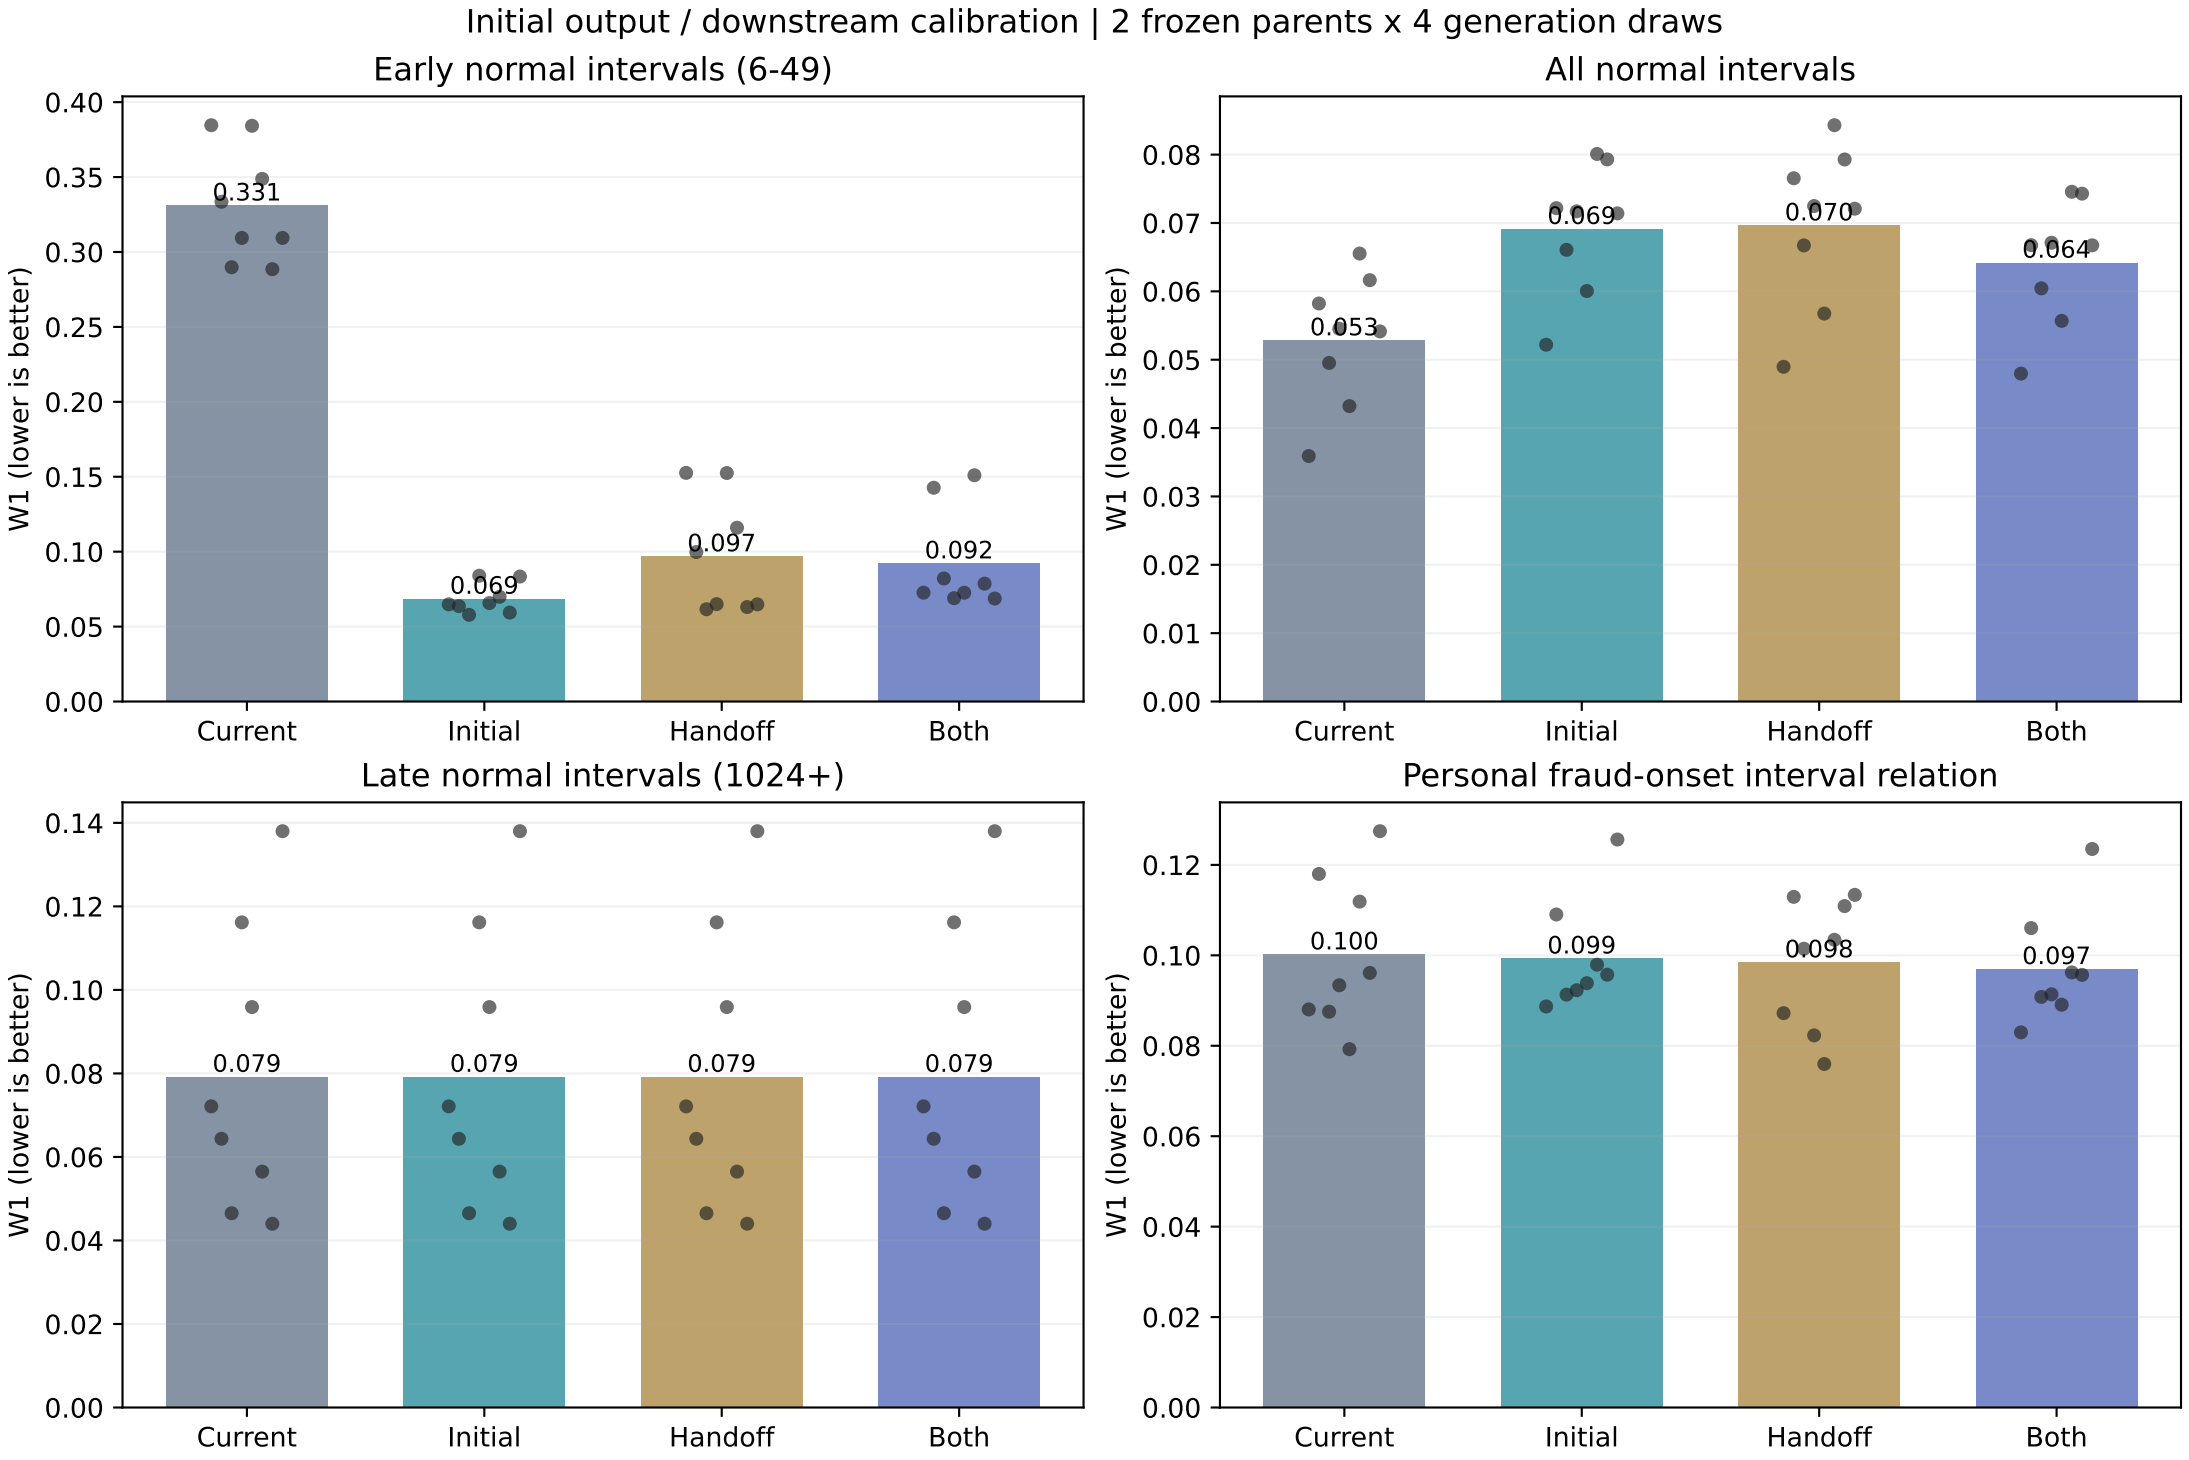
Initial output / downstream calibration | 2 frozen parents x 4 generation draws
Early normal intervals (6-49)
All normal intervals
Late normal intervals (1024+)
Personal fraud-onset interval relation
W1 (lower is better)
Current
Initial
Handoff
Both
0.331
0.069
0.097
0.092
0.053
0.069
0.070
0.064
0.079
0.079
0.079
0.079
0.100
0.099
0.098
0.097