


Single-Line Diagram — 300 MVA, 230/11 kV, Yd1 Transformer Protection Test System

Differential Protection (87T) | HV/LV CTs with Nonlinear Saturation | Internal & External Faults | Inrush Energization

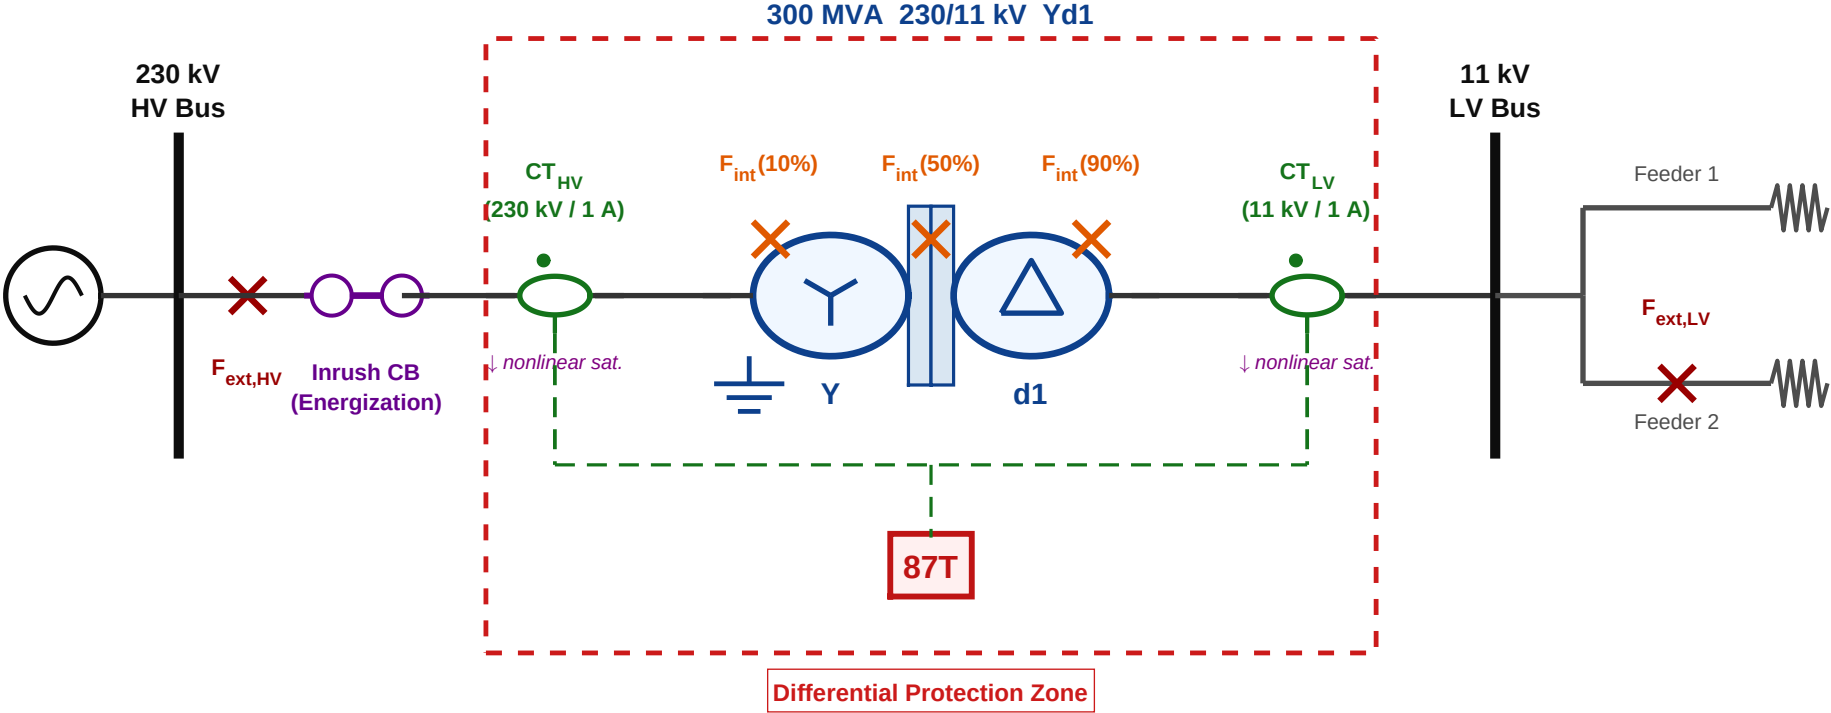

Legend

- CT secondary wiring (dashed)
- Transformer (Yd1)
- 87T Differential Relay
- Differential Protection Zone boundary
- Inrush Energization CB
- Internal Fault — 10 % / 50 % / 90 % winding
- External Fault — HV bus / LV feeder
- Nonlinear CT saturation model