

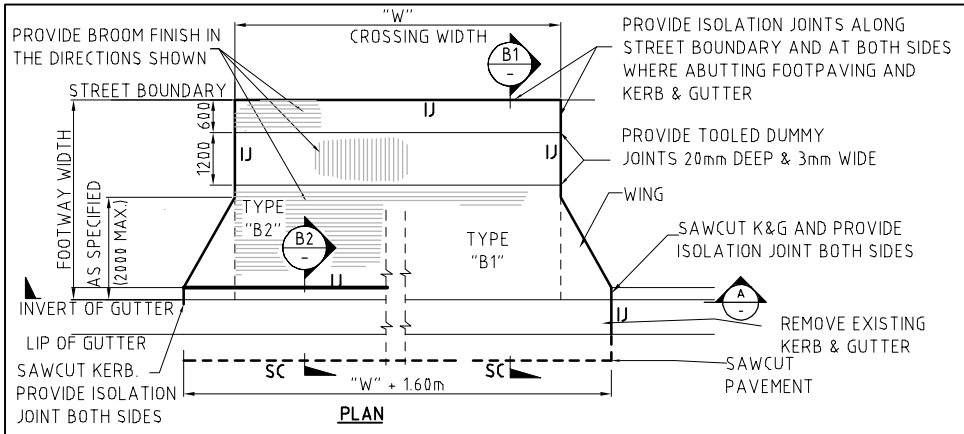



IJ = ISOLATION JOINT
SC = SAWCUT

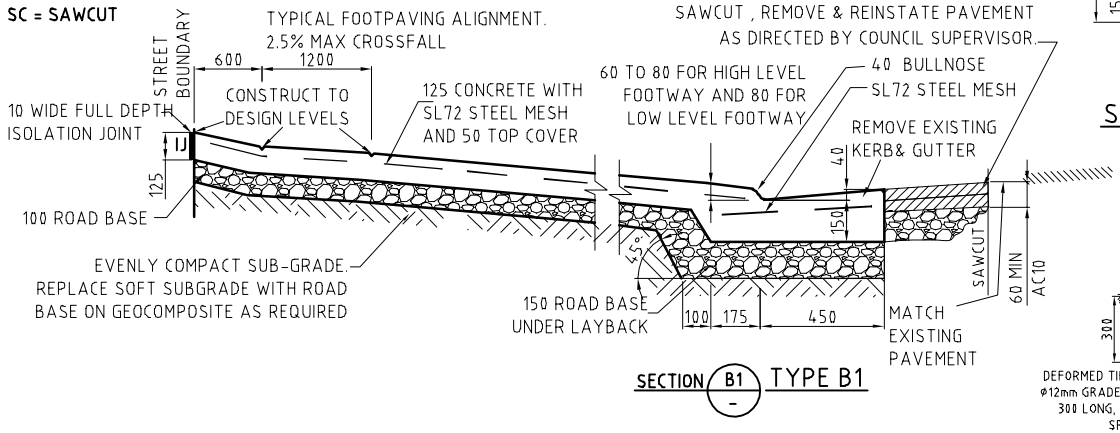


TYPE B1	VFC INTEGRAL WITH GUTTER	REMOVE K&G
TYPE B2	VFC MATCHING EXISTING LAYBACK	--------


REFER TO ATTACHED 'DESIGN LEVELS' PLAN FOR LEVELS AND DIMENSONS

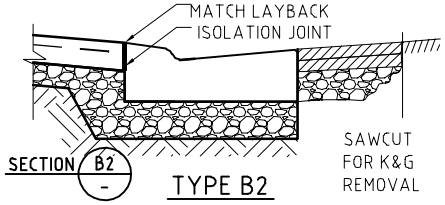

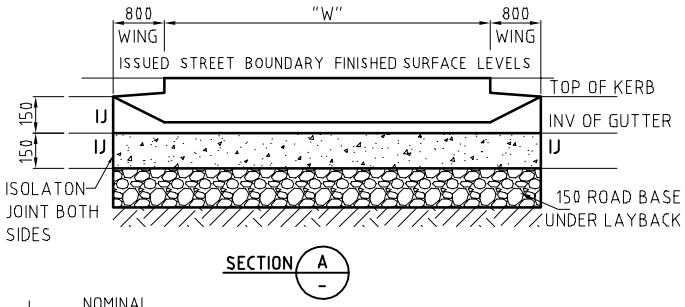

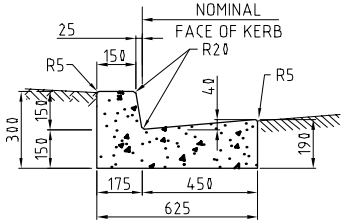

STANDARD KERB & GUTTER

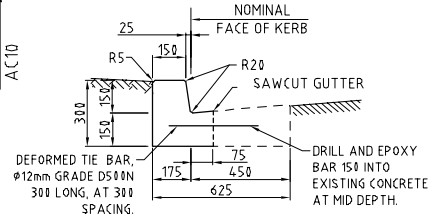

KERB REINSTATEMENTS

FOR REDUNDANT LAYBACKS AND STORMWATER CONNECTIONS TO KERB. LIGHT TRAFFIC ROADS ONLY.

NOTES :

1. ROAD BASE MATERIAL IS TO BE CRUSHED ROCK GRADED TO DGB20, CRUSHED CONCRETE GRADED TO DGS20, OR GRADED RECYCLED ASPHALT WITH MAX. PARTICLE SIZE OF 20. EXISTING ROAD BASE OF ADEQUATE THICKNESS CAN BE UTILISED.
2. CONCRETE: STRENGTH GRADE N32, 20mm MAX SIZE AGGREGATE, IN ACCORDANCE WITH AS3600.
3. ASPHALT HOTMIX AC10 (10mm MAX. AGGREGATE SIZE) , IN ACCORDANCE WITH AS2150, TO BE COMPACTED AT A MINIMUM TEMPERATURE OF 140°C IN 20-40mm THICKNESS LAYERS. **(COLD MIX IS NOT PERMITTED)**
4. ISOLATION JOINTS SHALL BE INSTALLED WHERE THE CONCRETE SLAB ABUTS HARD SURFACES.
   ISOLATION JOINTS SHALL CONSIST OF FULL DEPTH 10MM THICK COMPRESSIBLE FILLER. EITHER BITUMEN IMPREGNATED FIBREBOARD OR CLOSED CELL POLYETHYLENE FOAM SEALED WITH 10x10 POLYURETHANE SEALANT.
5. ALL BOXING BETWEEN GUTTER FACE AND EXISTING ROAD PAVEMENT SHALL BE FILLED TO MATCH THE EXISTING PAVEMENT WITH COMPACTED HOTMIX AC OR DGB20 ROAD BASE AND FINISHED WITH 60mm (MIN) AC10 HOTMIX COMPACTED IN 20-40mm LAYERS AS REQUIRED AND AS DIRECTED.
6. PROVIDE 50 TOP COVER TO STEEL MESH REINFORCEMENT AND 75 COVER AT ENDS. STEEL MESH IS TO BE PLACED ON PLASTIC BAR CHAIRS IN A REGULAR GRID NOT EXCEEDING 1.0m SPACING.
7. POLYETHYLENE SHEETING IS TO BE PLACED UNDER THE CONCRETE WHERE THE VFC IS CONTAINED ON BOTH SIDES BY FULL WIDTH PAVING.
8. ALL PERIMETER EDGES TO BE ROUNDED TO 20 RADIUS USING AN EDGING TOOL.
9. CONCRETE FINISH TO BE PLAIN CONCRETE WITH A "MEDIUM" BROOMED TEXTURE AT 90° TO DIRECTION OF TRAFFIC. PEDESTRIAN TRAFFIC TO HAVE PRIORITY.
10. ADJOINING EXISTING CONCRETE FOOTPAVING IS TO BE RECONSTRUCTED TO MATCH THE VFC AT A GRADE GENERALLY NOT EXCEEDING 1 in 14 AS REQUIRED BY THE COUNCIL SUPERVISOR.
11. ADJOINING NATURAL FOOTWAY IS TO BE SHAPED TO GRADE EVENLY TO THE VFC AS REQUIRED BY THE COUNCIL SUPERVISOR. DISTURBED AREAS TO BE TURFED.
12. THIS PLAN DOES NOT APPLY FOR FOOTWAY WIDTHS LESS THAN 2800.
13. USE APPROPRIATE SECTION TYPE AS DIRECTED BY COUNCIL SUPERVISOR.

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE

CANTERBURY BANKSTOWN

CITY OF CANTERBURY BANKSTOWN

STD DWG N° S-007

STANDARD LIGHT DUTY VEHICULAR FOOTWAY CROSSING (VFC)

PLAN VIEW, SECTIONS AND GENERAL NOTES

Sheet N°: 1 of 1

Revision: 28/04/20

File Name: S-007.dwg

U:\Standard Drawings\Standard Drawings - Draft\Draft_S-007.dwg 8/04/2020 8:10:43 AM