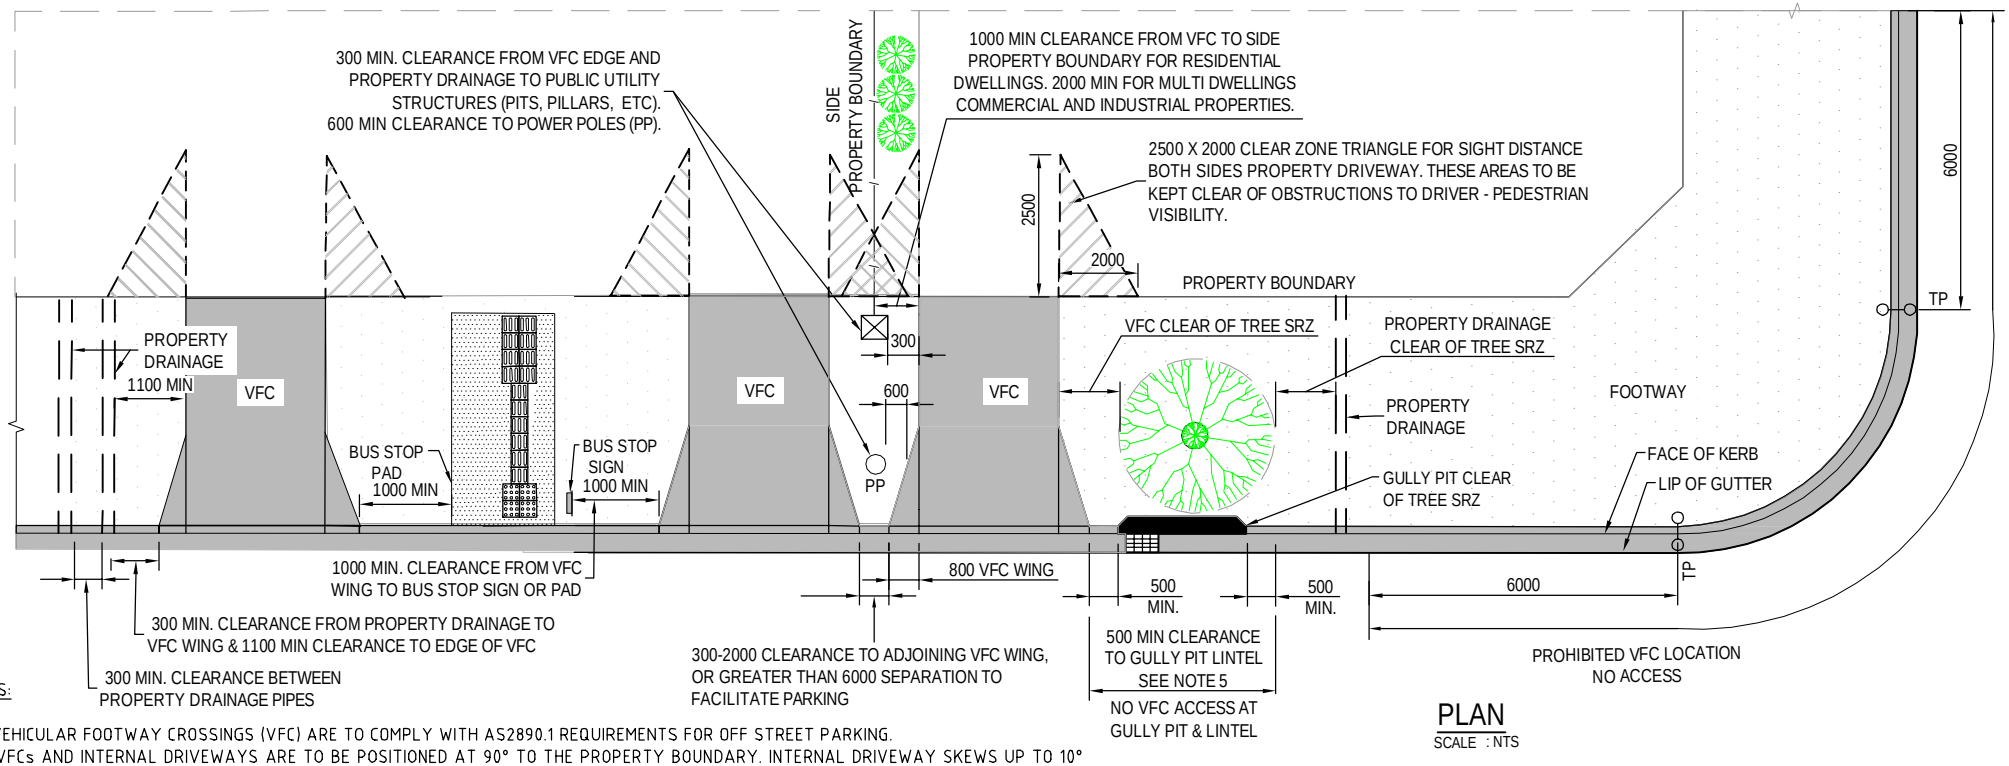


PLAN

SCALE : NTS

NOTES:

1. VEHICULAR FOOTWAY CROSSINGS (VFC) ARE TO COMPLY WITH AS2890.1 REQUIREMENTS FOR OFF STREET PARKING.
2. VFCs AND INTERNAL DRIVEWAYS ARE TO BE POSITIONED AT 90° TO THE PROPERTY BOUNDARY. INTERNAL DRIVEWAY SKEWS UP TO 10° MAY BE APPROVED TO AVOID STRUCTURES AND TREE ROOT ZONES IN THE ROAD RESERVE. 30° MAXIMUM SIDE SPLAYS ON VFCs MAY BE APPROVED WHERE ENTRY AND EXIT IS TO KERBSIDE TRAFFIC LANES, OR TO PROVIDE FOR TRUCK TURNING MOVEMENTS.
3. PROVIDE 1000MM MINIMUM CLEARANCE FROM VFC TO THE SIDE PROPERTY BOUNDARY FOR DOMESTIC RESIDENTIAL DWELLINGS. PROVIDE 2000MM MINIMUM CLEARANCE TO THE SIDE PROPERTY BOUNDARY FOR MULTI-DWELLINGS, COMMERCIAL AND INDUSTRIAL PROPERTIES.
4. NEAR ROAD INTERSECTIONS VFCs ARE TO BE LOCATED AT LEAST 6.0M FROM THE KERB & GUTTER TANGENT POINT (TP).
5. VFCs ARE TO BE LOCATED 500MM MINIMUM CLEAR OF LINTELS ON STORMWATER GULLY PITS. PROVIDE 1000MM MIN CLEARANCE FOR ROLL KERB. COUNCIL MAY APPROVE RELOCATION OF GULLY PITS AT THE OWNERS COST.
6. PROVIDE 300MM MINIMUM CLEARANCE FROM VFC AND PROPERTY DRAINAGE `TO PUBLIC UTILITY STRUCTURES. ANY SERVICE STRUCTURES IN THE LOCATION OF A PROPOSED VFC ARE TO BE RELOCATED AS REQUIRED BY THE SERVICE AUTHORITY.
7. PROVIDE 600MM MINIMUM CLEARANCE FROM VFC AND PROPERTY DRAINAGE TO POWER POLES.
8. PROVIDE 1000MM MINIMUM CLEARANCE FROM VFC WINGS TO BUS STOP SIGN AND/OR (FUTURE) BUS STOP PADS.
9. PROVIDE SEPARATION BETWEEN ADJOINING WINGS OF VFCs OF 300-2000MM, OR 6000MM OR GREATER SEPARATION. ADJUST VFC WIDTH AND SEPARATION TO FACILTATE ONSTREET PARKING
10. PROVIDE SEPARATION OF AT LEAST 2000MM BETWEEN VFC WINGS AND KERB RAMP WINGS.
11. PROPERTY DRAINAGE PIPES ARE TO BE LOCATED AT LEAST 1000MM CLEAR OF THE VFC AND PIPE OUTLETS AT THE KERB ARE TO BE LOCATED AT LEAST 300MM CLEAR OF THE VFC WING.
12. PROPERTY DRAINAGE PIPES ARE TO BE LOCATED AT LEAST 500MM CLEAR OF SIDE PROPERTY BOUNDARIES.
13. VFCs, PROPERTY DRAINAGE, AND STORMWATER GULLY PITS ARE TO BE LOCATED CLEAR OF TREE STRUCTURAL ROOT ZONES (SRZ), WITH 2000MM MINIMUM CLEARANCE TO TREE TRUNKS FOR SIGHT DISTANCE REQUIREMENTS. REFER TO CBC STD S-210 FOR TREE STRUCTURAL ROOT ZONE (SRZ) REQUIREMENTS.
14. SIGHT TRIANGLES WITH A CLEAR ZONE FREE OF OBSTRUCTIONS TO VISIBILITY FROM THE VEHICLE TO PEDESTRIANS MUST BE MAINTAINED FOR A DISTANCE OF 2.5m AND A WIDTH OF 2.0m ON BOTH SIDES OF THE DRIVEWAY WITHIN THE PROPERTY IN ACCORDANCE WITH AS2890.1:2004. COMMERCIAL AND INDUSTRIAL PROPERTIES NEED TO PROVIDE SIGHT DISTANCE TRIANGLES AS PER AS2890.2:2018 & MULTI-DWELLINGS NEED TO COMPLY WITH AS2890.1:2004

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE

CANTERBURY BANKSTOWN

CITY OF CANTERBURY BANKSTOWN

STANDARD

LOCATION FOR VFCs & PROPERTY DRAINAGE

CLEARANCE REQUIREMENTS FOR INFRASTRUCTURE

STD DWG N°

S-004

Sheet N°: 1 of 1

Revision: 25/09/25

File Name: S-004.dwg

U:\Standard Drawings\Standard Drawings (dwg)\S-004.dwg 25 Sep. 2025 2:47 pm