
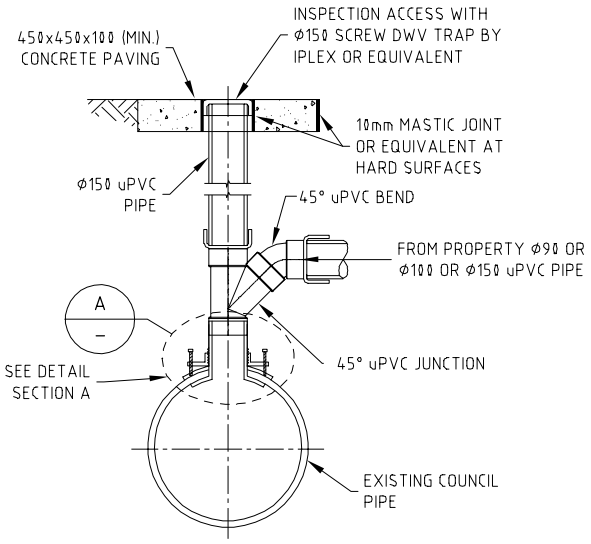



TOP CONNECTION DETAIL: TYPE 1

SCALE: NTS

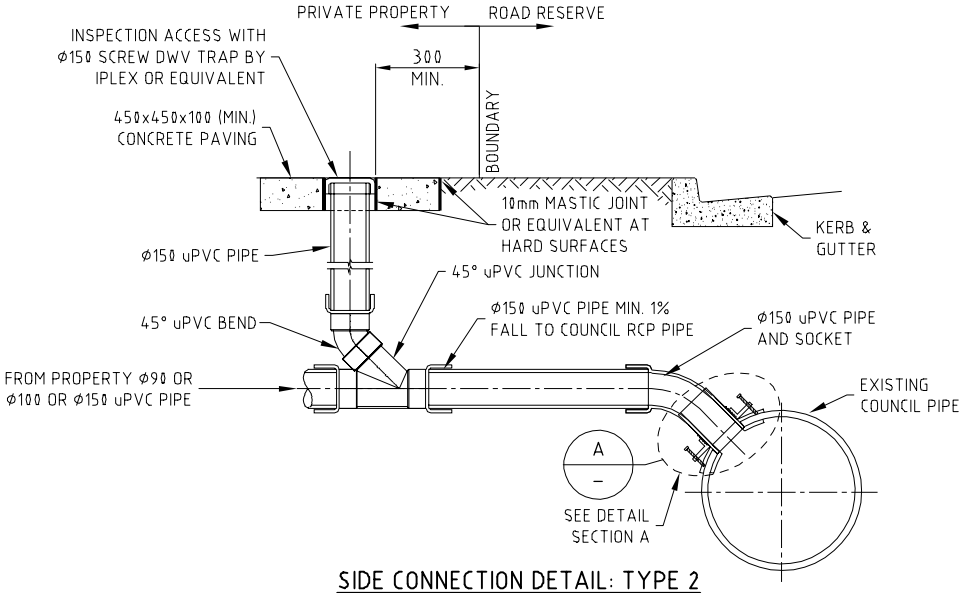


SIDE CONNECTION DETAIL: TYPE 2

SCALE: NTS



ALTERNATIVE INSPECTION ACCESS IN LANDSCAPED AREAS


SCALE: NTS

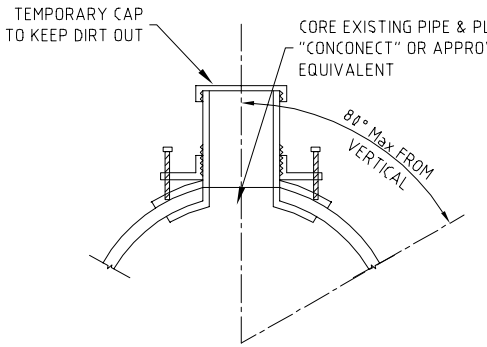

"CONCONECT" by FLOWCON

DETAIL A – SCALE: NTS

REQUIRED CONNECTION

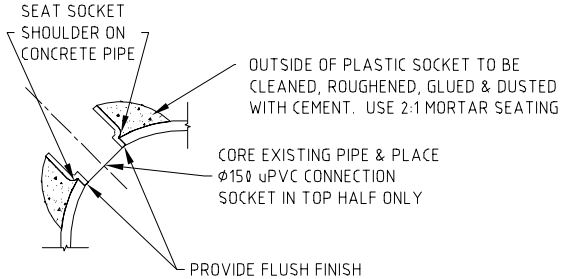

DETAIL A – SCALE: NTS

ALTERNATIVE CONNECTION ONLY IF APPROVED

PIPE CONNECTION NOTES:

1. DIRECT CONNECTION TO COUNCIL PIPE IS ONLY FOR 100 DIA. AND 150 DIA. PIPES. FOR CONNECTION OF PIPE SIZES 225 DIA. OR LARGER, PROVIDE GULLY PIT WITH 1.2m O/A LINTEL (IN KERB AND GUTTER), OR STANDARD JUNCTION BOX.
2. USE TYPE 1 CONNECTION IN PROPERTY, TYPE 2 CONNECTION OUTSIDE PROPERTY, OR AS SPECIFIED.
3. CONNECTIONS TO BE IN TOP HALF OF COUNCIL PIPE, AND PERPENDICULAR TO THE COUNCIL PIPE.
4. THE COUNCIL STORM WATER PIPE SHALL BE PIERCED BY A NEAT SAWCUT/CORED OPENING TO ALLOW THE INSTALLATION OF A PIPE CONNECTION FLANGE WHICH SHALL NOT PROTRUDE BEYOND THE INNER SURFACE OF THE STORM WATER PIPE. THE INTERNAL JUNCTION SHALL BE SMOOTHLY FINISHED WITH 2:1 CEMENT MORTAR SO AS TO PRESENT NO OBSTRUCTION WITHIN THE INTERNAL CHANNEL OF THE STORM WATER PIPE. THE CONNECTION SOCKET IS TO BE INSPECTED AND APPROVED PRIOR TO INSTALLATION OF THE DRAINAGE PIPE.
5. PIPE CONNECTION SOCKET TO BE A FEMALE SOCKET OR A PROPRIETARY PIPE CONNECTOR 'CONCONECT' BY FLOWCON OR APPROVED EQUIVALENT).
6. uPVC PIPES TO BE EXTRA HEAVY DUTY SEWER GRADE - SN825N10.

THE CONNECTION SOCKET IS TO BE INSPECTED AND APPROVED PRIOR TO INSTALLATION OF THE DRAINAGE PIPE

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE

CANTERBURY BANKSTOWN

CITY OF CANTERBURY BANKSTOWN	STD DWG N°
STANDARD PROPERTY DRAINAGE CONNECTION TO COUNCIL PIPES	S-107A
	Sheet N°: 1 of 1 / Revision: 08/10/18
SECTIONS AND STANDARD NOTES	File Name: S-107A.dwg

U:\Standard Drawings\Standard Drawings (dwg)\S-107A.dwg 08 Oct. 2018 5:40 pm