



p_{60} p_{70} p_{80} N_{conv} (knee) threshold (gap = 0.005) — gap = 0 (= reference)

TIAGE

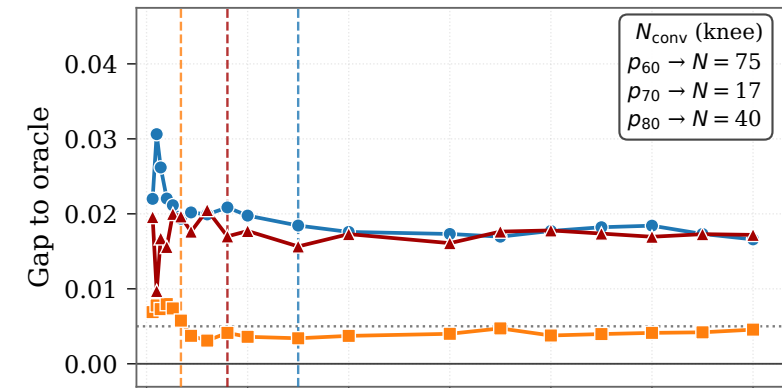

Dialseg711

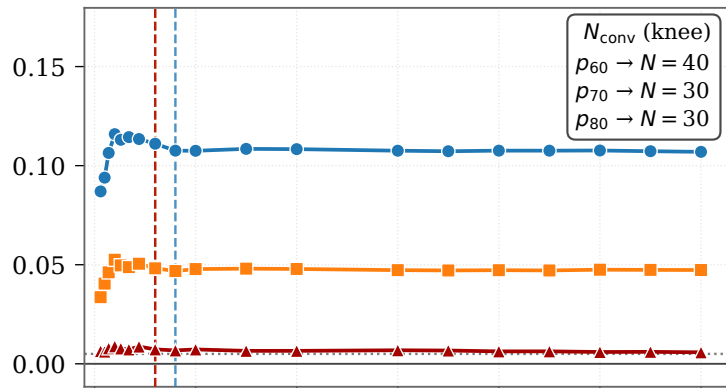

SuperDialseg

