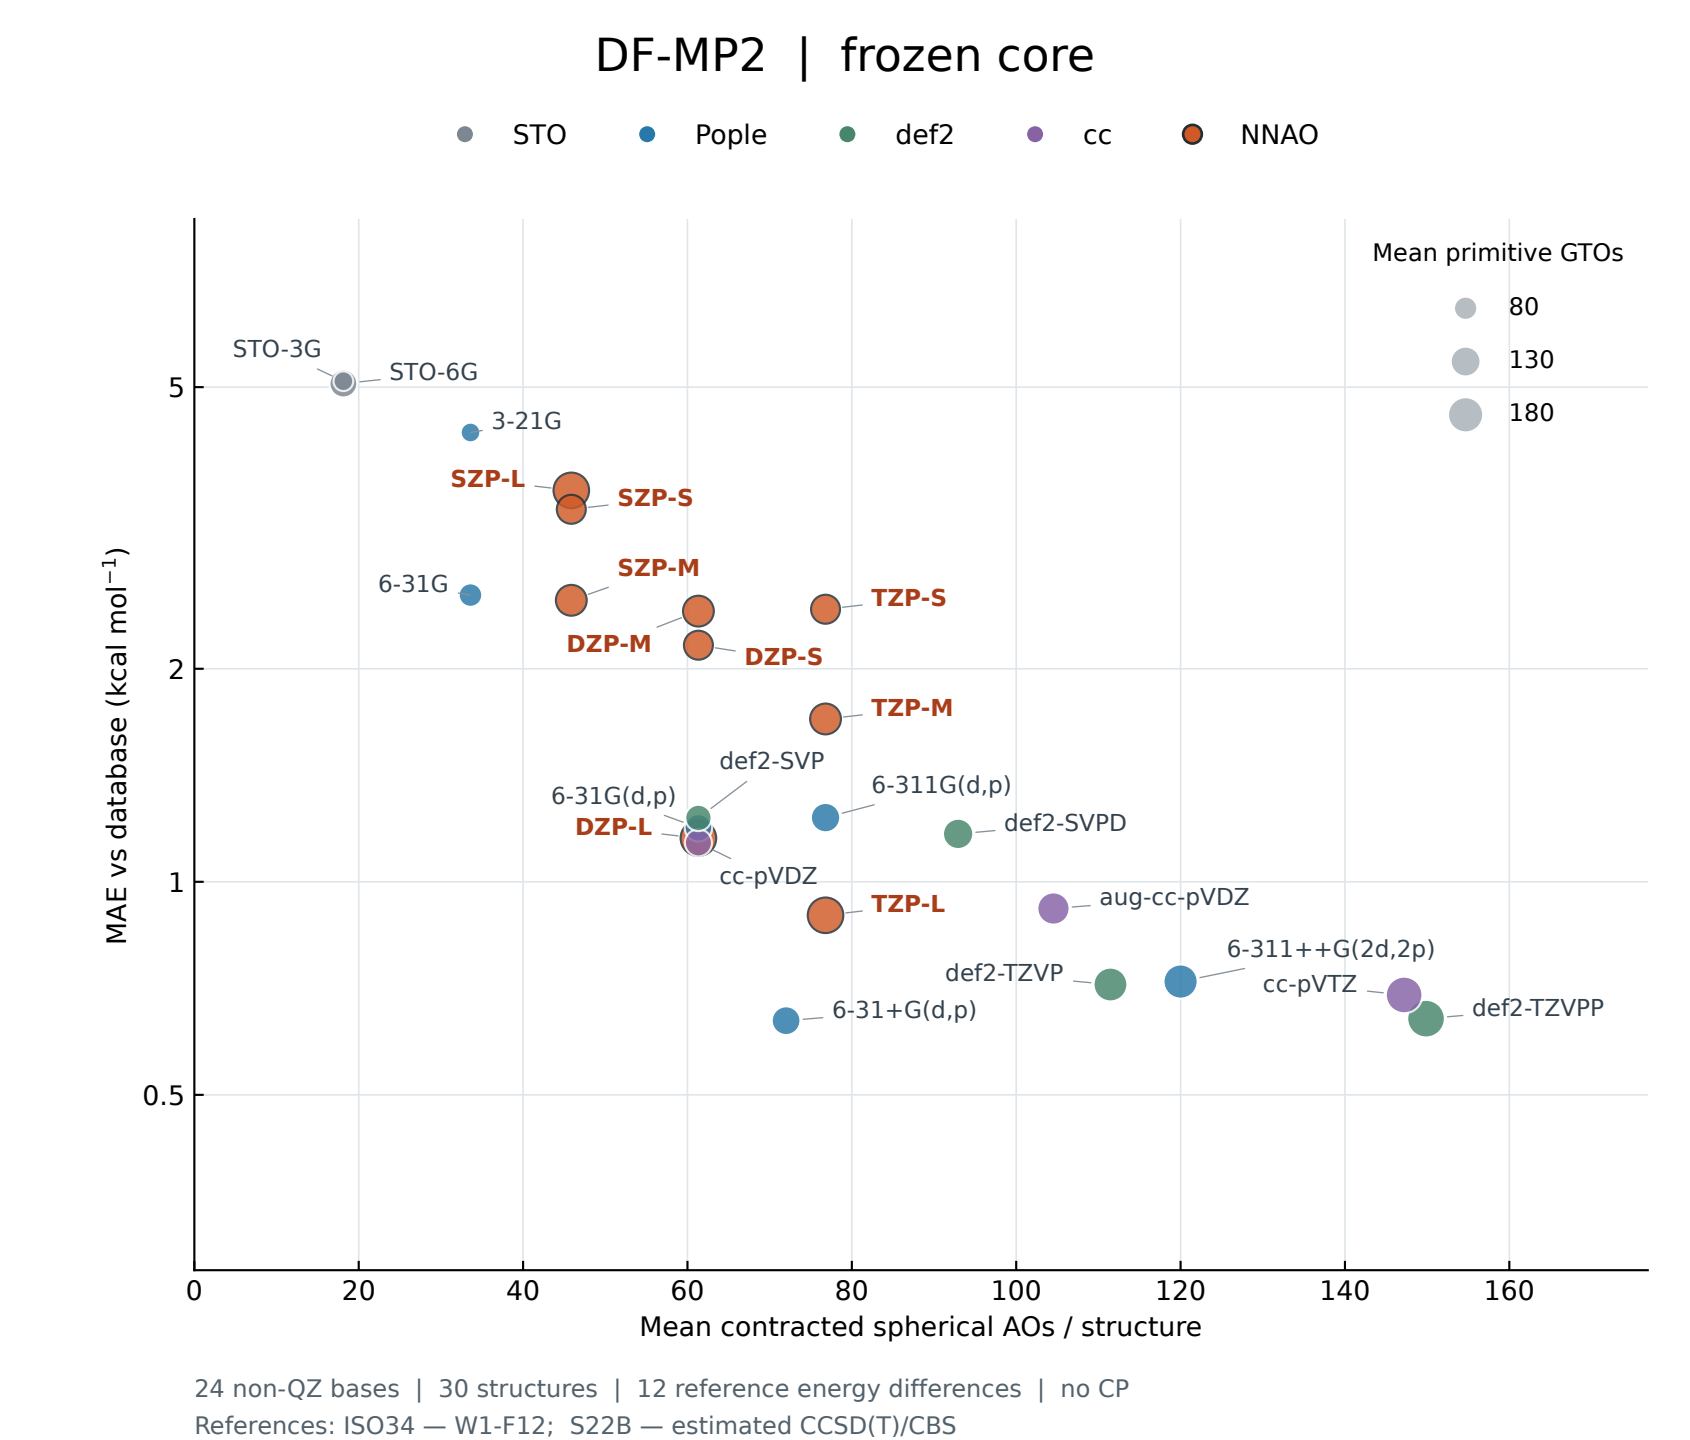

24 non-QZ bases | 30 structures | 12 reference energy differences | no CP

References: ISO34 — W1-F12; S22B — estimated CCSD(T)/CBS