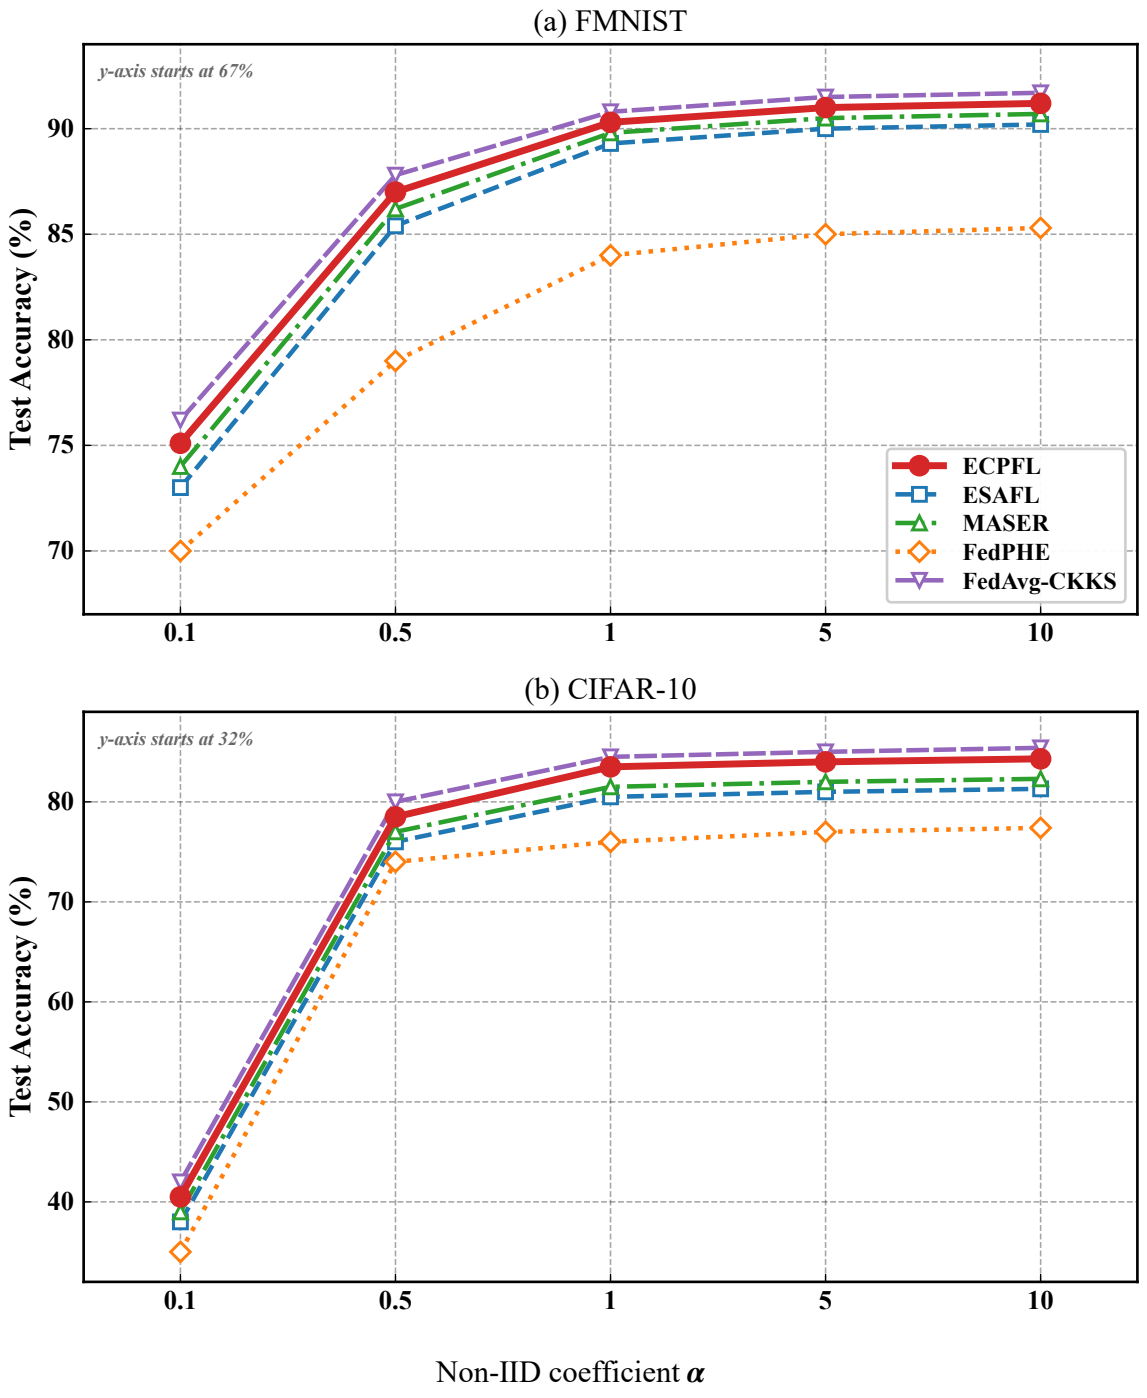

(a) FMNIST
y-axis starts at 67%
Test Accuracy (%)
90
85
80
75
70
0.1
0.5
1
5
10
ECPFL
ESAFL
MASER
FedPHE
FedAvg-CKKS
(b) CIFAR-10
y-axis starts at 32%
Test Accuracy (%)
80
70
60
50
40
0.1
0.5
1
5
10
Non-IID coefficient α