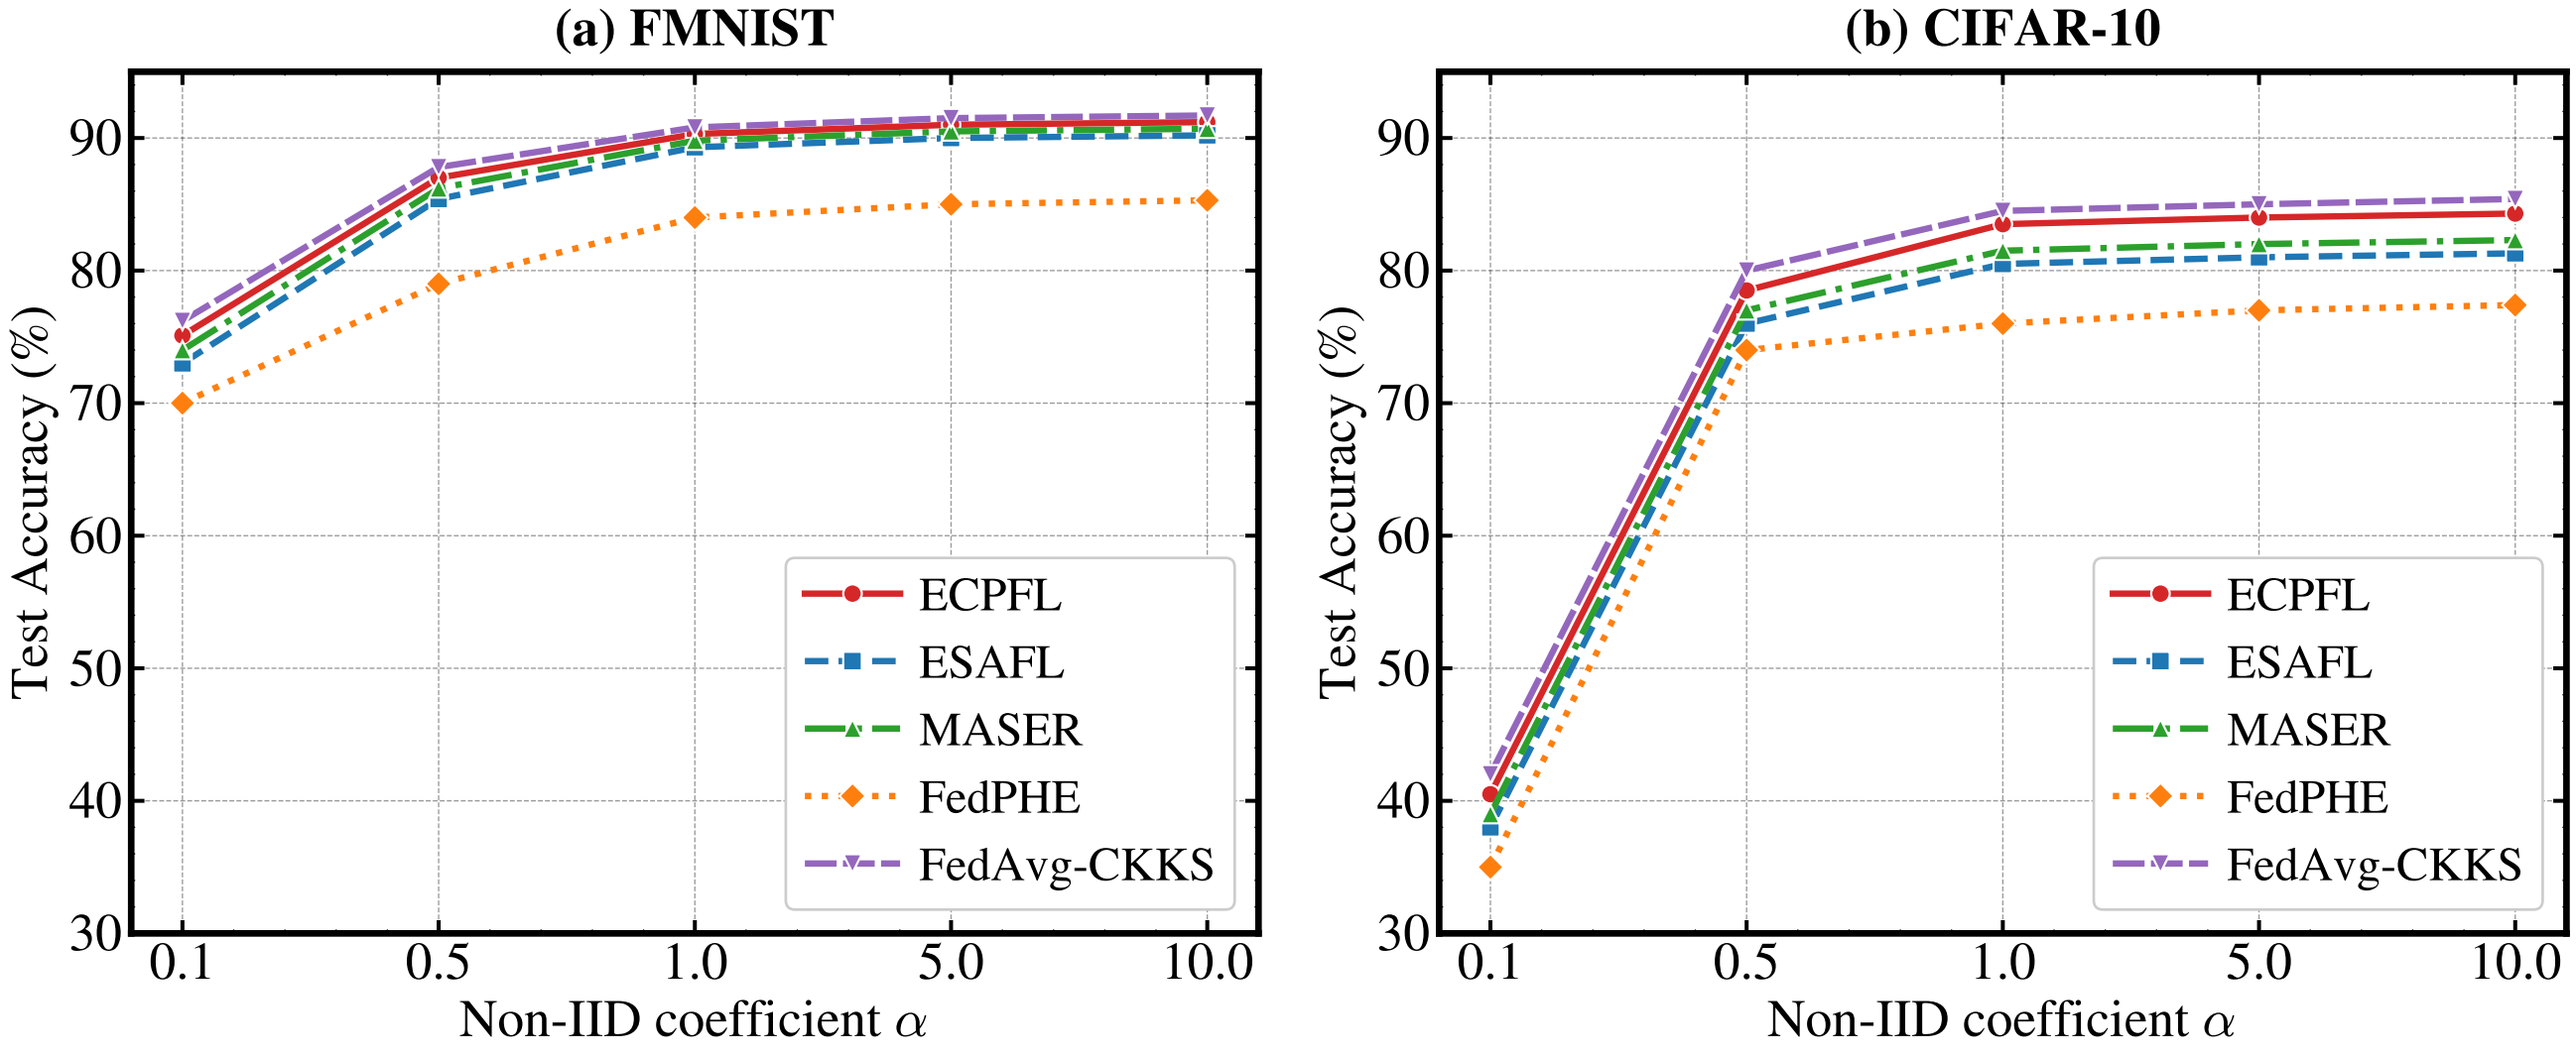
(a) FMNIST
(b) CIFAR-10
Test Accuracy (%)
Non-IID coefficient α
0.1
0.5
1.0
5.0
10.0
30
40
50
60
70
80
90
ECPFL
ESAFL
MASER
FedPHE
FedAvg-CKKS