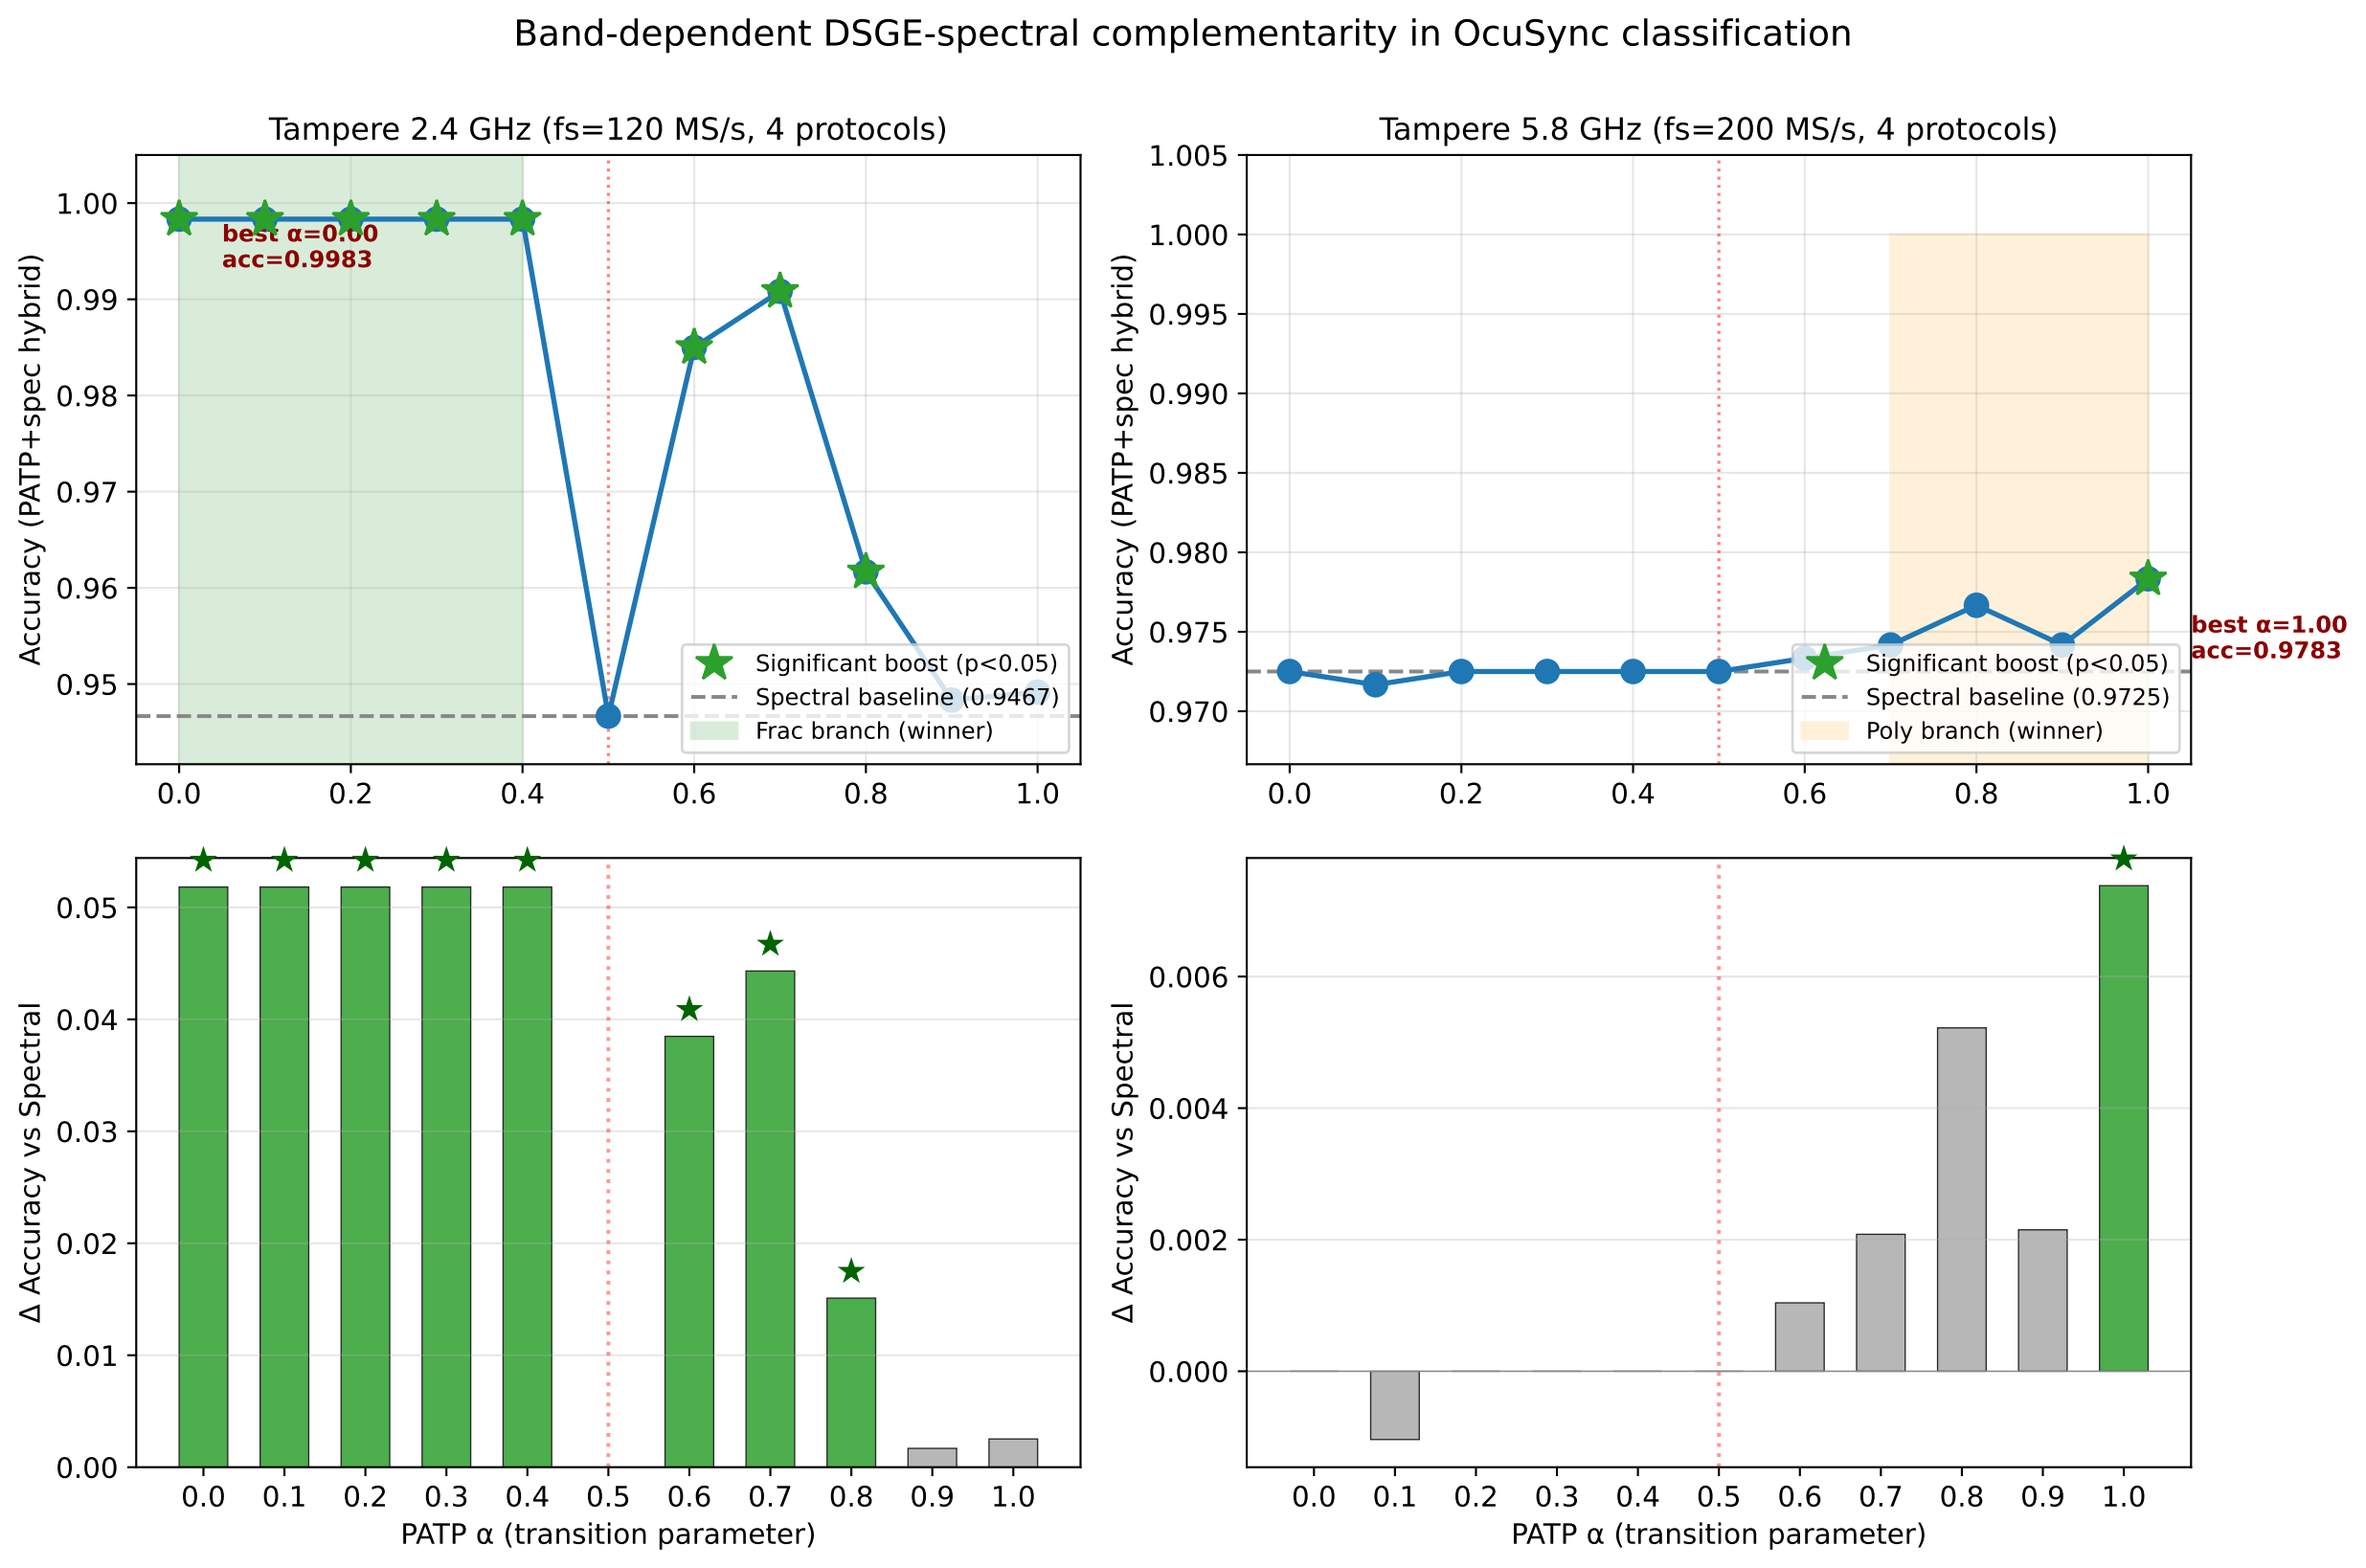
Band-dependent DSGE-spectral complementarity in OcuSync classification
Tampere 2.4 GHz (fs=120 MS/s, 4 protocols)
Tampere 5.8 GHz (fs=200 MS/s, 4 protocols)
Accuracy (PATP+spec hybrid)
best α=0.00
acc=0.9983
Significant boost (p<0.05)
Spectral baseline (0.9467)
Frac branch (winner)
Spectral baseline (0.9725)
Poly branch (winner)
best α=1.00
acc=0.9783
Δ Accuracy vs Spectral
PATP α (transition parameter)