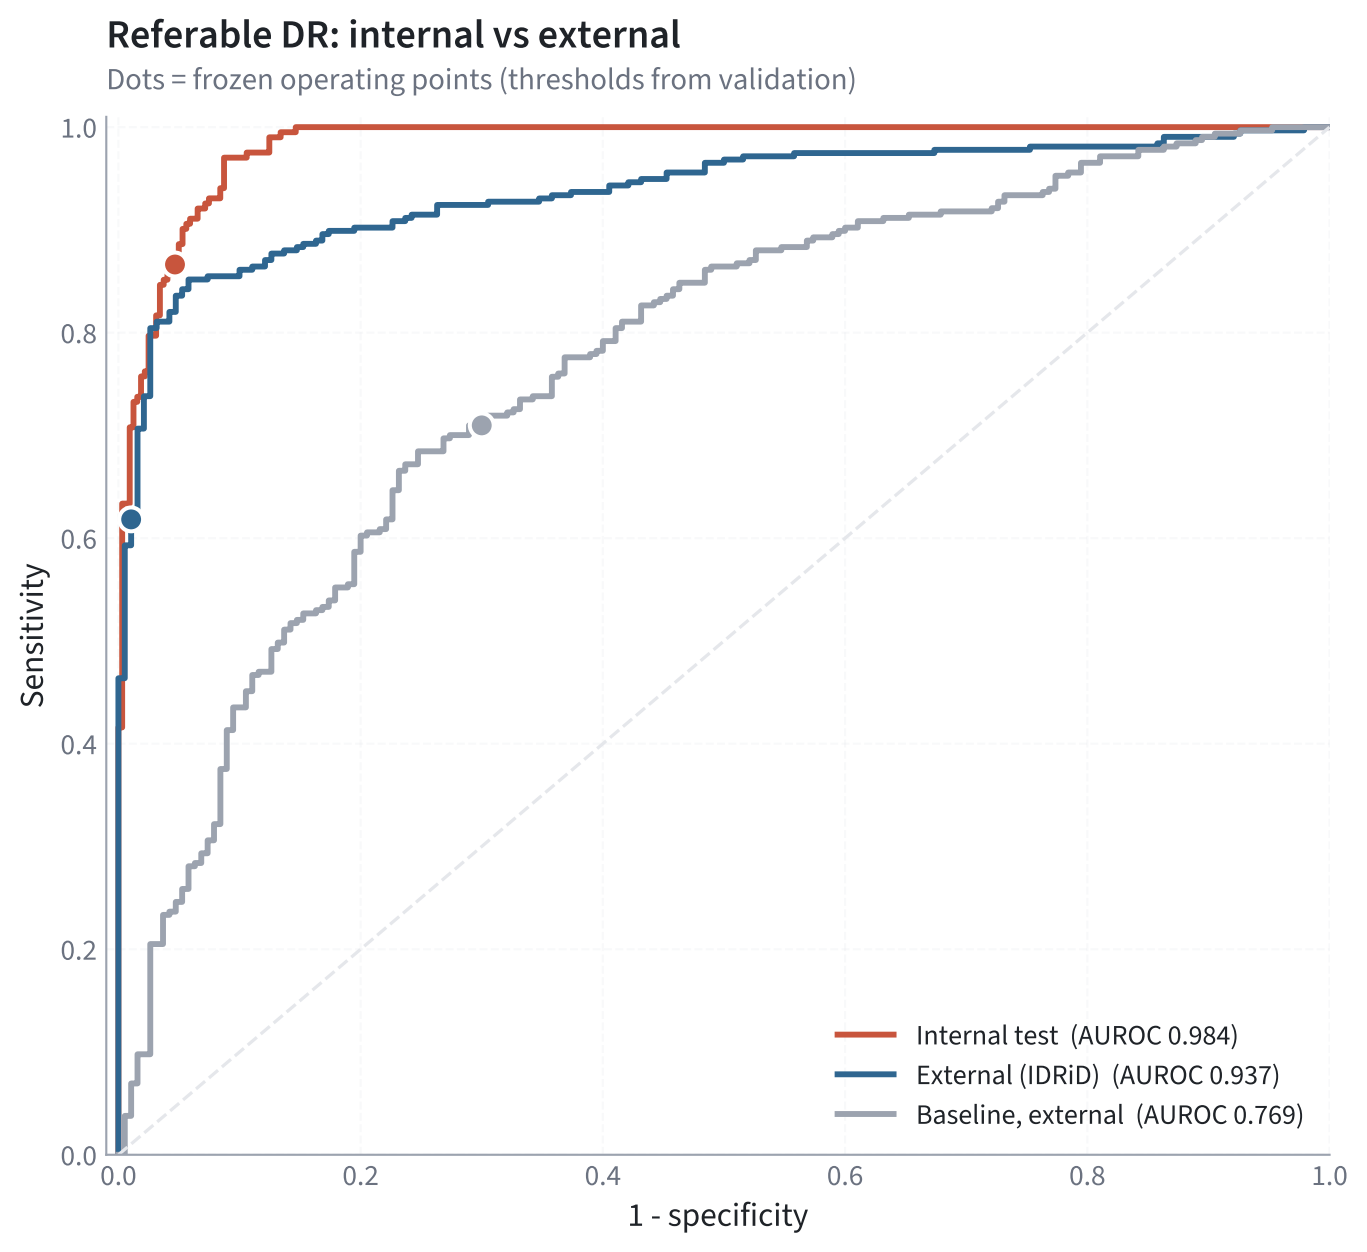
Referable DR: internal vs external
Dots = frozen operating points (thresholds from validation)
Sensitivity
1 - specificity
0.0
0.2
0.4
0.6
0.8
1.0
Internal test (AUROC 0.984)
External (IDRiD) (AUROC 0.937)
Baseline, external (AUROC 0.769)