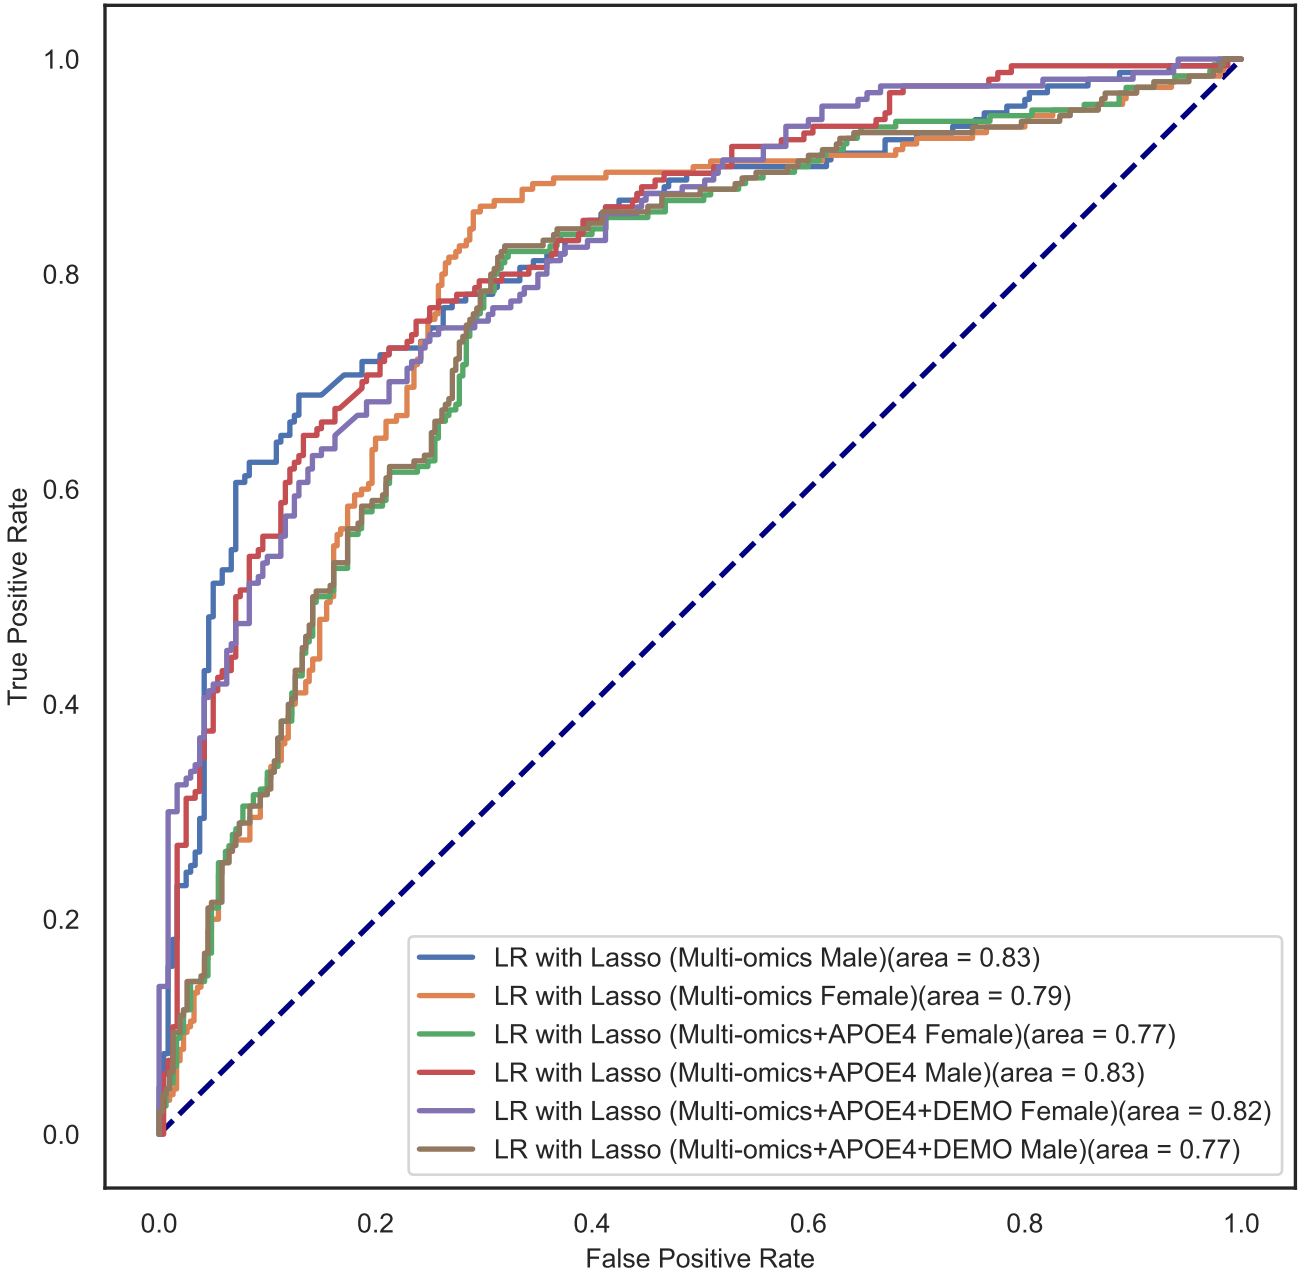
True Positive Rate
False Positive Rate
0.0
0.2
0.4
0.6
0.8
1.0
LR with Lasso (Multi-omics Male)(area = 0.83)
LR with Lasso (Multi-omics Female)(area = 0.79)
LR with Lasso (Multi-omics+APOE4 Female)(area = 0.77)
LR with Lasso (Multi-omics+APOE4 Male)(area = 0.83)
LR with Lasso (Multi-omics+APOE4+DEMO Female)(area = 0.82)
LR with Lasso (Multi-omics+APOE4+DEMO Male)(area = 0.77)