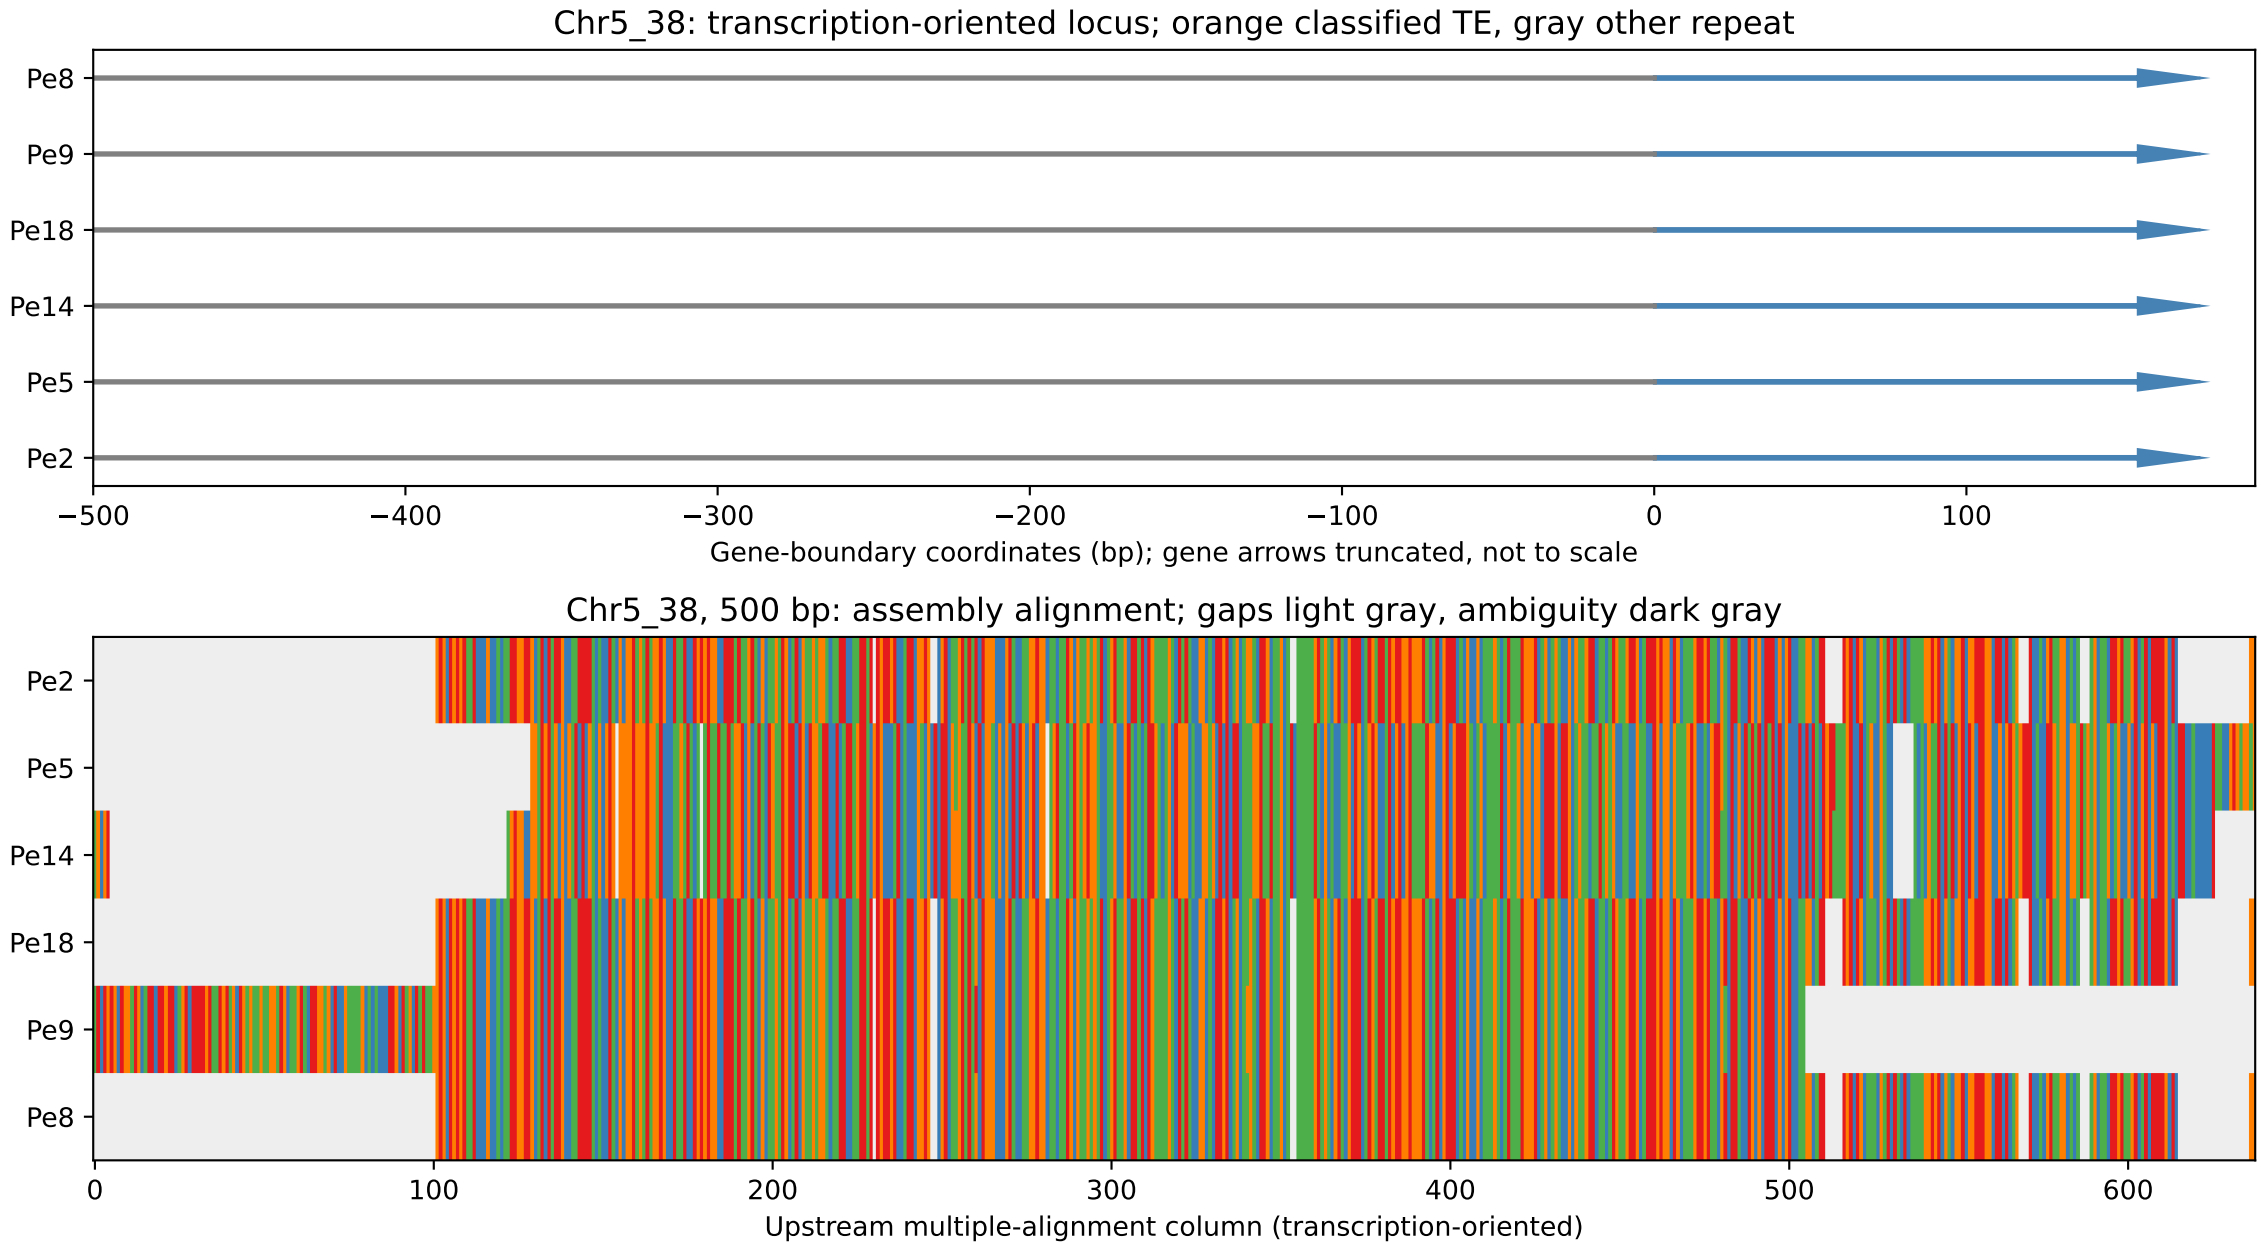

Candidate screen; TE insertion history and regulatory function are not established.