



Real one-channel examples through the frozen normal autoencoder


Healthy MIT-BIH NSRDB first ECG channel

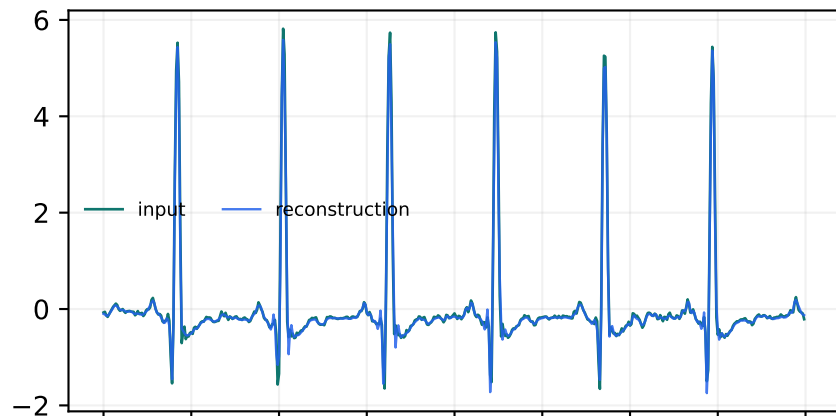

absolute residual; mean = 0.060

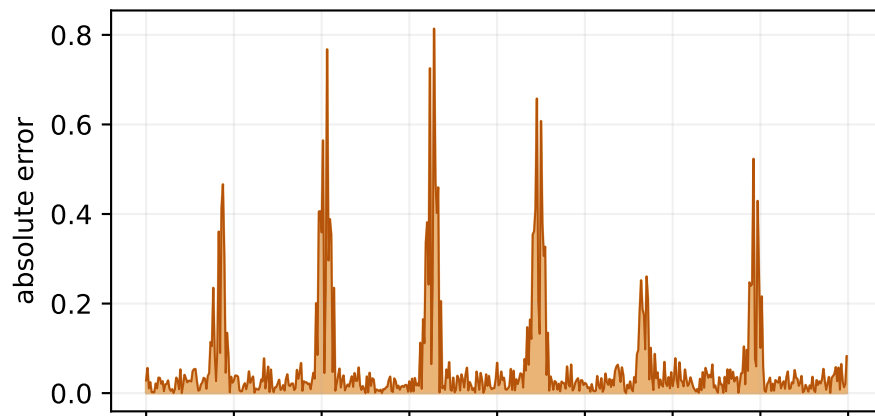

Abnormal MITDB MLII example: PVC

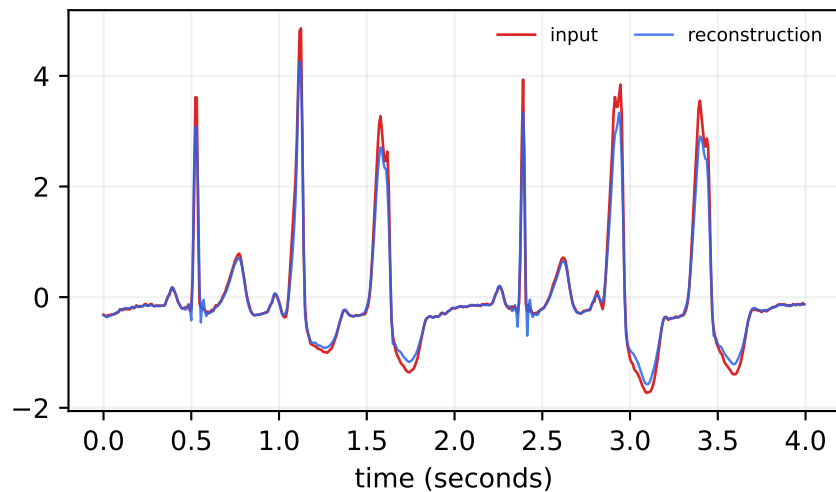

absolute residual; mean = 0.091

